


Supplementary figure 4

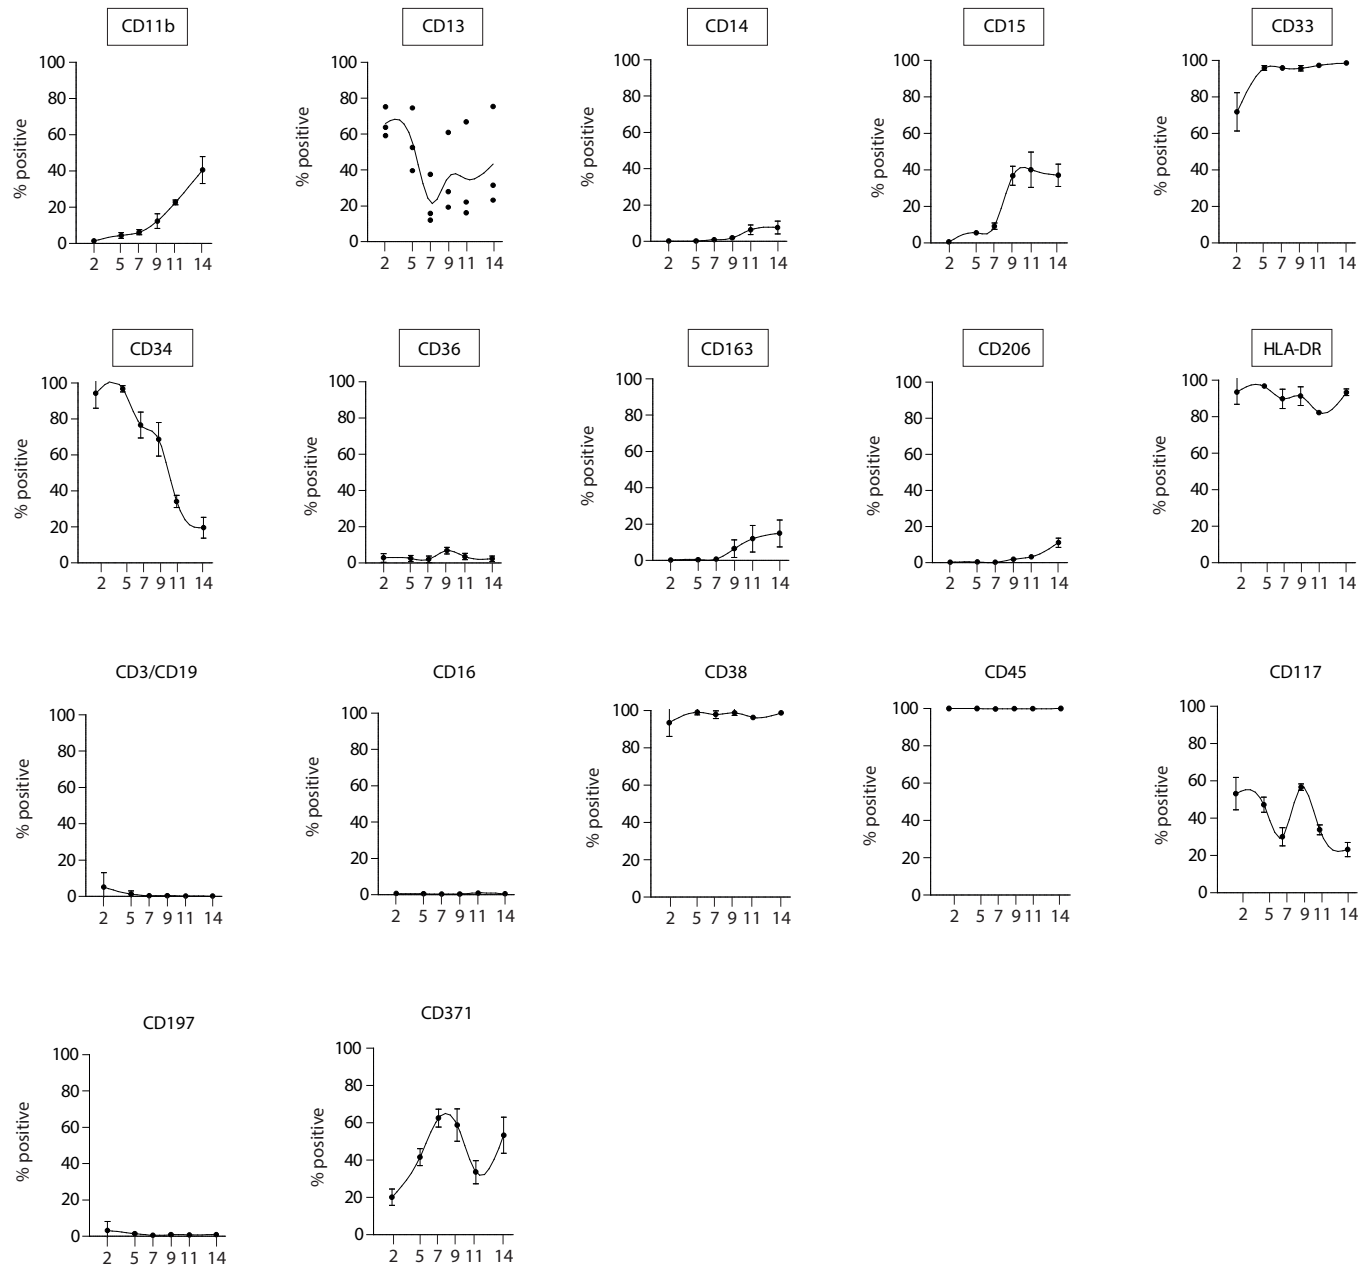

Supplementary figure 4. Frequencies of markers expressed on total viable cells in myeloid panel measured over time. Markers indicated in boxes were used to further characterize the non-DC compartment by using the non-DC panel.