


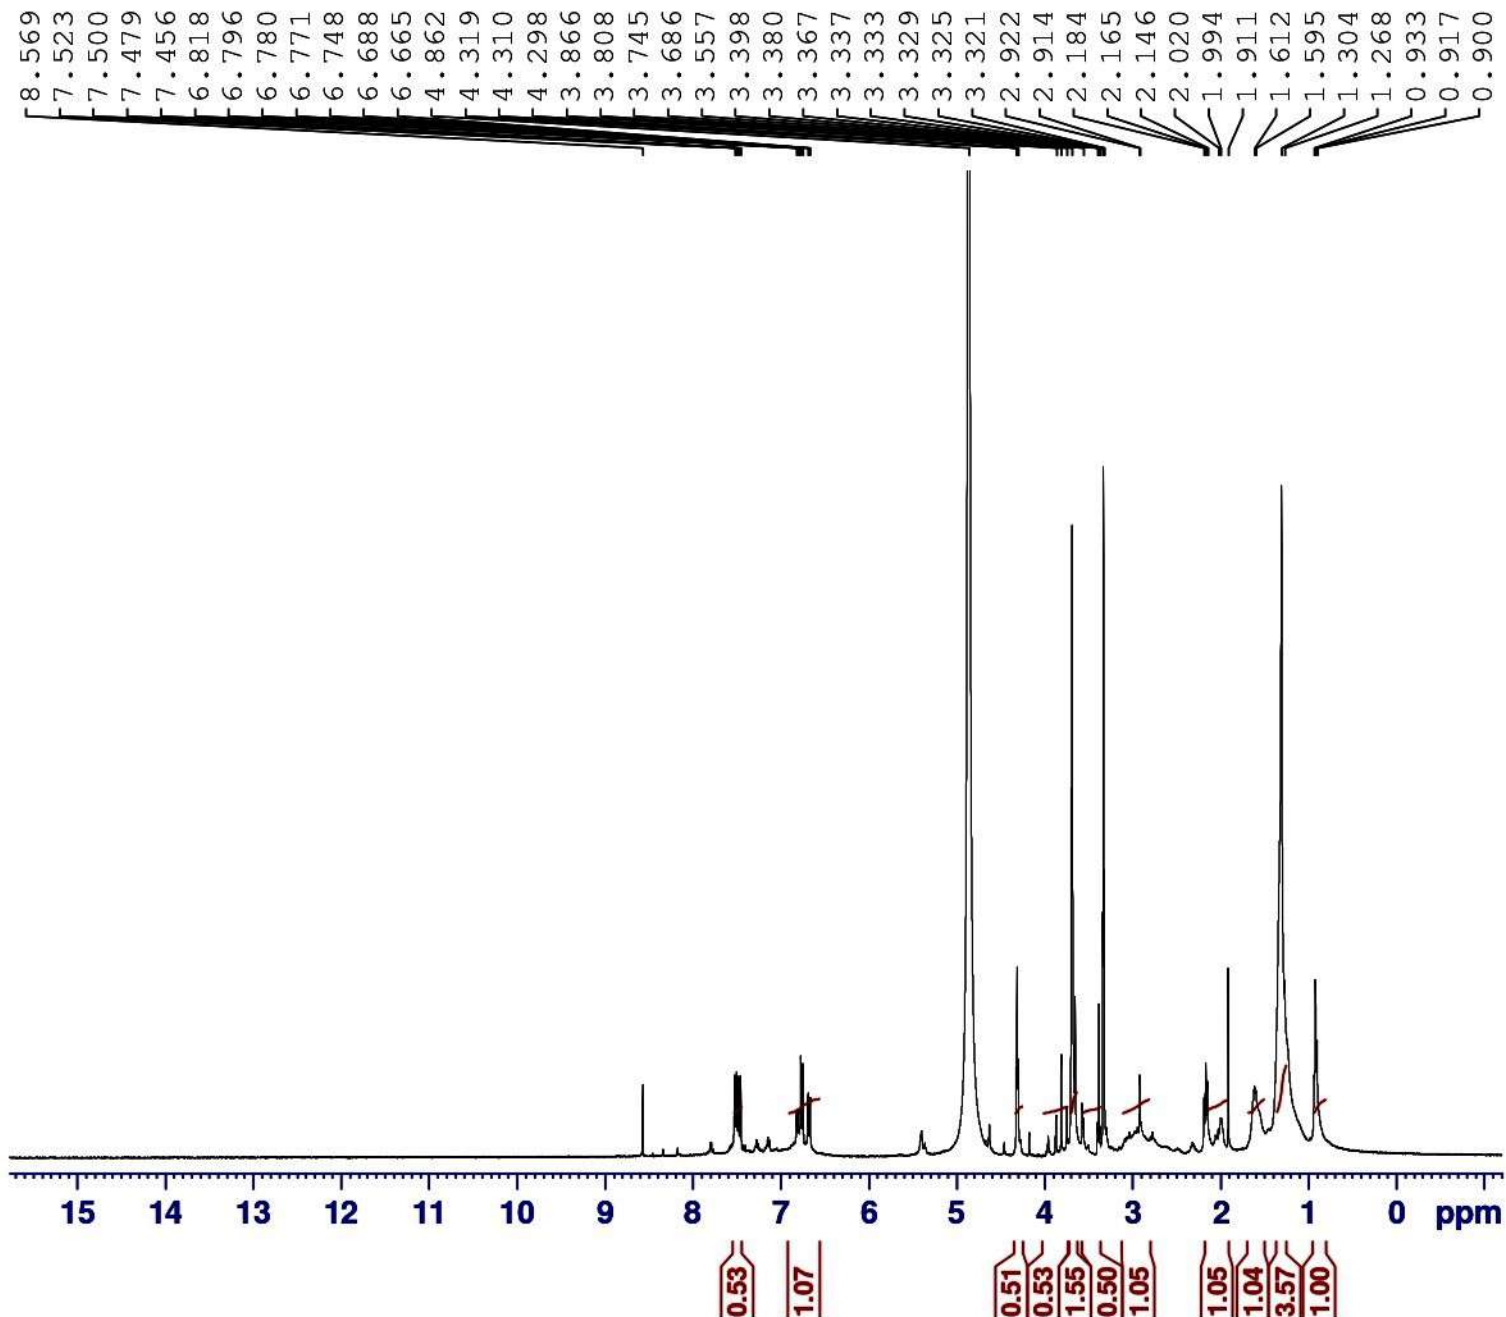


Current Data Parameters
 NAME ahmed-samy-BPH
 EXPNO 1
 PROCNO 1

F2 - Acquisition Parameters
 Date_ 20231128
 Time 16.52
 INSTRUM spect
 PROBHD 5 mm PABBO BB/
 PULPROG zg30
 TD 65536
 SOLVENT MeOD
 NS 88
 DS 2
 SWH 8012.820 Hz
 FIDRES 0.122266 Hz
 AQ 4.0894465 sec
 RG 205.37
 DW 62.400 usec
 DE 6.50 usec
 TE 300.0 K
 D1 1.00000000 sec
 TD0 1

===== CHANNEL f1 =====
 SFO1 400.1524711 MHz
 NUC1 1H
 P1 12.00 usec
 PLW1 18.00000000 W

F2 - Processing parameters
 SI 65536
 SF 400.1500000 MHz
 WDW EM
 SSB 0
 LB 0.30 Hz
 GB 0
 PC 1.00

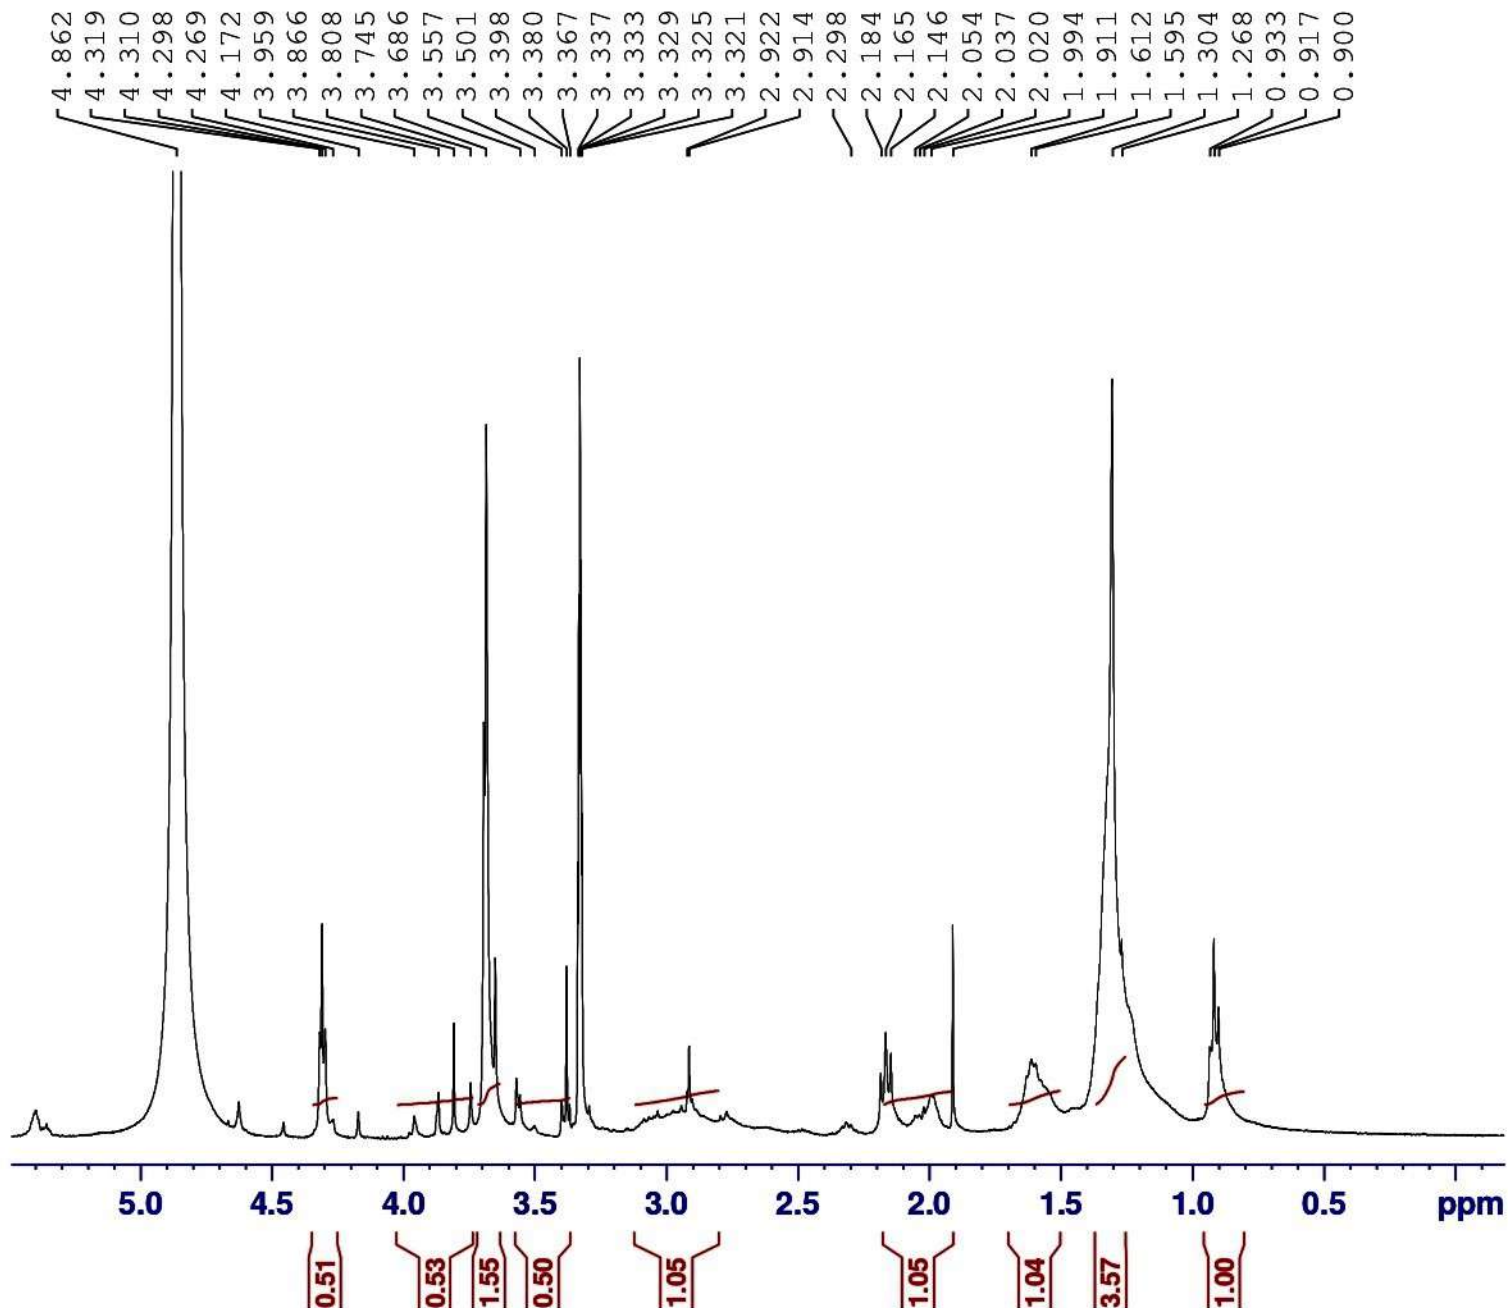


Current Data Parameters
 NAME ahmed-samy-BPH
 EXPNO 1
 PROCNO 1

F2 - Acquisition Parameters
 Date_ 20231128
 Time 16.52
 INSTRUM spect
 PROBHD 5 mm PABBO BB/
 PULPROG zg30
 TD 65536
 SOLVENT MeOD
 NS 88
 DS 2
 SWH 8012.820 Hz
 FIDRES 0.122266 Hz
 AQ 4.0894465 sec
 RG 205.37
 DW 62.400 usec
 DE 6.50 usec
 TE 300.0 K
 D1 1.00000000 sec
 TD0 1

===== CHANNEL f1 =====
 SFO1 400.1524711 MHz
 NUC1 1H
 P1 12.00 usec
 PLW1 18.00000000 W

F2 - Processing parameters
 SI 65536
 SF 400.1500000 MHz
 WDW EM
 SSB 0
 LB 0.30 Hz
 GB 0
 PC 1.00

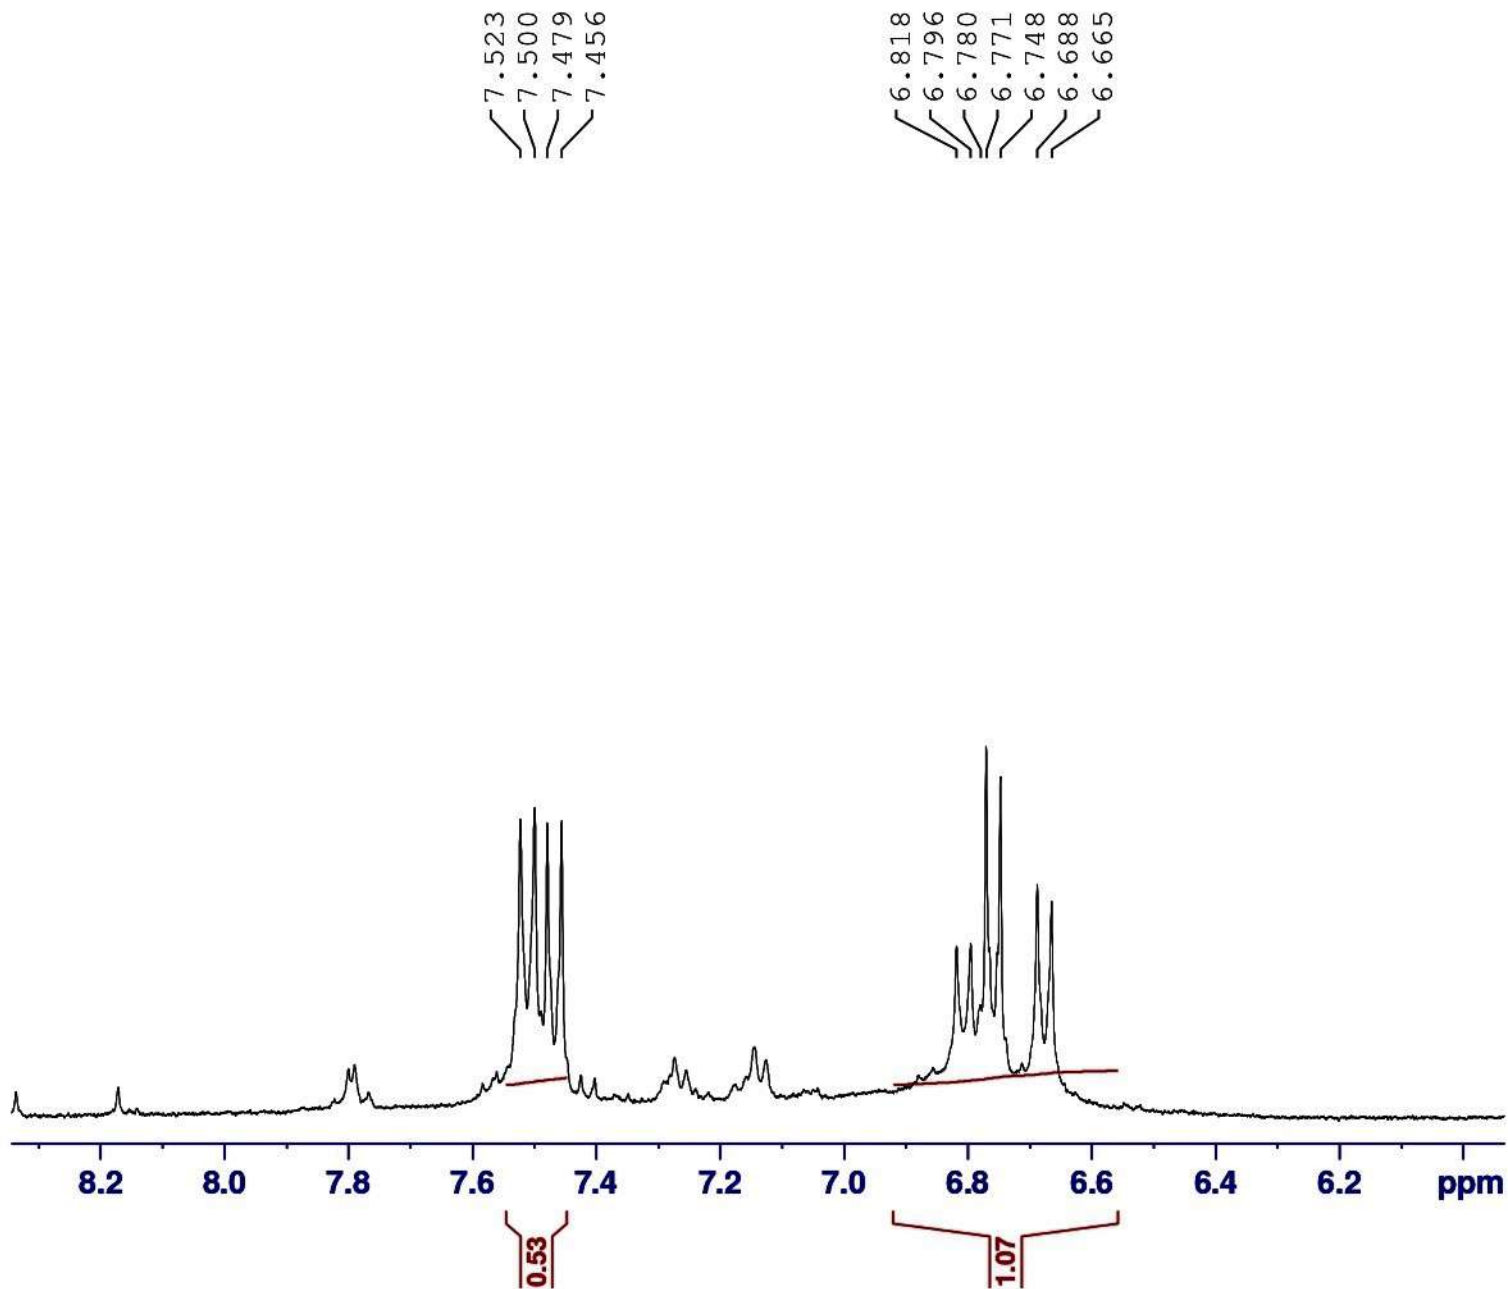

Current Data Parameters
 NAME ahmed-samy-BPH
 EXPNO 1
 PROCNO 1

F2 - Acquisition Parameters
 Date_ 20231128
 Time 16.52
 INSTRUM spect
 PROBHD 5 mm PABBO BB/
 PULPROG zg30
 TD 65536
 SOLVENT MeOD
 NS 88
 DS 2
 SWH 8012.820 Hz
 FIDRES 0.122266 Hz
 AQ 4.0894465 sec
 RG 205.37
 DW 62.400 usec
 DE 6.50 usec
 TE 300.0 K
 D1 1.00000000 sec
 TD0 1

===== CHANNEL f1 =====
 SFO1 400.1524711 MHz
 NUC1 1H
 P1 12.00 usec
 PLW1 18.00000000 W

F2 - Processing parameters
 SI 65536
 SF 400.1500000 MHz
 WDW EM
 SSB 0
 LB 0.30 Hz
 GB 0
 PC 1.00