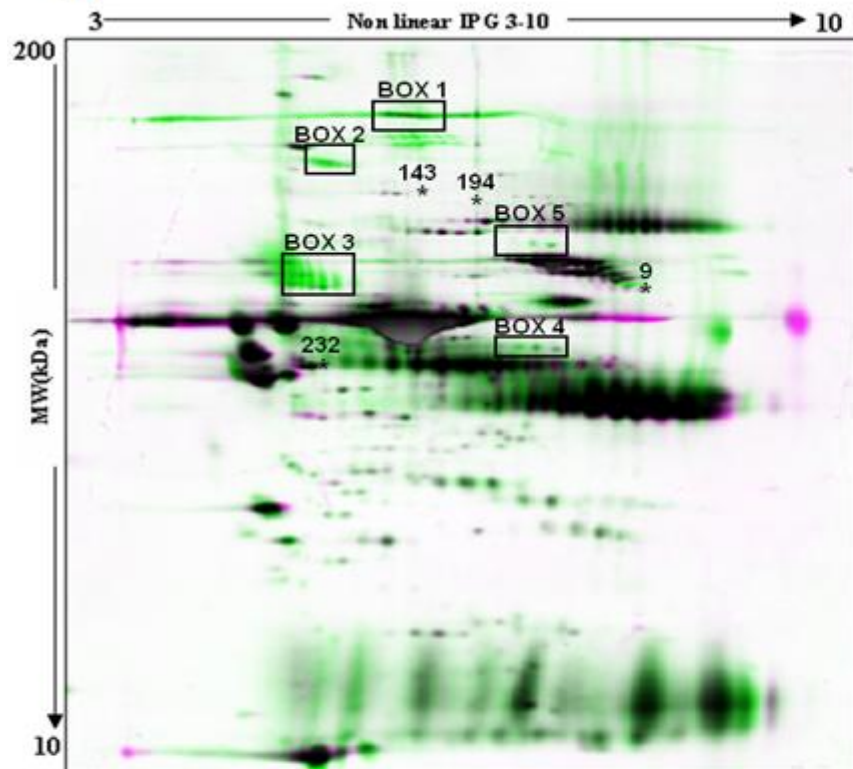


A**B**

Spot N (Figure 3A)	Spot N*	p-value	q-value	Power *	Class
9	9	5,77E-04	6,59E-03	0.999	Only MFF
143	143	1,58E-03	1,35E-02	0.994	Only Serum
232	232	2,71E-04	3,56E-03	0.999	Serum> MFF
194	194	1,28E-03	1,10E-02	0.992	Serum> MFF
Box 1	40	3,32E-04	1,77E-02	1	Serum> MFF
	41	4,65E-07	2,75E-05	1	
	42	4,61E-09	2,99E-06	1	
	46	1,13E-08	2,99E-06	1	
	65	9,89E-08	9,78E-06	1	
	96	9,25E-07	4,33E-05	1	
	106	1,76E-06	5,72E-05	1	
Box 2	131	8,32E-06	1,85E-04	1	Serum> MFF
	132	7,15E-06	1,70E-04	1	
	59	1,98E-06	6,24E-05	1	
	74	6,40E-08	8,16E-06	1	
	77	5,28E-07	2,75E-05	1	
	83	4,36E-07	2,75E-05	1	
	89	7,88E-08	8,78E-06	1	
Box 3	104	1,20E-08	2,99E-06	1	Only Serum
	114	9,77E-05	1,45E-03	1	
	138	1,19E-06	4,75E-05	1	
Box 4	137	4,76E-06	1,21E-04	1	Serum> MFF
	152	9,44E-04	8,63E-03	0.997	
Box 5	158	2,72E-07	2,02E-05	1	Only Serum
	161	6,77E-05	1,04E-03	1	
Box 5	177	2,26E-05	4,00E-04	1	Only Serum
	78	5,67E-05	8,74E-04	1	
	87	1,83E-05	3,34E-04	1	
Box 5	117	1,21E-06	4,75E-05	1	Only Serum
	121	1,31E-06	4,75E-05	1	

*Power can be defined as the probability of finding a real difference if it exists. 80% or 0.8 is considered an acceptable value for power. The Power Analysis is performed independently for each spot.