


Anton Swart Biokinetic Rehabilitation Practice

Name: 001 001 001
Number: 001
Gender: Male
Birthdate: 01/06/1967 50 years

P / PQ: 120 ms / 170 ms
QRS: 82 ms
QT / QTc / QTd: 363 ms / 433 ms / -
P/QRS/T axis: 73° / 82° / 61°
Heartrate: 100 bpm

Recorded: 03/05/2018 16:52:25
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

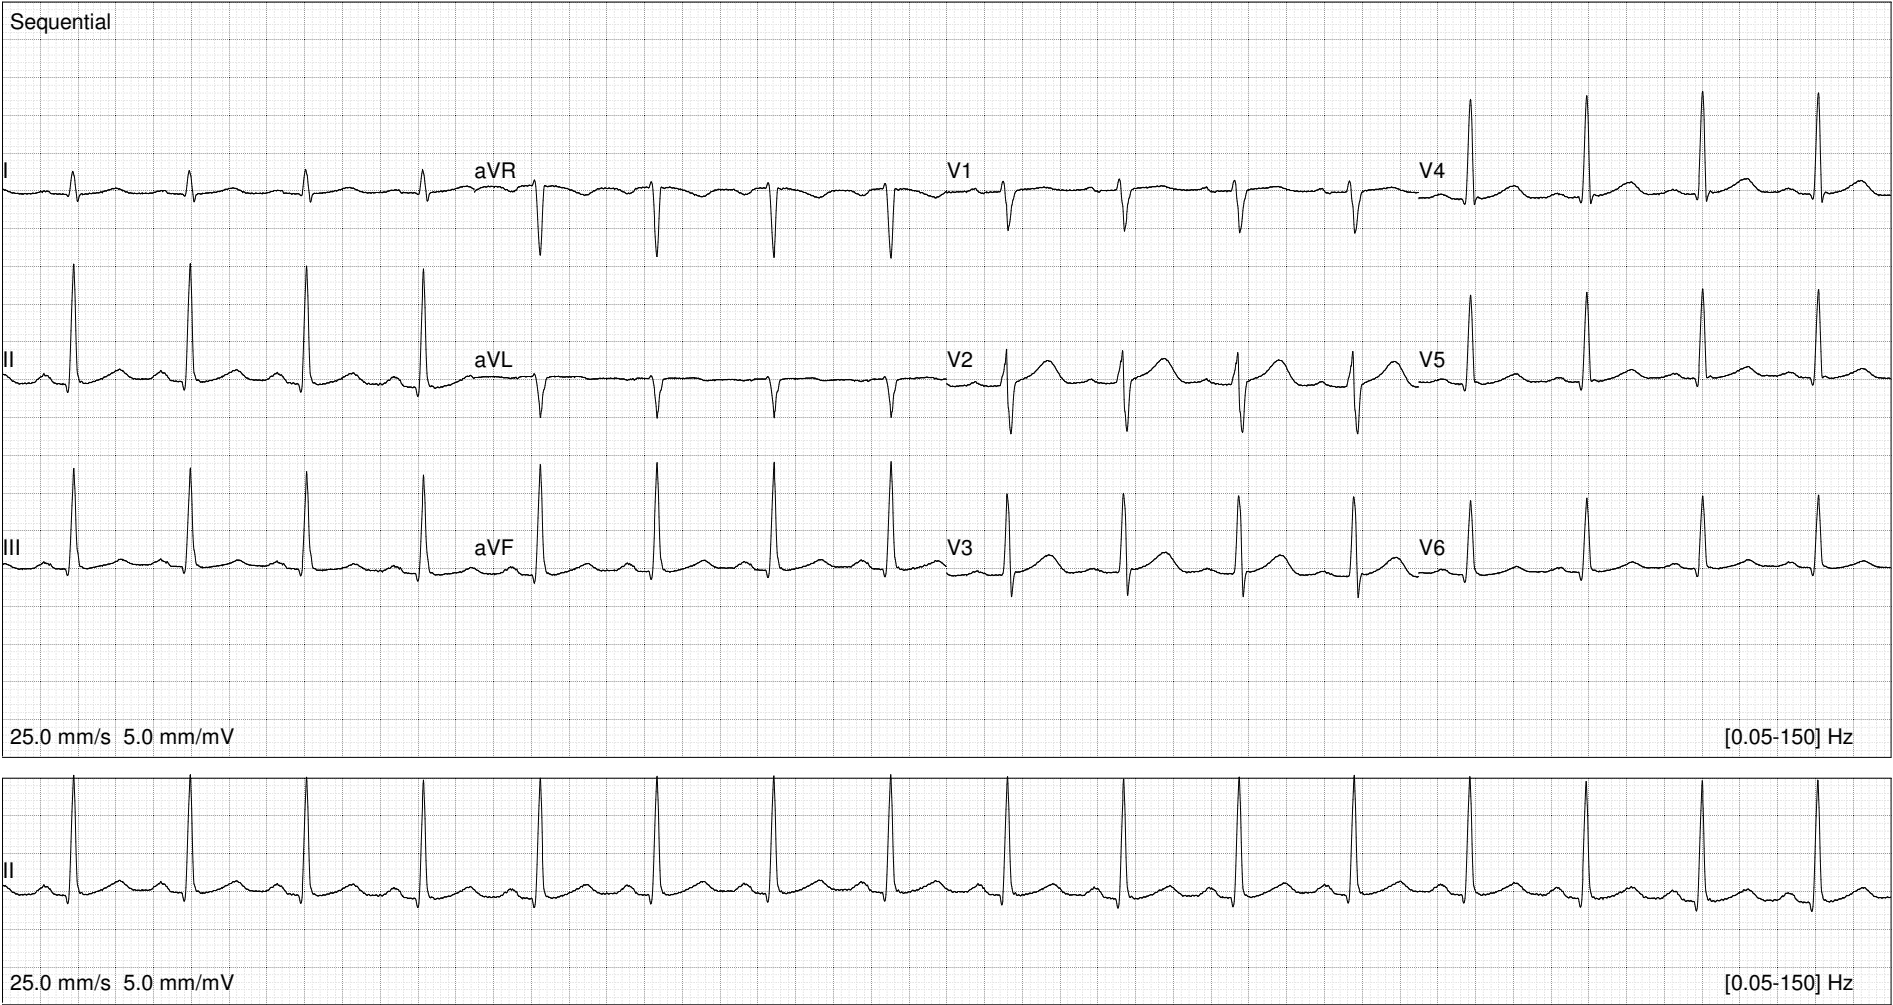

Anton Swart Biokinetic Rehabilitation Practice

Name:

001 001 001

Number:

001

Gender:

Male

Birthdate:

01/06/1967 50 years

P / PQ:

120 ms / 170 ms

QRS:

82 ms

QT / QTc / QTd:

363 ms / 433 ms / -

P/QRS/T axis:

73° / 82° / 61°

Heartrate:

100 bpm

Recorded:

03/05/2018 16:52:25

Recorded by:

Mr. Anton Swart

Referring physician:

Location:

Anton Swart Biokinetic Rehabilitation Practice



Ordering physician:

Attending physician:

Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW



Beats		RR	
Total:	497	Minimum	570 ms
Normal:	497	Maximum	623 ms
Other:	0	Mean:	602 ms
		SD:	7 ms

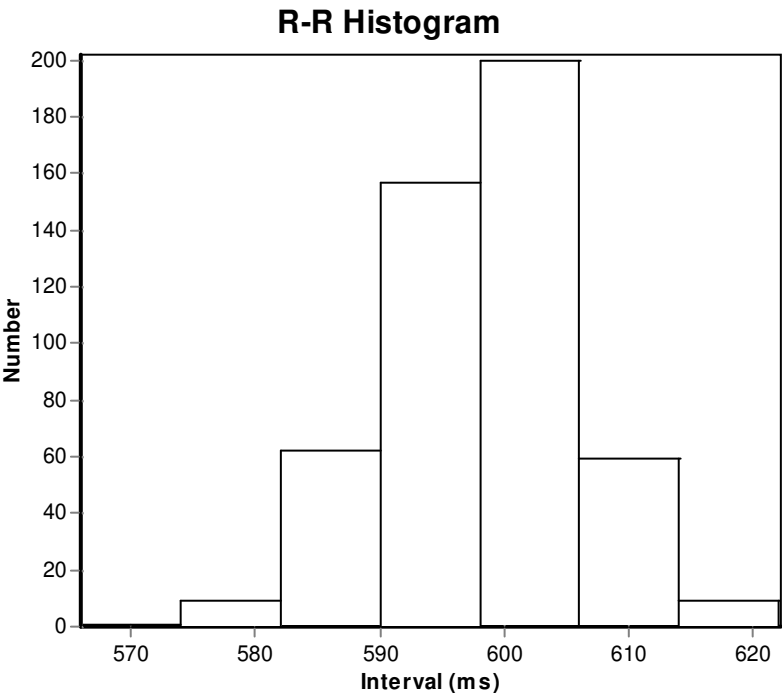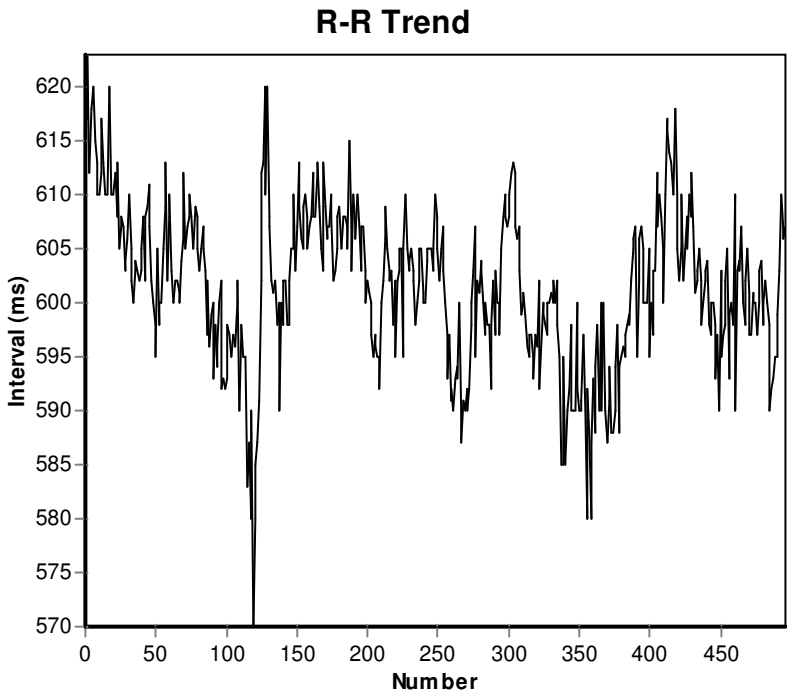

Heart Rate Variability: Time Domain Analysis

Name: 001, 001 001
Number: 001
Gender: Male


Birthdate: 01/06/1967
Recorded: 03/05/2018 16:52:25

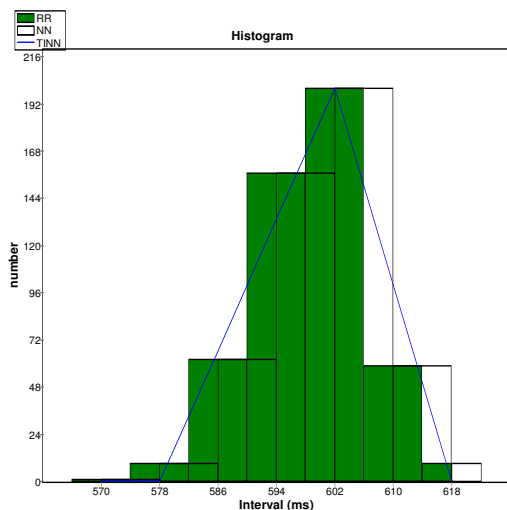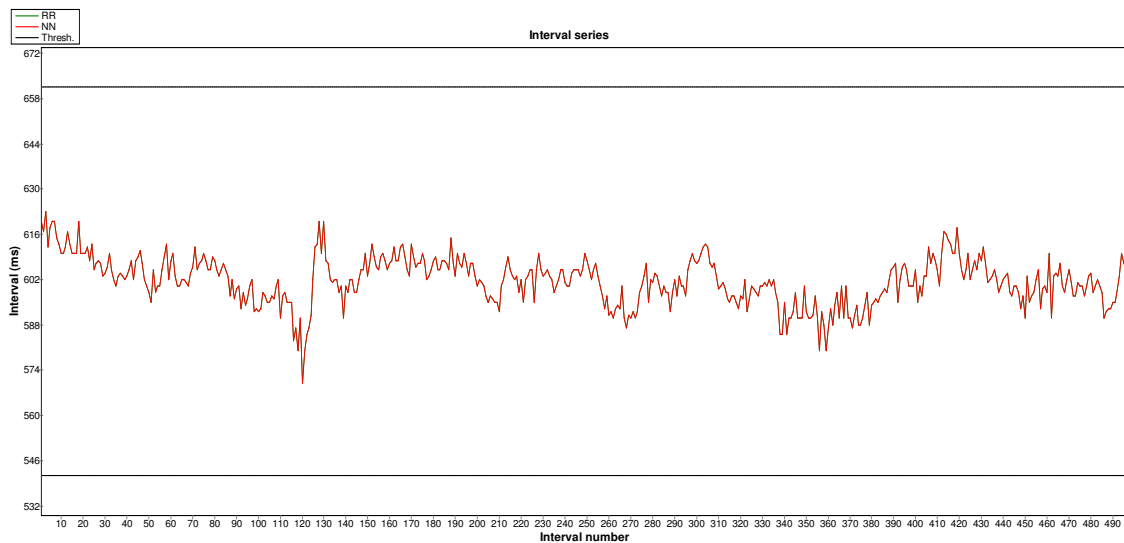

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	7	7
Triangular Interpolation (ms)	40	40
Triangular Index	2.48	2.48

Interval statistics	NN	RR
Number	497	497
Minimum (ms)	570	570
Maximum (ms)	623	623
Range (ms)	53	53
Avg (ms)	602	602
SD (ms)	7	7
AvgDev (ms)	6	6
p5 (ms)	590	590
p50 (ms)	602	602
p95 (ms)	613	613
Skewness	-0.27	-0.27
Kurtosis	3.64	3.64


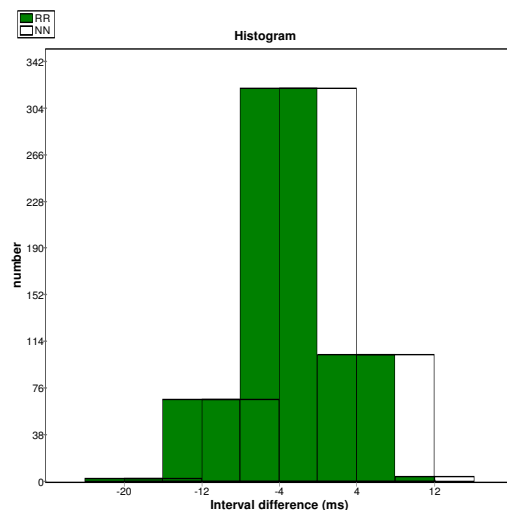


HRV parameters	NN	RR
SDSD (ms)	5	5
RMSSD (ms)	5	5
NN50	0	0
NN50(1)	0	0
NN50(2)	0	0
pNN50	0.00	0.00
pNN50(1)	0.00	0.00
pNN50(2)	0.00	0.00
Logarithmic Index	2.69	2.69
SD(Logarithmic Index)	0.37	0.37

Interval statistics	NN	RR
Number	496	496
Minimum (ms)	-20	-20
Maximum (ms)	13	13
Range (ms)	33	33
Avg (ms)	-0	-0
SD (ms)	5	5
AvgDev (ms)	4	4
p5 (ms)	-9	-9
p50 (ms)	0	0
p95 (ms)	8	8
Skewness	-0.35	-0.35
Kurtosis	4.12	4.12

Heart Rate Variability: Frequency Domain Analysis

Name: 001, 001 001 Birthdate: 01/06/1967
 Number: 001 Recorded: 03/05/2018 16:52:25
 Gender: Male

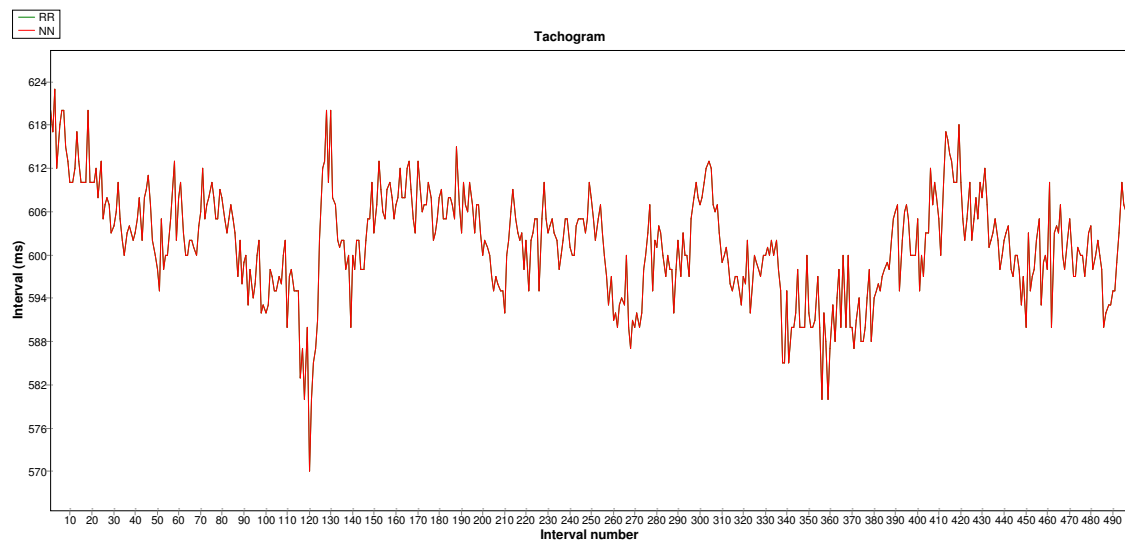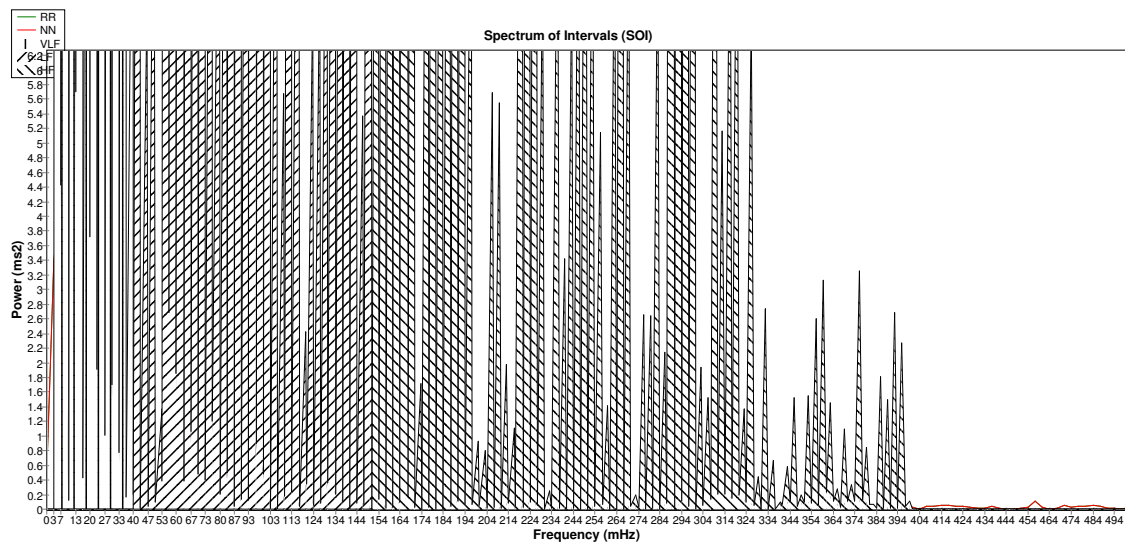

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	37	37	Spectrum of Intervals (SOI)	
VLF (ms2)	20	20	Frequency resolution (mHz)	3
LF (ms2)	13	13	VLF lower boundary (mHz)	3
HF (ms2)	4	4	VLF upper boundary (mHz)	40
LF/HF	3.12	3.12	LF upper boundary (mHz)	150
LF normalized	75.71	75.71	HF upper boundary (mHz)	400
HF normalized	24.29	24.29	Smoothing factor	1
VLF peak (mHz)	13	13	Tapering	Hann
LF peak (mHz)	57	57	Fourier transform	DFT
HF peak (mHz)	361	361	Sample frequency (Hz)	1.66
			Interval correction	Annotation
			Interval threshold (%)	10