


Anton Swart Biokinetic Rehabilitation Practice

Name: 002 002 002
Number: 002
Gender: Male
Birthdate: 04/02/1978 40 years

P / PQ: 123 ms / 188 ms
QRS: 94 ms
QT / QTc / QTd: 370 ms / 398 ms / -
P/QRS/T axis: 66° / 46° / 67°
Heartrate: 76 bpm

Recorded: 03/05/2018 17:22:31
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

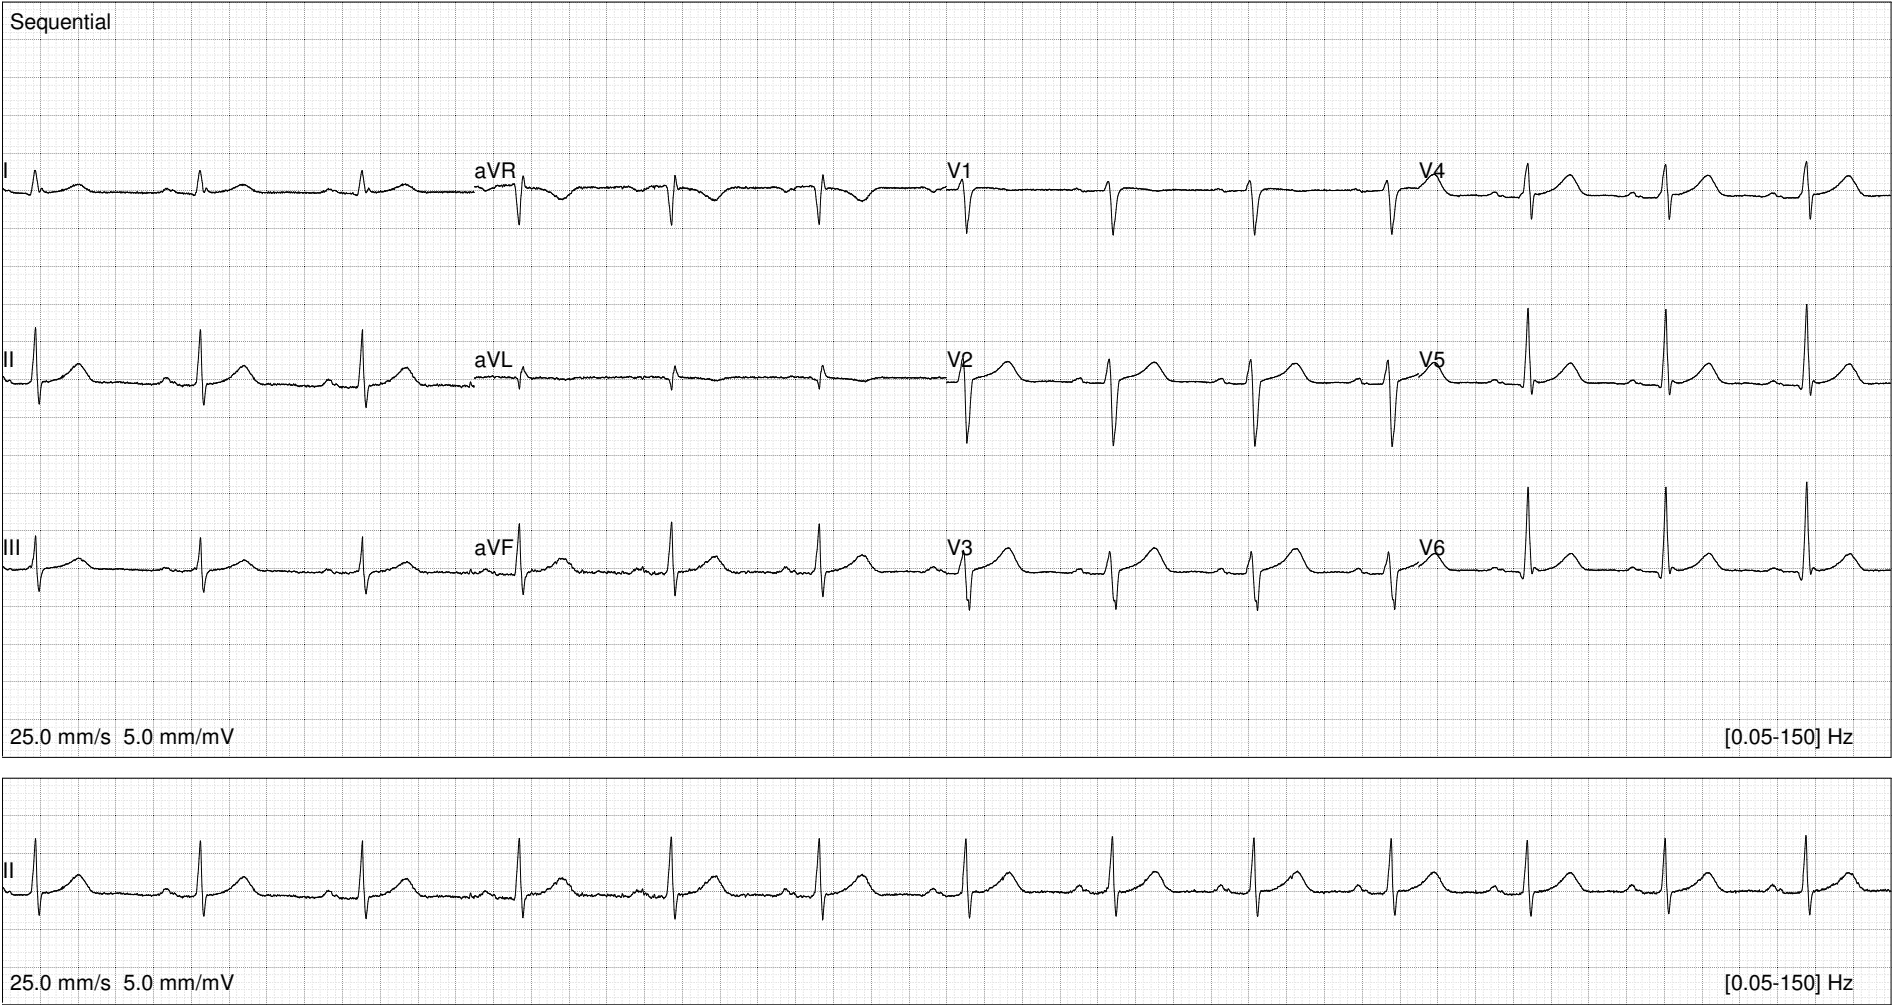

Anton Swart Biokinetic Rehabilitation Practice


Name: 002 002 002
Number: 002
Gender: Male
Birthdate: 04/02/1978 40 years
P / PQ: 123 ms / 188 ms
QRS: 94 ms
QT / QTc / QTd: 370 ms / 398 ms / -
P/QRS/T axis: 66° / 46° / 67°
Heartrate: 76 bpm

Recorded: 03/05/2018 17:22:31
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:


UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

Beats		RR	
Total:	381	Minimum	650 ms
Normal:	381	Maximum	918 ms
Other:	0	Mean:	785 ms
		SD:	49 ms

R-R Trend


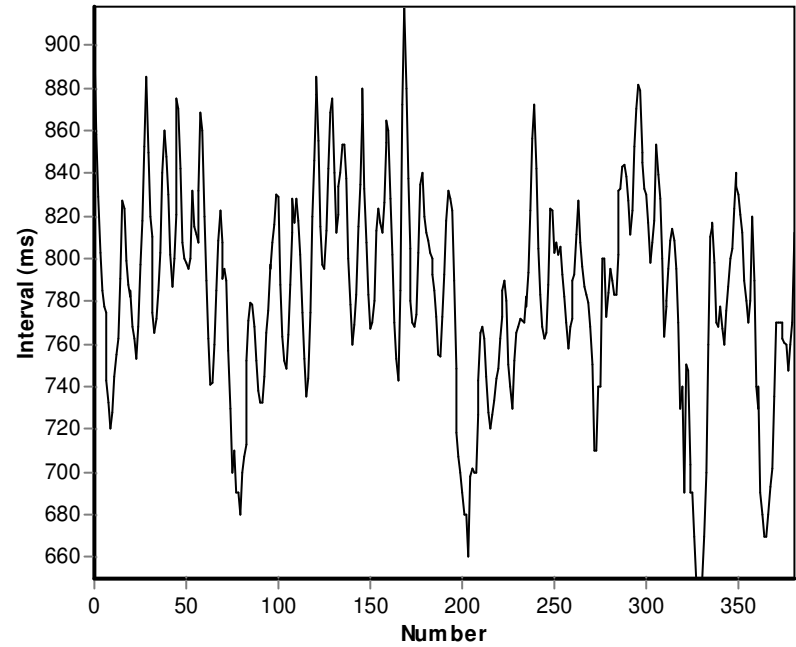


R-R Histogram

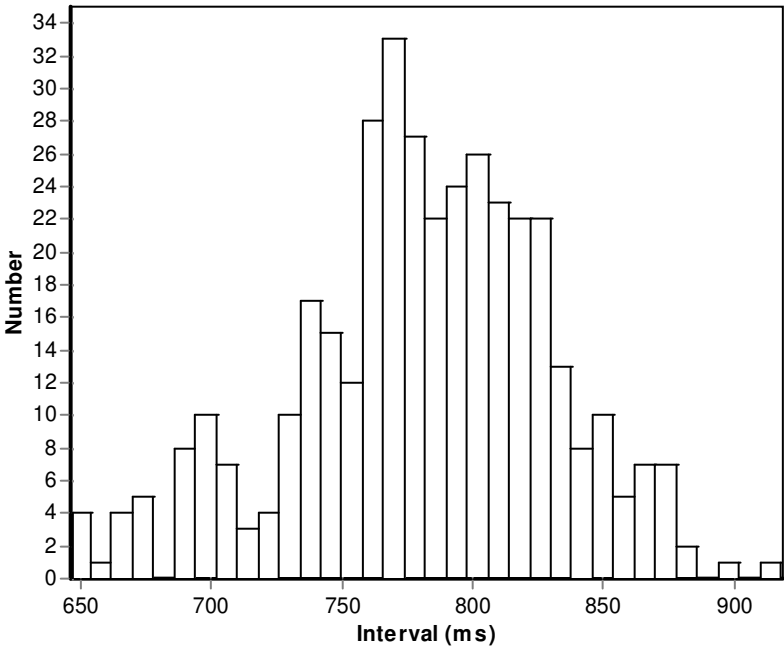

Heart Rate Variability: Time Domain Analysis


Name: 002, 002 002 Birthdate: 04/02/1978
 Number: 002 Recorded: 03/05/2018 17:22:31
 Gender: Male

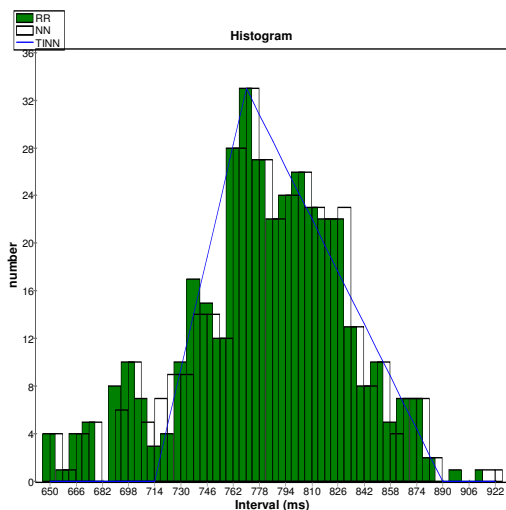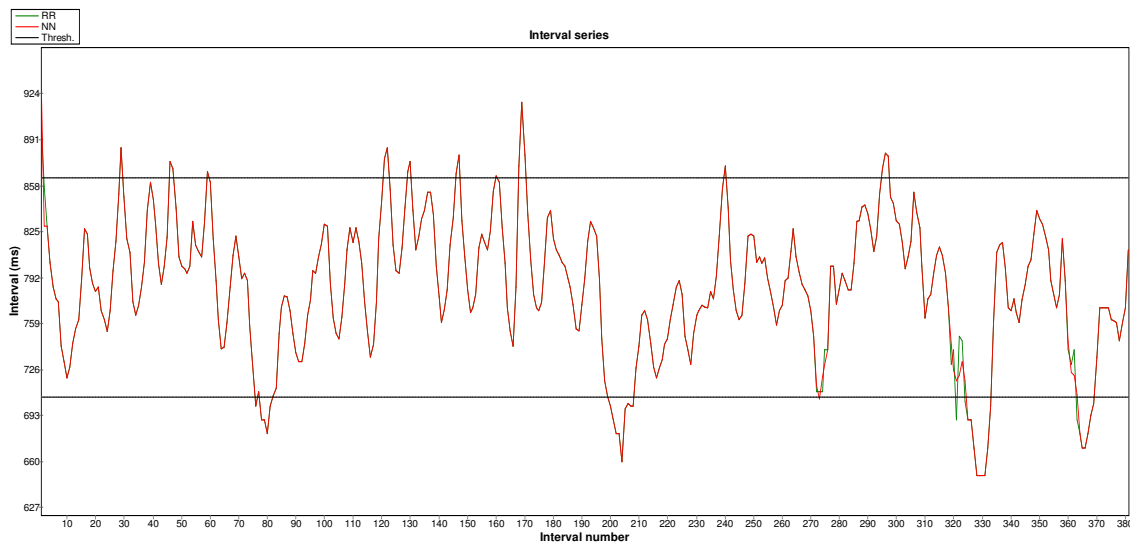

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	49	49
Triangular Interpolation (ms)	176	176
Triangular Index	11.55	11.55

Interval statistics	NN	RR
Number	381	381
Minimum (ms)	650	650
Maximum (ms)	929	918
Range (ms)	279	268
Avg (ms)	785	785
SD (ms)	49	49
AvgDev (ms)	38	38
p5 (ms)	693	690
p50 (ms)	787	787
p95 (ms)	865	865
Skewness	-0.32	-0.36
Kurtosis	3.16	3.10


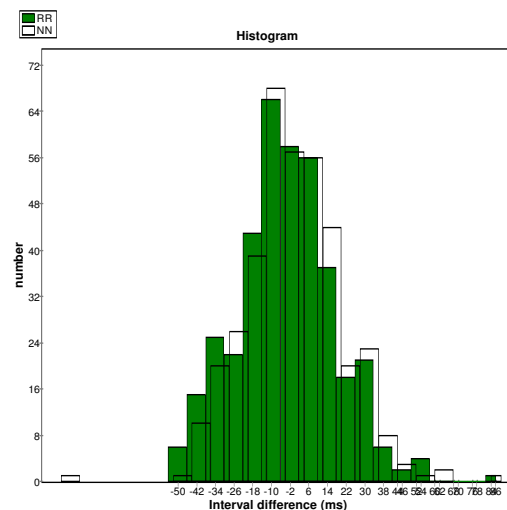


HRV parameters	NN	RR
SDSD (ms)	21	21
RMSSD (ms)	21	21
NN50	5	5
NN50(1)	1	0
NN50(2)	4	5
pNN50	0.01	0.01
pNN50(1)	0.00	0.00
pNN50(2)	0.01	0.01
Logarithmic Index	0.62	0.59
SD(Logarithmic Index)	0.06	0.05

Interval statistics	NN	RR
Number	380	380
Minimum (ms)	-100	-50
Maximum (ms)	87	87
Range (ms)	187	137
Avg (ms)	-0	-0
SD (ms)	21	21
AvgDev (ms)	16	17
p5 (ms)	-32	-35
p50 (ms)	-1	-1
p95 (ms)	34	34
Skewness	0.08	0.28
Kurtosis	4.44	3.47

Heart Rate Variability: Frequency Domain Analysis

Name: 002, 002 002 Birthdate: 04/02/1978
 Number: 002 Recorded: 03/05/2018 17:22:31
 Gender: Male

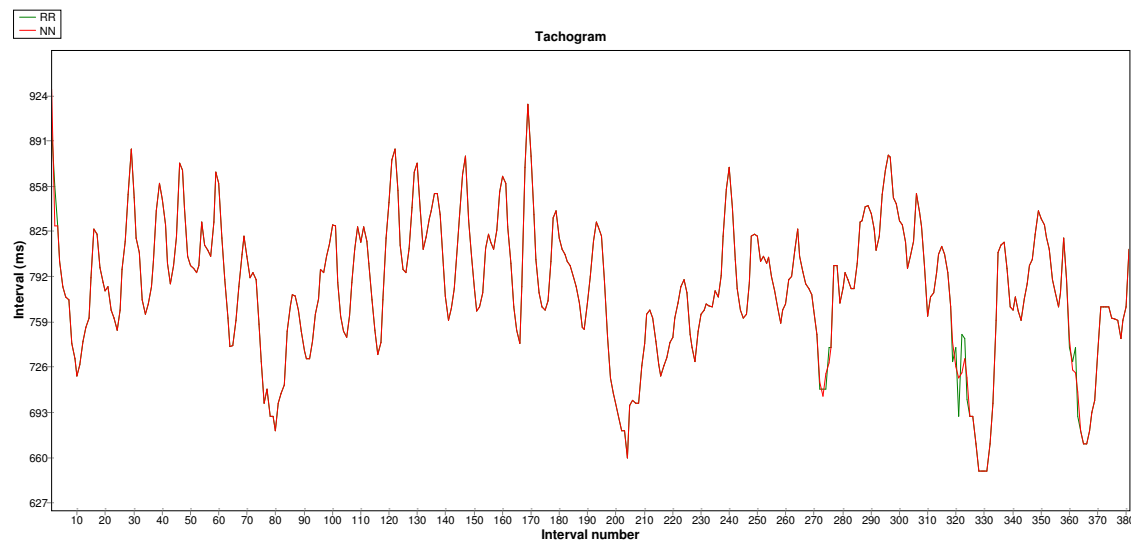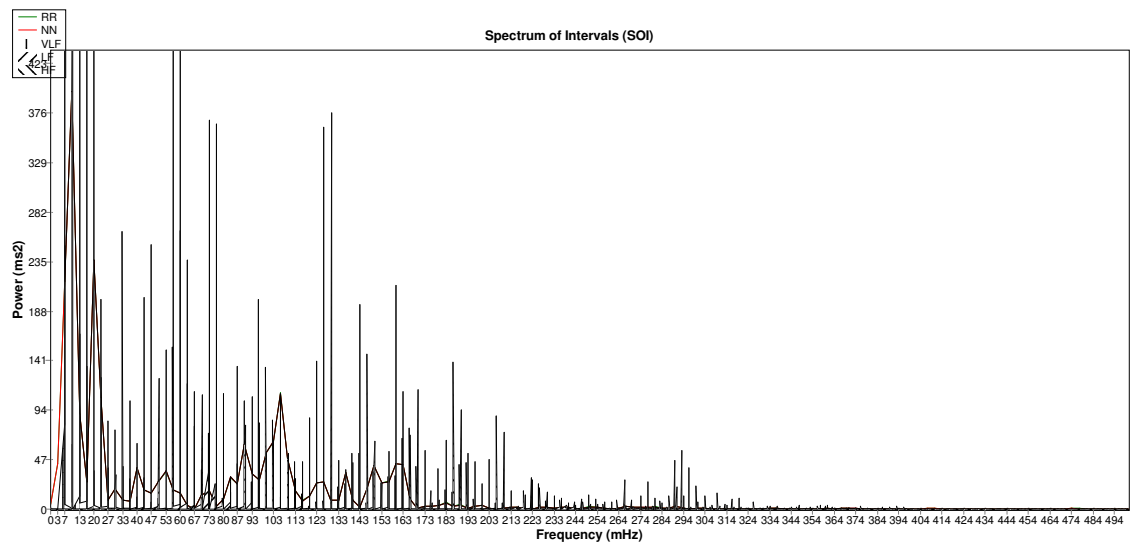

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	2223	2224	Spectrum of Intervals (SOI)	
VLF (ms2)	1154	1154	Frequency resolution (mHz)	3
LF (ms2)	803	804	VLF lower boundary (mHz)	3
HF (ms2)	266	266	VLF upper boundary (mHz)	40
LF/HF	3.02	3.02	LF upper boundary (mHz)	150
LF normalized	75.12	75.12	HF upper boundary (mHz)	400
HF normalized	24.88	24.88	Smoothing factor	1
VLF peak (mHz)	10	10	Tapering	Hann
LF peak (mHz)	107	107	Fourier transform	DFT
HF peak (mHz)	160	160	Sample frequency (Hz)	1.27
			Interval correction	Annotation
			Interval threshold (%)	10