


Anton Swart Biokinetic Rehabilitation Practice

Name: 003 003 003
Number: 003
Gender: Male
Birthdate: 26/01/1958 60 years

P / PQ: 127 ms / 150 ms
QRS: 90 ms
QT / QTc / QTd: 380 ms / 440 ms / -
P/QRS/T axis: 75° / 86° / 63°
Heartrate: 94 bpm

Recorded: 04/05/2018 14:06:31
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

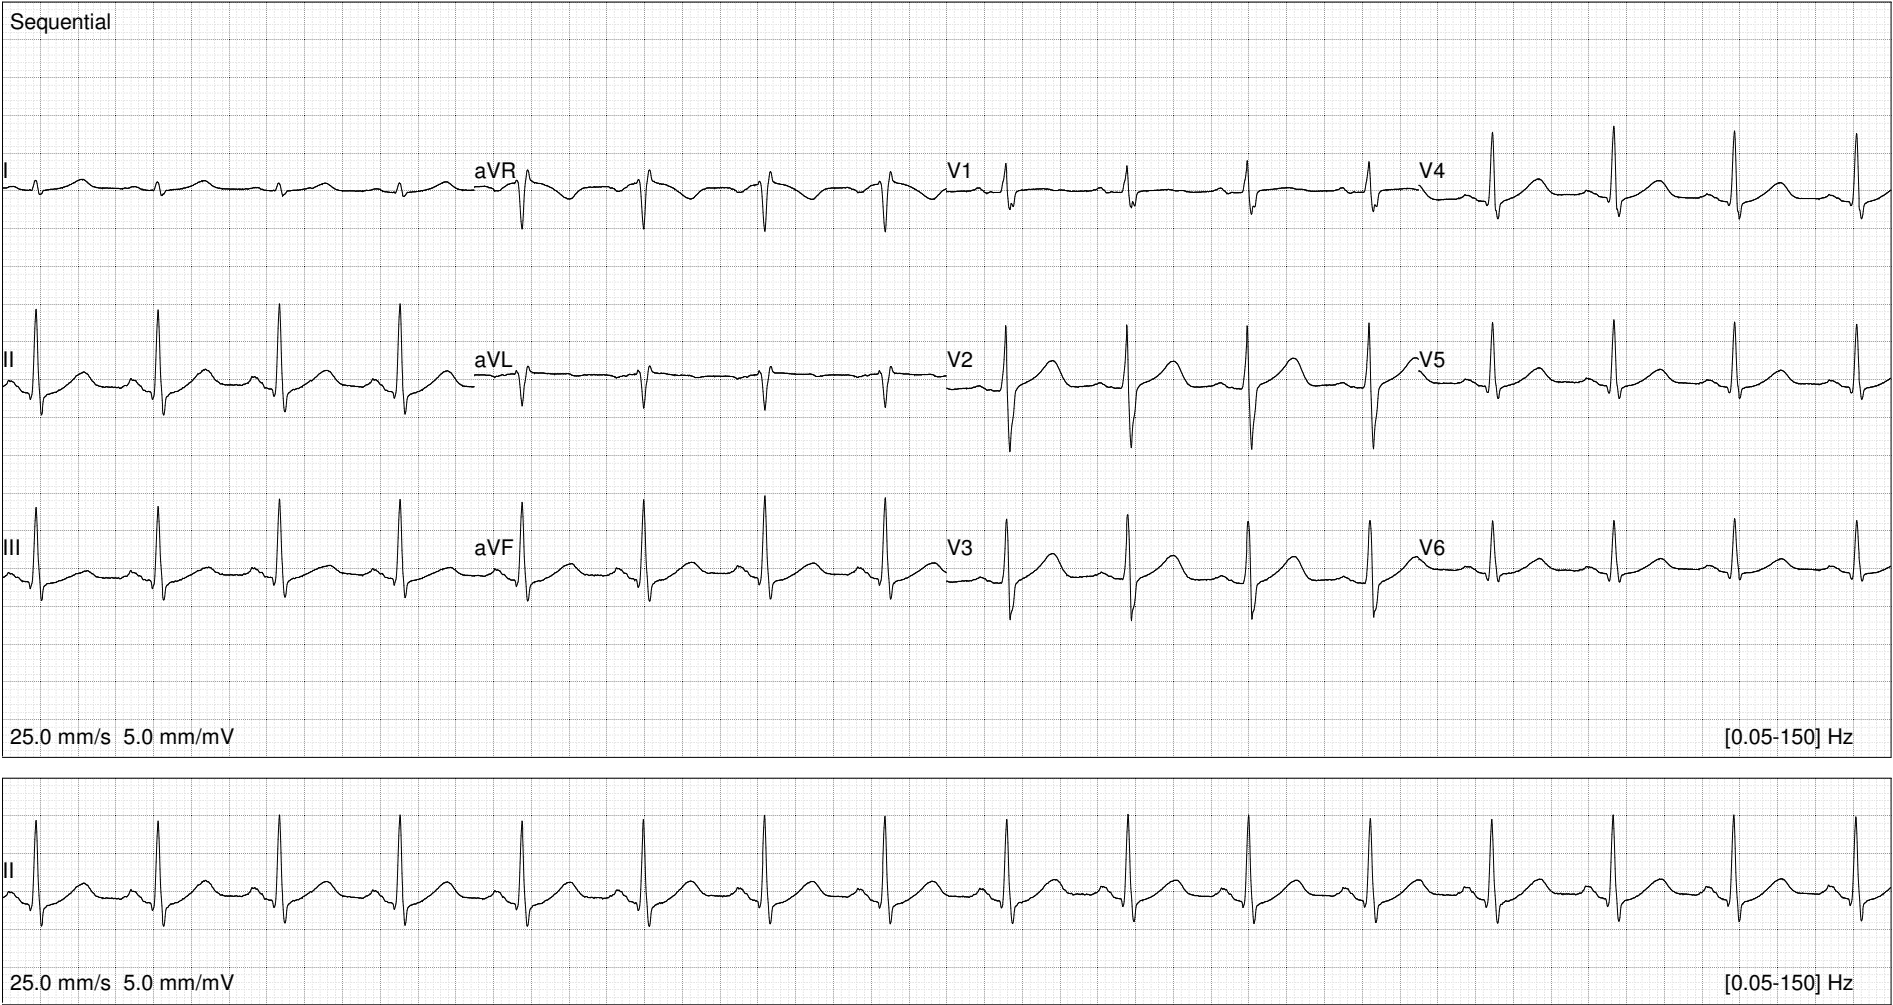

Anton Swart Biokinetic Rehabilitation Practice



Name: 003 003 003
Number: 003
Gender: Male
Birthdate: 26/01/1958 60 years

P / PQ: 127 ms / 150 ms
QRS: 90 ms
QT / QTc / QTd: 380 ms / 440 ms / -
P/QRS/T axis: 75° / 86° / 63°
Heartrate: 94 bpm

Recorded: 04/05/2018 14:06:31
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW




Beats		RR	
Total:	469	Minimum	617 ms
Normal:	469	Maximum	657 ms
Other:	0	Mean:	639 ms
		SD:	7 ms

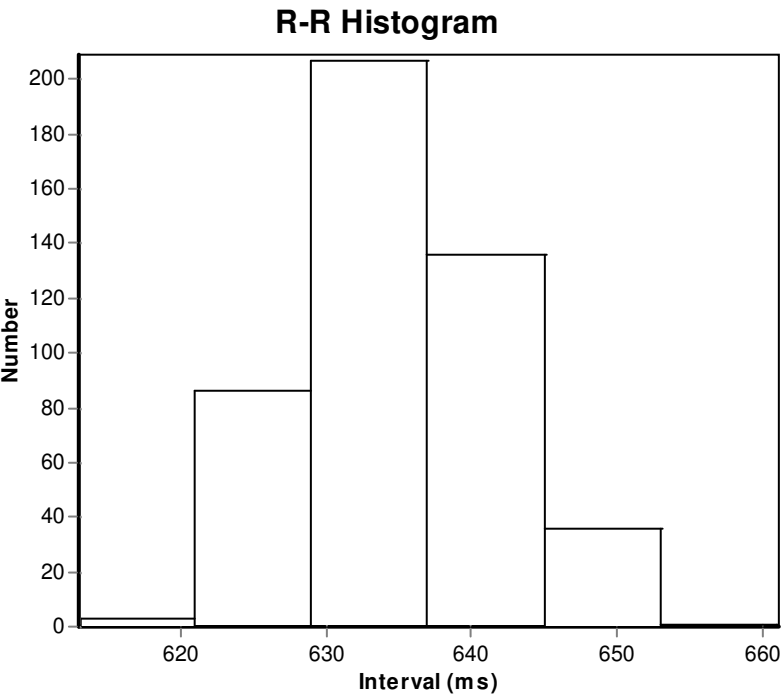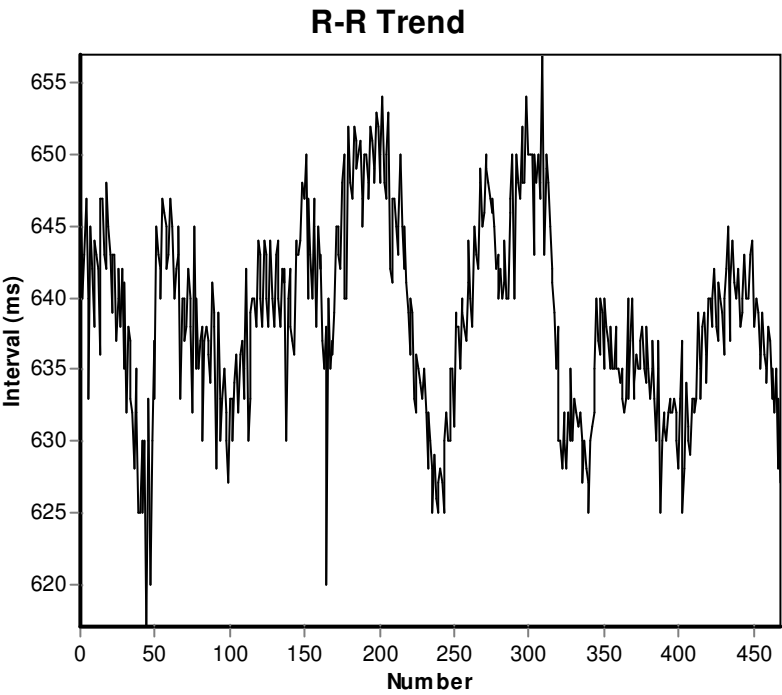

Heart Rate Variability: Time Domain Analysis

Name: 003, 003 003
 Number: 003
 Gender: Male

Birthdate: 26/01/1958
 Recorded: 04/05/2018 14:06:31

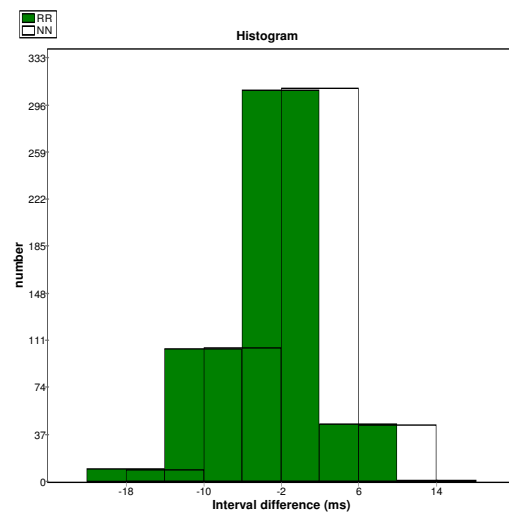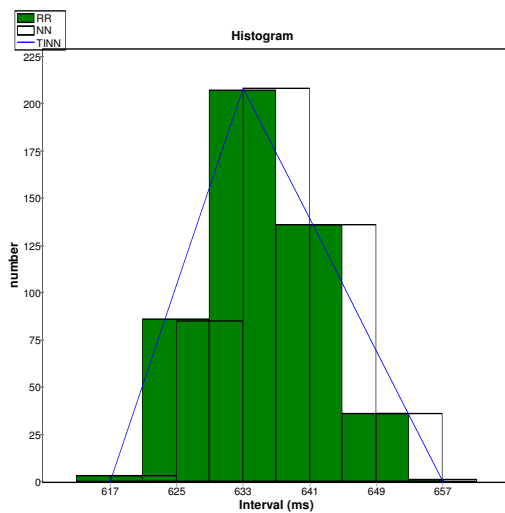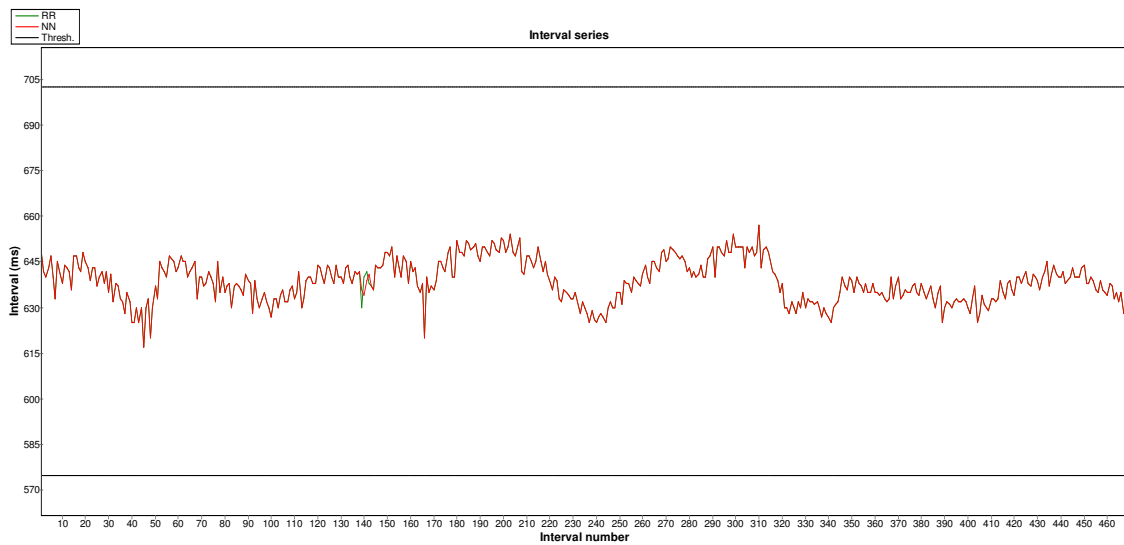

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	7	7
Triangular Interpolation (ms)	40	40
Triangular Index	2.25	2.27



HRV parameters	NN	RR
SDSD (ms)	4	4
RMSSD (ms)	4	4
NN50	0	0
NN50(1)	0	0
NN50(2)	0	0
pNN50	0.00	0.00
pNN50(1)	0.00	0.00
pNN50(2)	0.00	0.00
Logarithmic Index	2.69	2.69
SD(Logarithmic Index)	0.01	0.03

Interval statistics	NN	RR
Number	469	469
Minimum (ms)	617	617
Maximum (ms)	657	657
Range (ms)	40	40
Avg (ms)	639	639
SD (ms)	7	7
AvgDev (ms)	5	5
p5 (ms)	628	628
p50 (ms)	639	639
p95 (ms)	650	650
Skewness	-0.02	-0.02
Kurtosis	2.63	2.63

Interval statistics	NN	RR
Number	468	468
Minimum (ms)	-18	-18
Maximum (ms)	20	20
Range (ms)	38	38
Avg (ms)	-0	-0
SD (ms)	4	4
AvgDev (ms)	3	3
p5 (ms)	-7	-7
p50 (ms)	-1	-1
p95 (ms)	7	7
Skewness	0.03	0.01
Kurtosis	4.85	4.82

Heart Rate Variability: Frequency Domain Analysis

Name: 003, 003 003 Birthdate: 26/01/1958
 Number: 003 Recorded: 04/05/2018 14:06:31
 Gender: Male

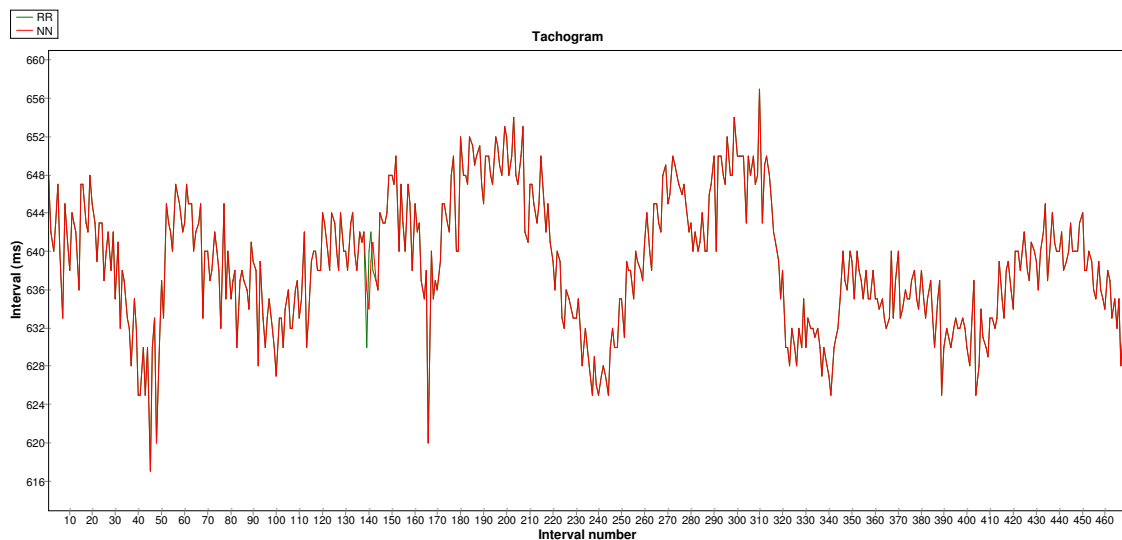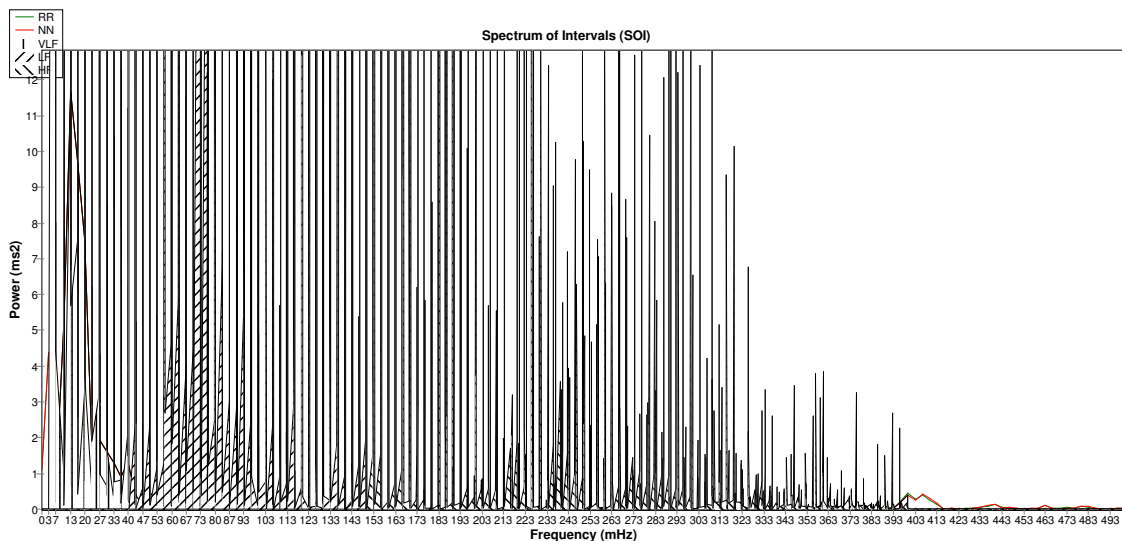

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	50	50	Spectrum of Intervals (SOI)	
VLf (ms2)	44	44	Frequency resolution (mHz)	3
LF (ms2)	5	5	VLf lower boundary (mHz)	3
HF (ms2)	2	2	VLf upper boundary (mHz)	40
LF/HF	2.27	2.10	LF upper boundary (mHz)	150
LF normalized	69.40	67.76	HF upper boundary (mHz)	400
HF normalized	30.60	32.24	Smoothing factor	1
VLf peak (mHz)	13	13	Tapering	Hann
LF peak (mHz)	80	80	Fourier transform	DFT
HF peak (mHz)	400	400	Sample frequency (Hz)	1.57
			Interval correction	Annotation
			Interval threshold (%)	10