


Anton Swart Biokinetic Rehabilitation Practice

Name: 004 004 004
Number: 004
Gender: Male
Birthdate: 13/11/1964 53 years

Recorded: 04/05/2018 12:38:28
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW



P / PQ: 173 ms / 207 ms
QRS: 108 ms
QT / QTc / QTd: 401 ms / 445 ms / -
P/QRS/T axis: 77° / 82° / 78°
Heartrate: 85 bpm

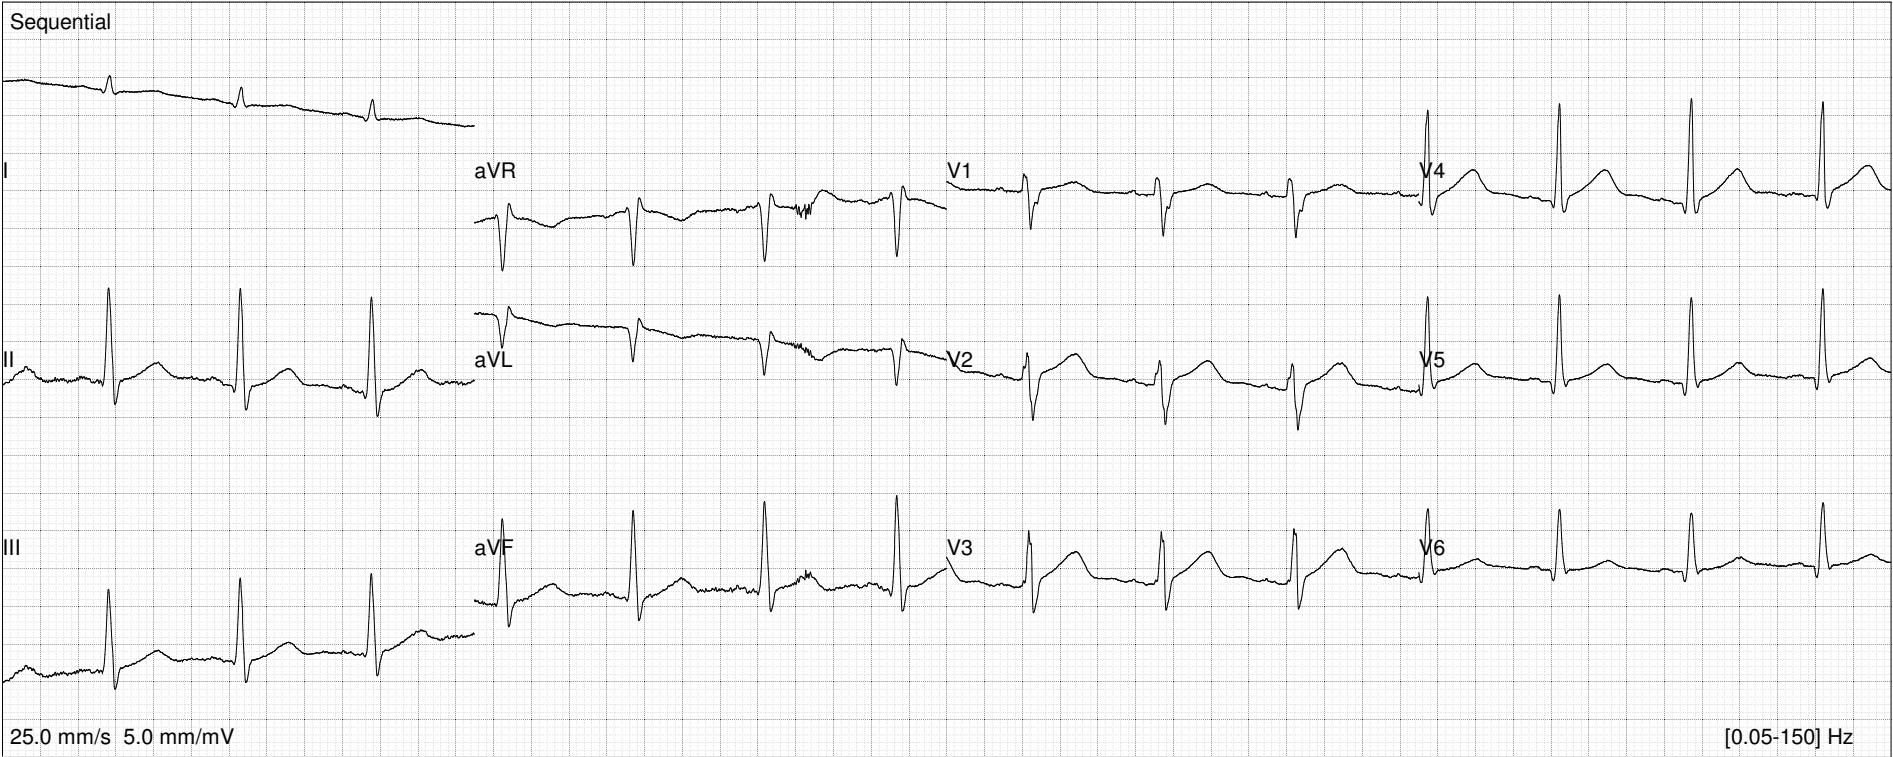

Anton Swart Biokinetic Rehabilitation Practice

Name:	004 004 004	Recorded:	04/05/2018 12:38:28	UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW
Number:	004	Recorded by:	Mr. Anton Swart	
Gender:	Male	Referring physician:		
Birthdate:	13/11/1964 53 years	Location:	Anton Swart Biokinetic Rehabilitation Practice	
P / PQ:	173 ms / 207 ms	Ordering physician:		
QRS:	108 ms	Attending physician:		
QT / QTc / QTd:	401 ms / 445 ms / -	Comment:		
P/QRS/T axis:	77° / 82° / 78°			
Heartrate:	85 bpm			




Beats		RR	
Total:	421	Minimum	650 ms
Normal:	421	Maximum	763 ms
Other:	0	Mean:	709 ms
		SD:	17 ms

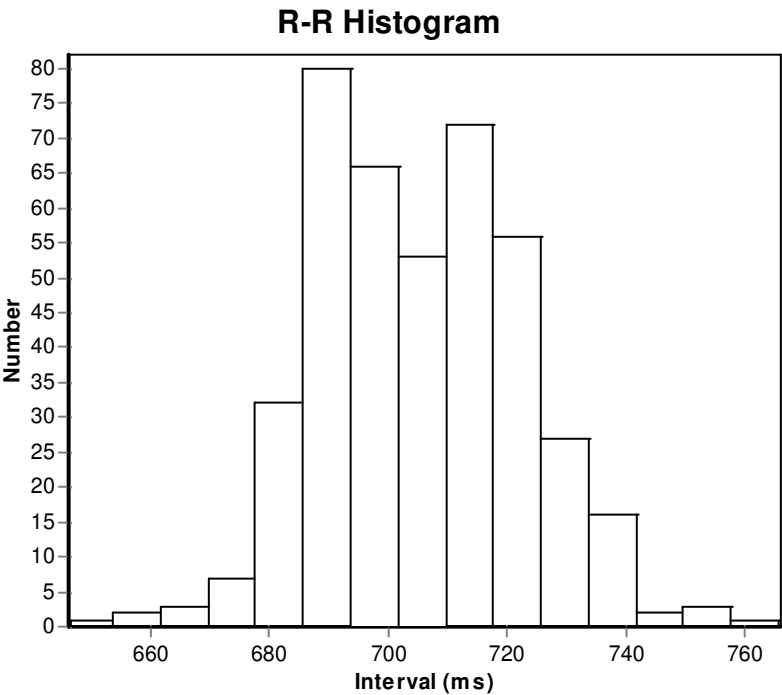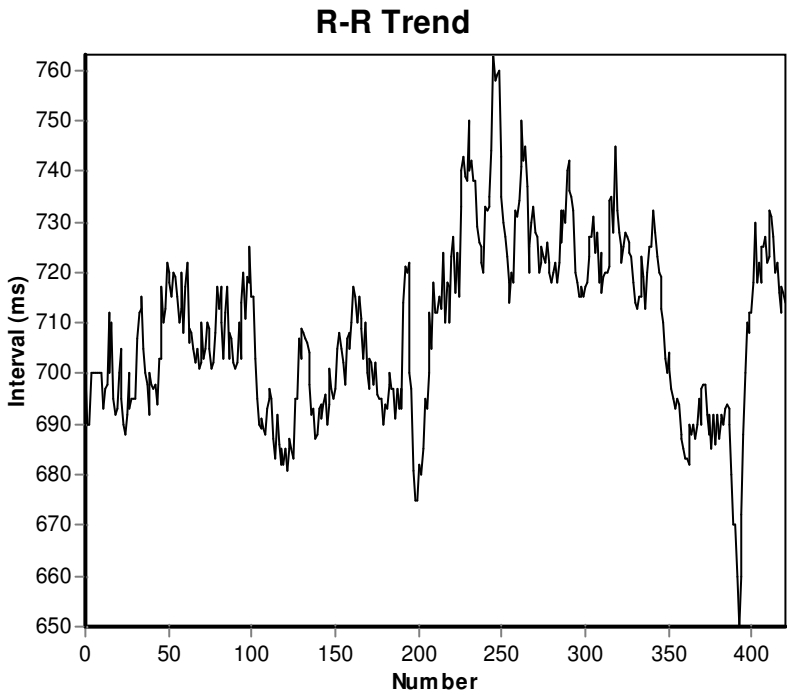

Heart Rate Variability: Time Domain Analysis

Name: 004, 004 004
 Number: 004
 Gender: Male

Birthdate: 13/11/1964
 Recorded: 04/05/2018 12:38:28

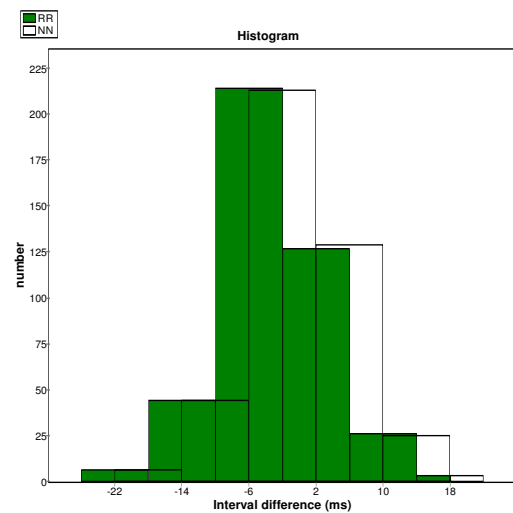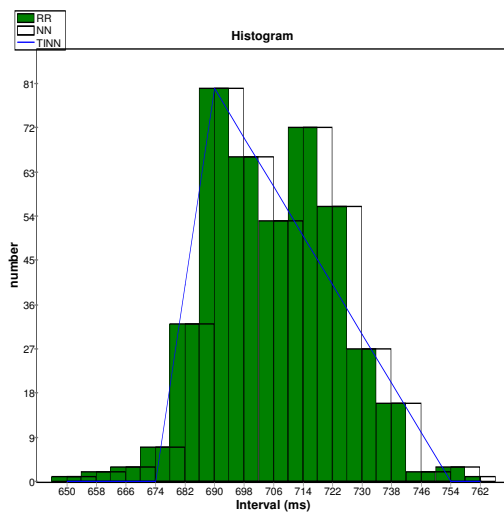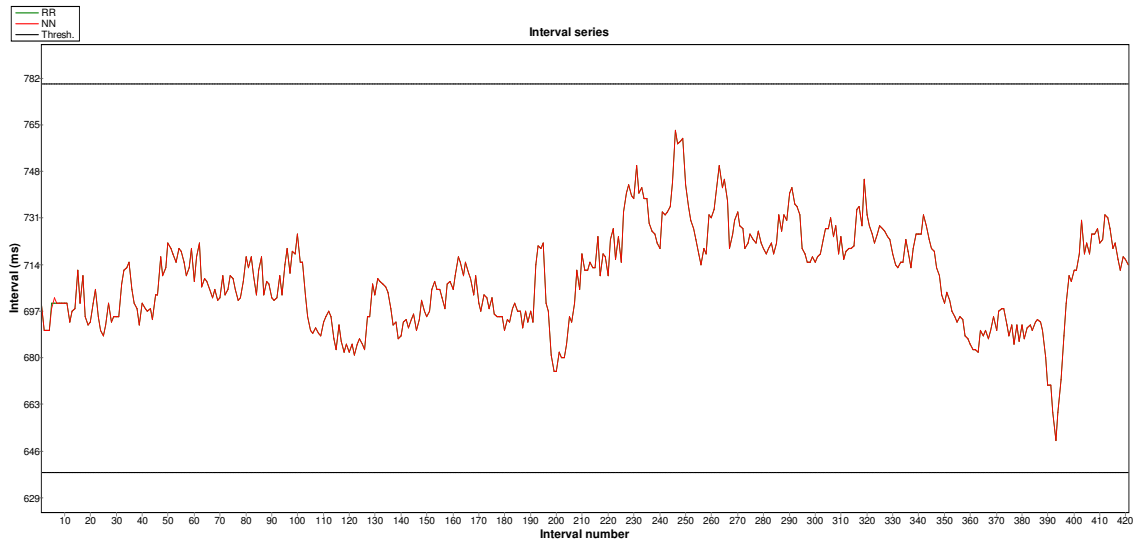

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	17	17
Triangular Interpolation (ms)	80	80
Triangular Index	5.26	5.26

HRV parameters	NN	RR
SDSD (ms)	6	6
RMSSD (ms)	6	6
NN50	0	0
NN50(1)	0	0
NN50(2)	0	0
pNN50	0.00	0.00
pNN50(1)	0.00	0.00
pNN50(2)	0.00	0.00
Logarithmic Index	1.76	1.76
SD(Logarithmic Index)	0.14	0.14



Interval statistics	NN	RR
Number	421	421
Minimum (ms)	650	650
Maximum (ms)	763	763
Range (ms)	113	113
Avg (ms)	709	709
SD (ms)	17	17
AvgDev (ms)	14	14
p5 (ms)	685	685
p50 (ms)	710	710
p95 (ms)	738	738
Skewness	0.12	0.12
Kurtosis	3.07	3.07

Interval statistics	NN	RR
Number	420	420
Minimum (ms)	-22	-22
Maximum (ms)	21	21
Range (ms)	43	43
Avg (ms)	0	0
SD (ms)	6	6
AvgDev (ms)	5	5
p5 (ms)	-10	-10
p50 (ms)	-1	0
p95 (ms)	11	11
Skewness	0.13	0.14
Kurtosis	3.61	3.61

Heart Rate Variability: Frequency Domain Analysis

Name: 004, 004 004
Number: 004
Gender: Male

Birthdate: 13/11/1964
Recorded: 04/05/2018 12:38:28

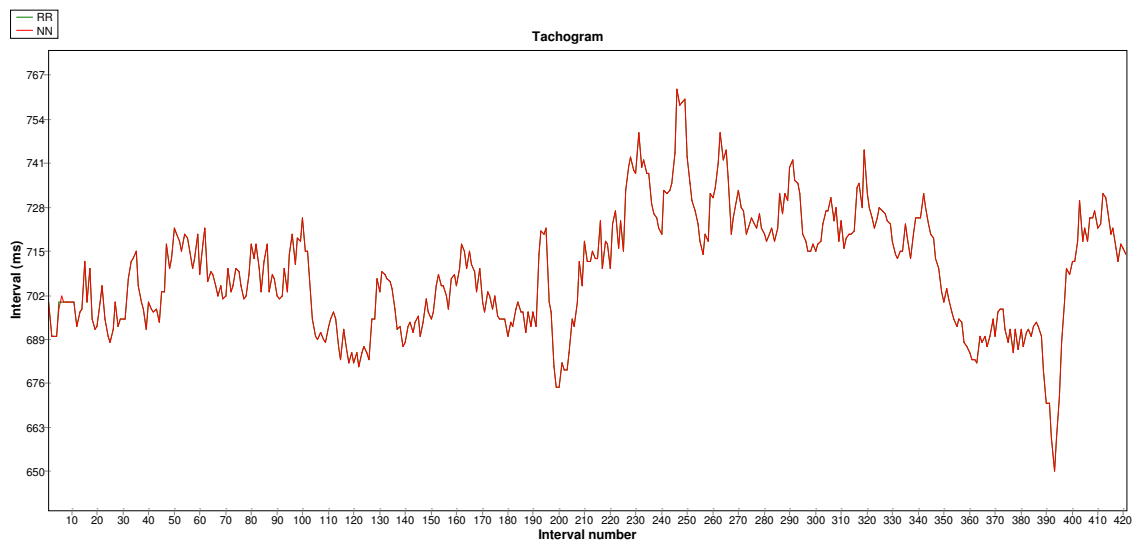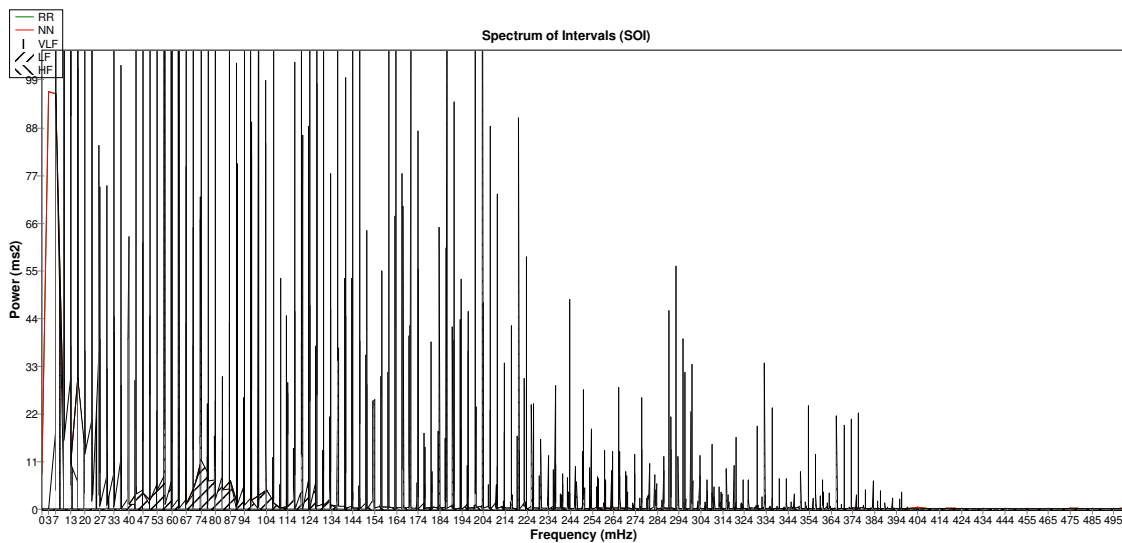

HRV parameters

	NN	RR
TP (ms2)	253	253
VLF (ms2)	170	170
LF (ms2)	74	74
HF (ms2)	9	9
LF/HF	8.25	8.25
LF normalized	89.19	89.19
HF normalized	10.81	10.81
VLF peak (mHz)	7	7
LF peak (mHz)	74	74
HF peak (mHz)	160	160

HRV spectral settings

Spectrum of Intervals (SOI)	
Frequency resolution (mHz)	3
VLF lower boundary (mHz)	3
VLF upper boundary (mHz)	40
LF upper boundary (mHz)	150
HF upper boundary (mHz)	400
Smoothing factor	1
Tapering	Hann
Fourier transform	DFT
Sample frequency (Hz)	1.41
Interval correction	Annotation
Interval threshold (%)	10