


Anton Swart Biokinetic Rehabilitation Practice

Name: 005 005 005
Number: 005
Gender: Male
Birthdate: 16/06/1977 40 years

P / PQ: 120 ms / 165 ms
QRS: 92 ms
QT / QTc / QTd: 493 ms / 472 ms / -
P/QRS/T axis: 73° / -51° / 60°
Heartrate: 48 bpm

Recorded: 01/05/2018 08:11:20
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

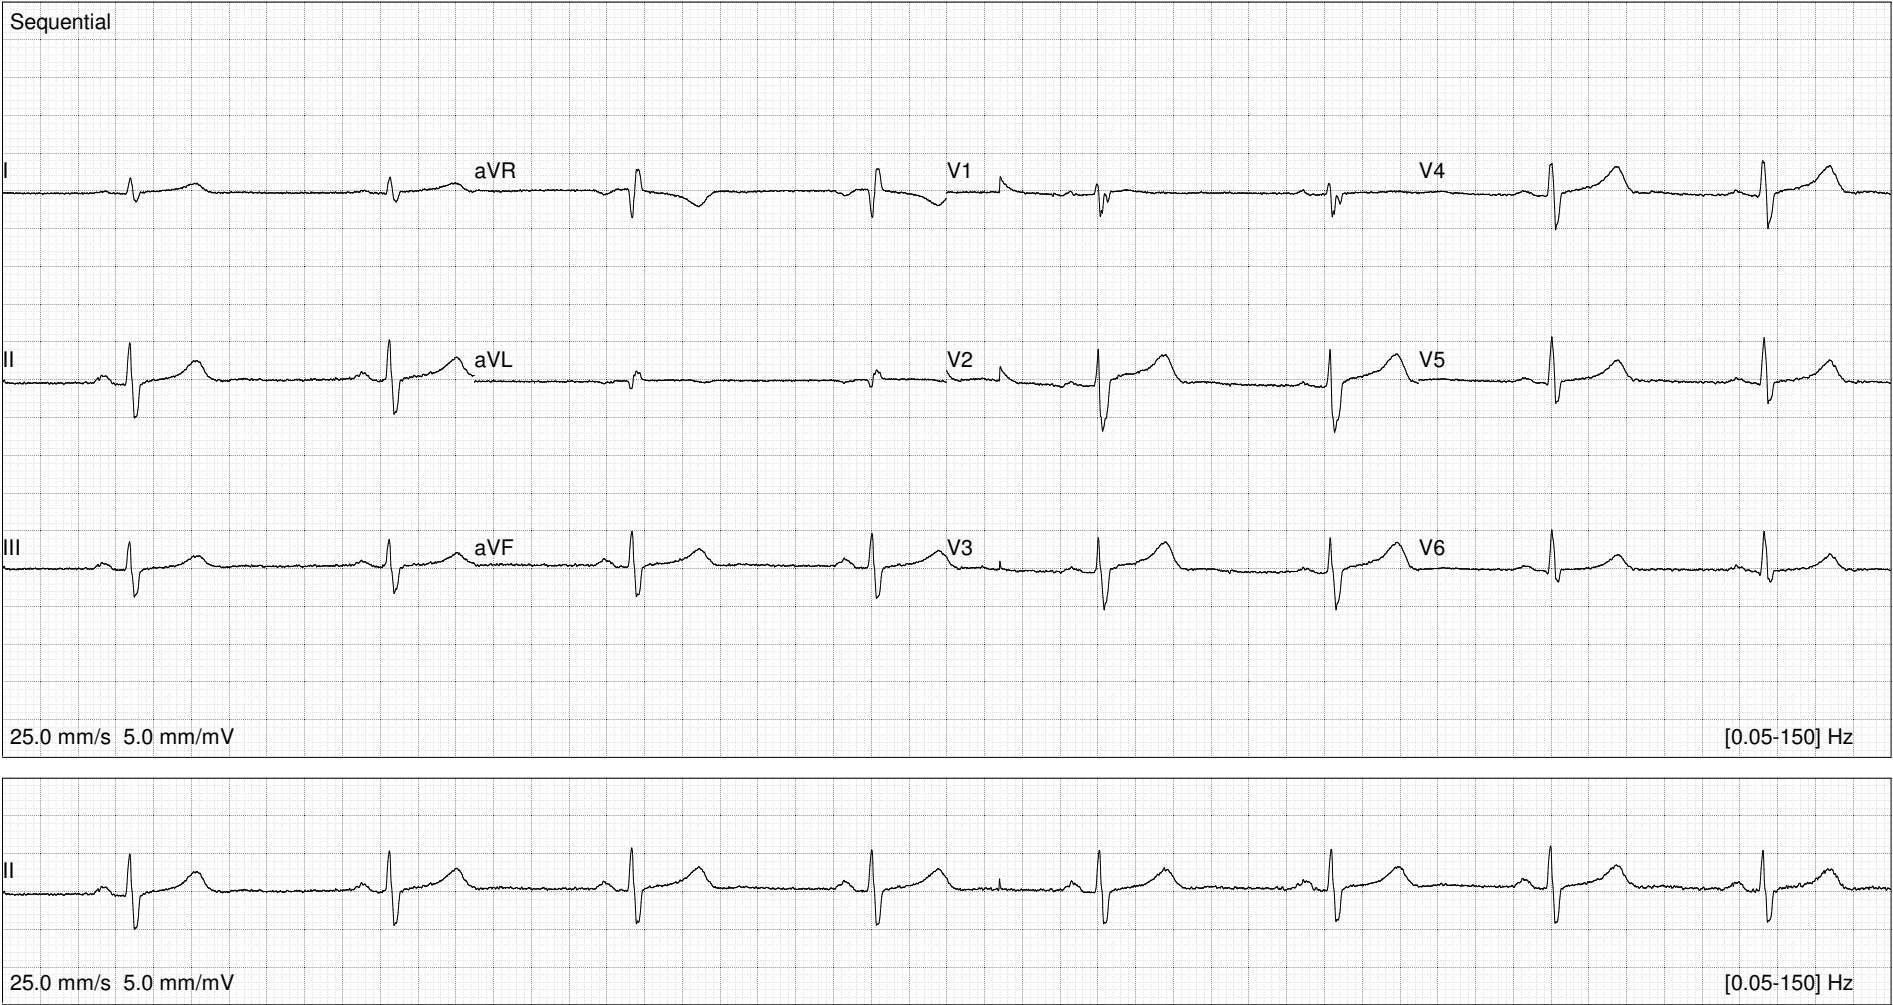

Anton Swart Biokinetic Rehabilitation Practice

Name:

005 005 005

Number:

005

Gender:

Male

Birthdate:

16/06/1977 40 years

P / PQ:

120 ms / 165 ms

QRS:

92 ms

QT / QTc / QTd:

493 ms / 472 ms / -

P/QRS/T axis:

73° / -51° / 60°

Heartrate:

48 bpm

Recorded:

01/05/2018 08:11:20

Recorded by:

Mr. Anton Swart

Referring physician:

Location:

Anton Swart Biokinetic Rehabilitation Practice



Ordering physician:

Attending physician:

Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW




Beats		RR	
Total:	242	Minimum	760 ms
Normal:	242	Maximum	1420 ms
Other:	0	Mean:	1235 ms
		SD:	70 ms

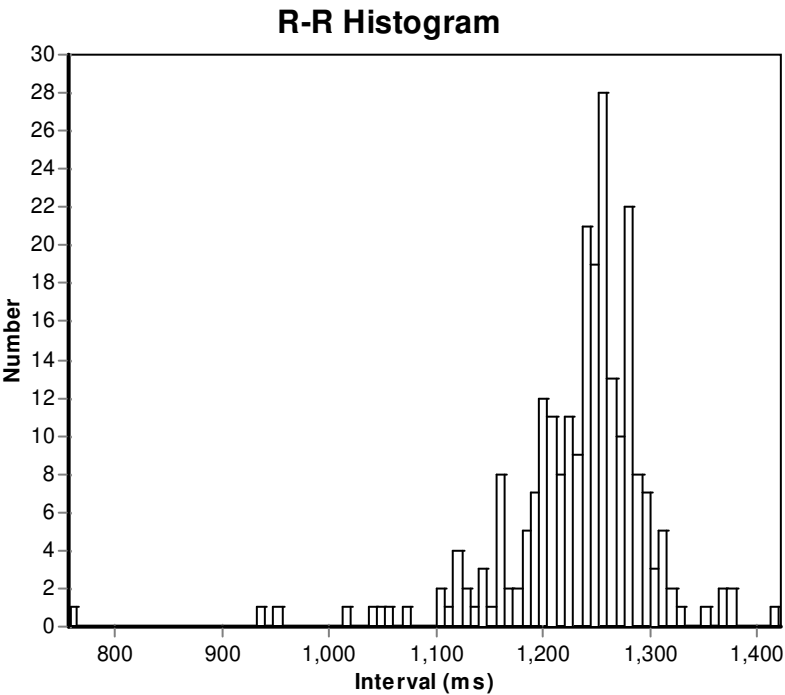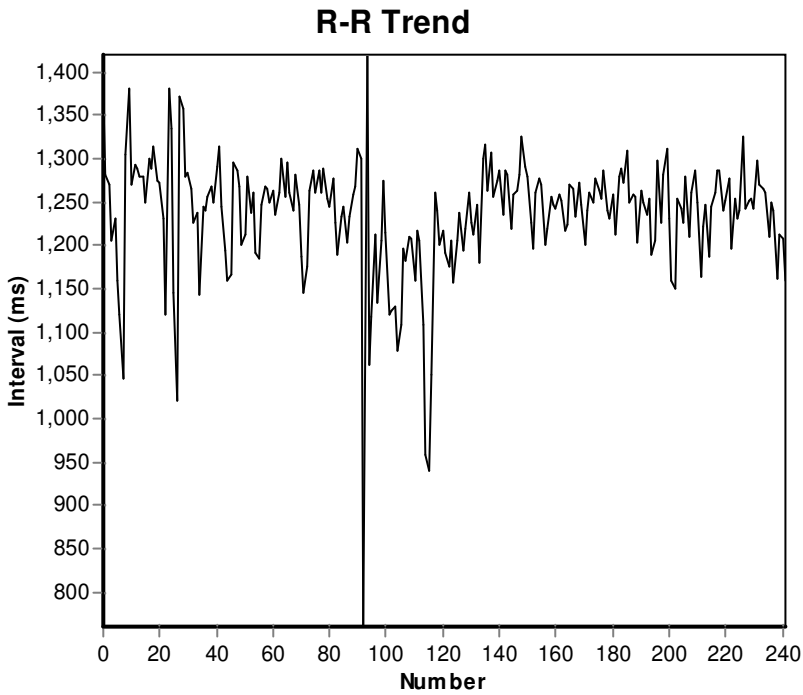

Heart Rate Variability: Time Domain Analysis

Name: 005, 005 005
 Number: 005
 Gender: Male

Birthdate: 16/06/1977
 Recorded: 01/05/2018 08:11:20

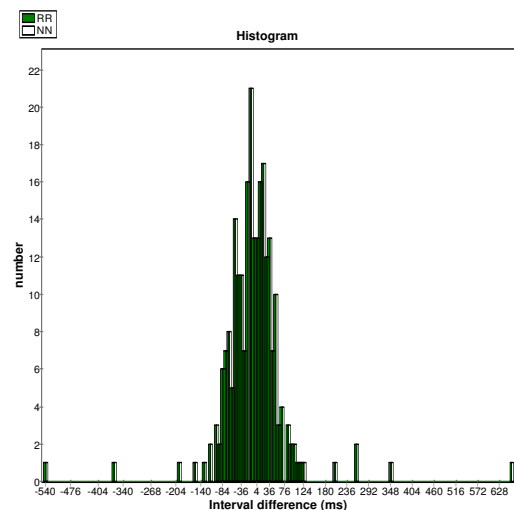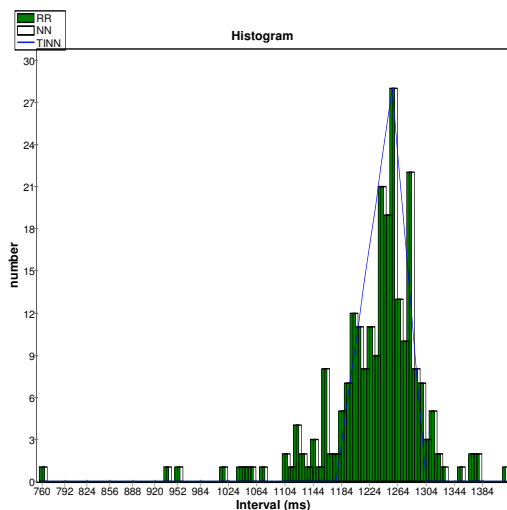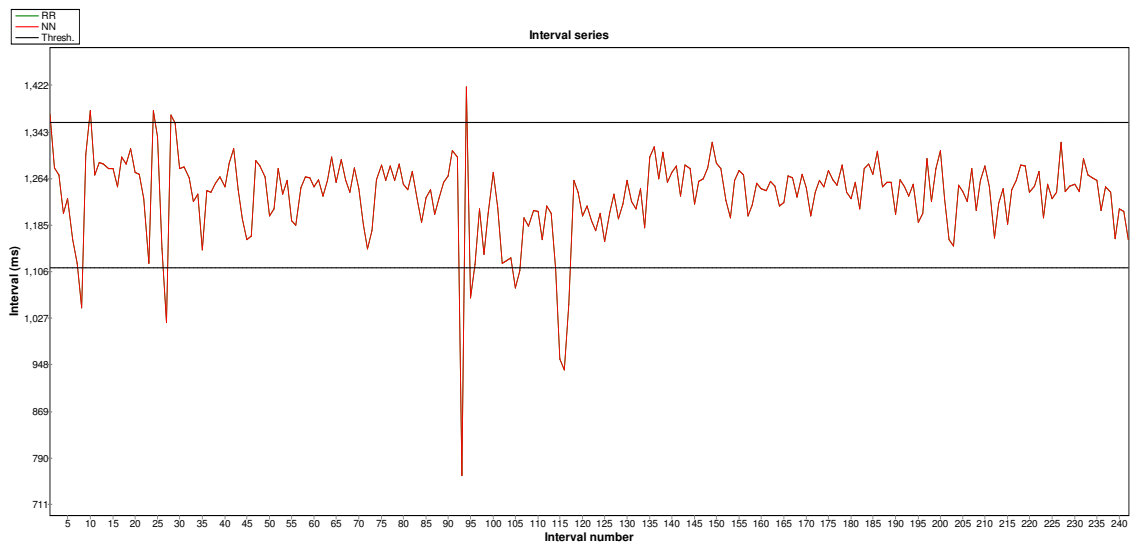

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	70	70
Triangular Interpolation (ms)	128	128
Triangular Index	8.64	8.64

HRV parameters	NN	RR
SDSD (ms)	85	85
RMSSD (ms)	85	85
NN50	73	73
NN50(1)	41	41
NN50(2)	32	32
pNN50	0.30	0.30
pNN50(1)	0.17	0.17
pNN50(2)	0.13	0.13
Logarithmic Index	0.19	0.19
SD(Logarithmic Index)	0.01	0.01



Interval statistics	NN	RR
Number	242	242
Minimum (ms)	760	760
Maximum (ms)	1420	1420
Range (ms)	660	660
Avg (ms)	1235	1235
SD (ms)	70	70
AvgDev (ms)	47	47
p5 (ms)	1120	1120
p50 (ms)	1250	1250
p95 (ms)	1314	1314
Skewness	-2.16	-2.16
Kurtosis	13.43	13.43

Interval statistics	NN	RR
Number	241	241
Minimum (ms)	-540	-540
Maximum (ms)	660	660
Range (ms)	1200	1200
Avg (ms)	-1	-1
SD (ms)	85	85
AvgDev (ms)	49	49
p5 (ms)	-83	-83
p50 (ms)	-4	-4
p95 (ms)	92	92
Skewness	1.12	1.12
Kurtosis	26.05	26.05

Heart Rate Variability: Frequency Domain Analysis

Name:005, 005 005
Number:005
Gender:Male

Birthdate:16/06/1977
Recorded:01/05/2018 08:11:20

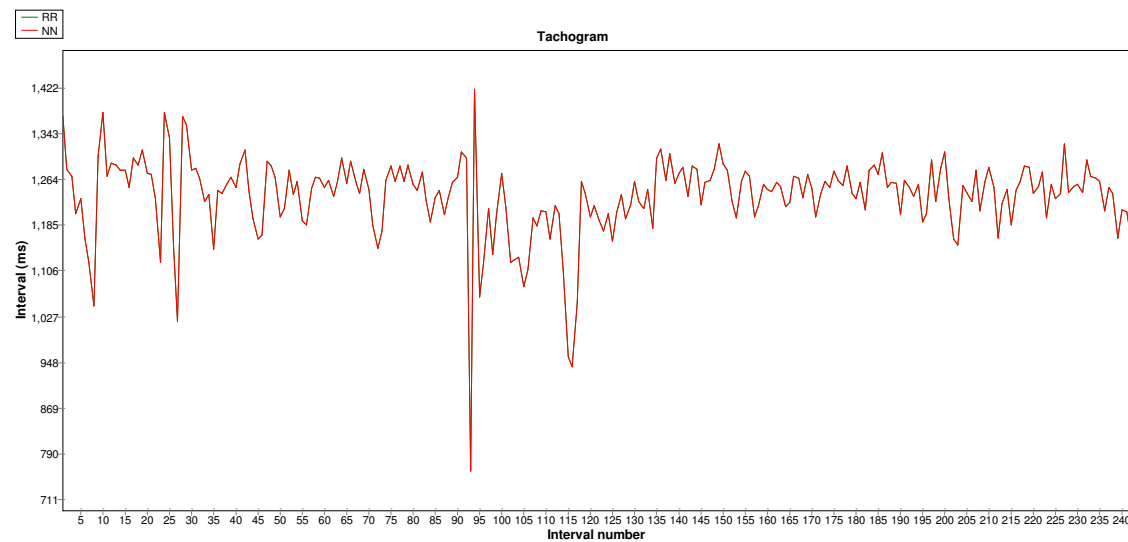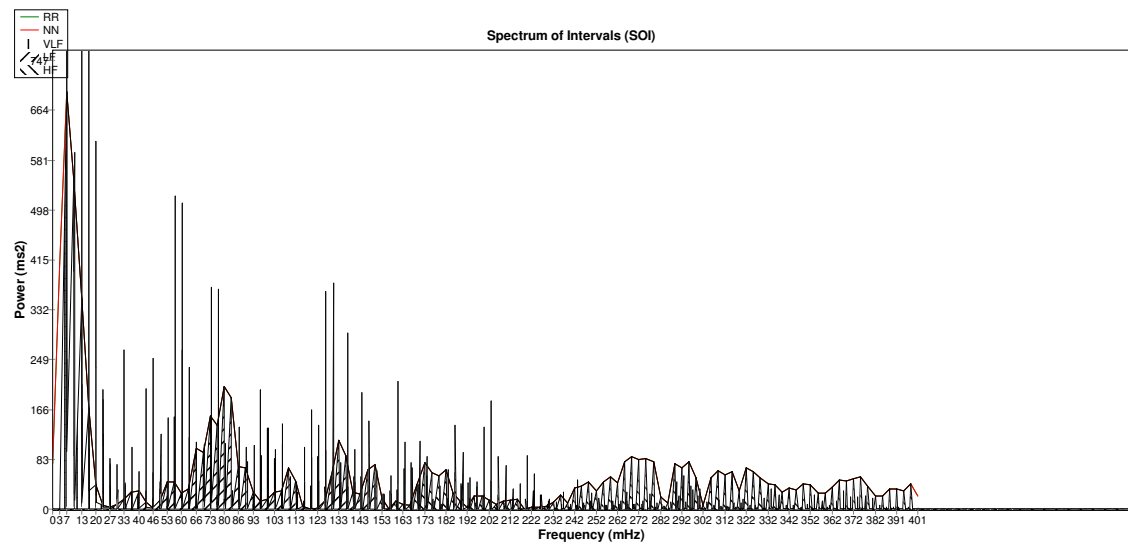

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	6604	6604	Spectrum of Intervals (SOI)	
VLF (ms2)	1895	1895	Frequency resolution (mHz)	3
LF (ms2)	1912	1912	VLF lower boundary (mHz)	3
HF (ms2)	2797	2797	VLF upper boundary (mHz)	40
LF/HF	0.68	0.68	LF upper boundary (mHz)	150
LF normalized	40.60	40.60	HF upper boundary (mHz)	400
HF normalized	59.40	59.40	Smoothing factor	1
VLF peak (mHz)	7	7	Tapering	Hann
LF peak (mHz)	80	80	Fourier transform	DFT
HF peak (mHz)	269	269	Sample frequency (Hz)	0.81
			Interval correction	Annotation
			Interval threshold (%)	10