


Anton Swart Biokinetic Rehabilitation Practice

Name: 006 006 006
Number: 006
Gender: Female
Birthdate: 25/01/1979 39 years

P / PQ: 103 ms / 182 ms
QRS: 90 ms
QT / QTc / QTd: 441 ms / 458 ms / -
P/QRS/T axis: 72° / 86° / 71°
Heartrate: 70 bpm

Recorded: 01/05/2018 08:34:40
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

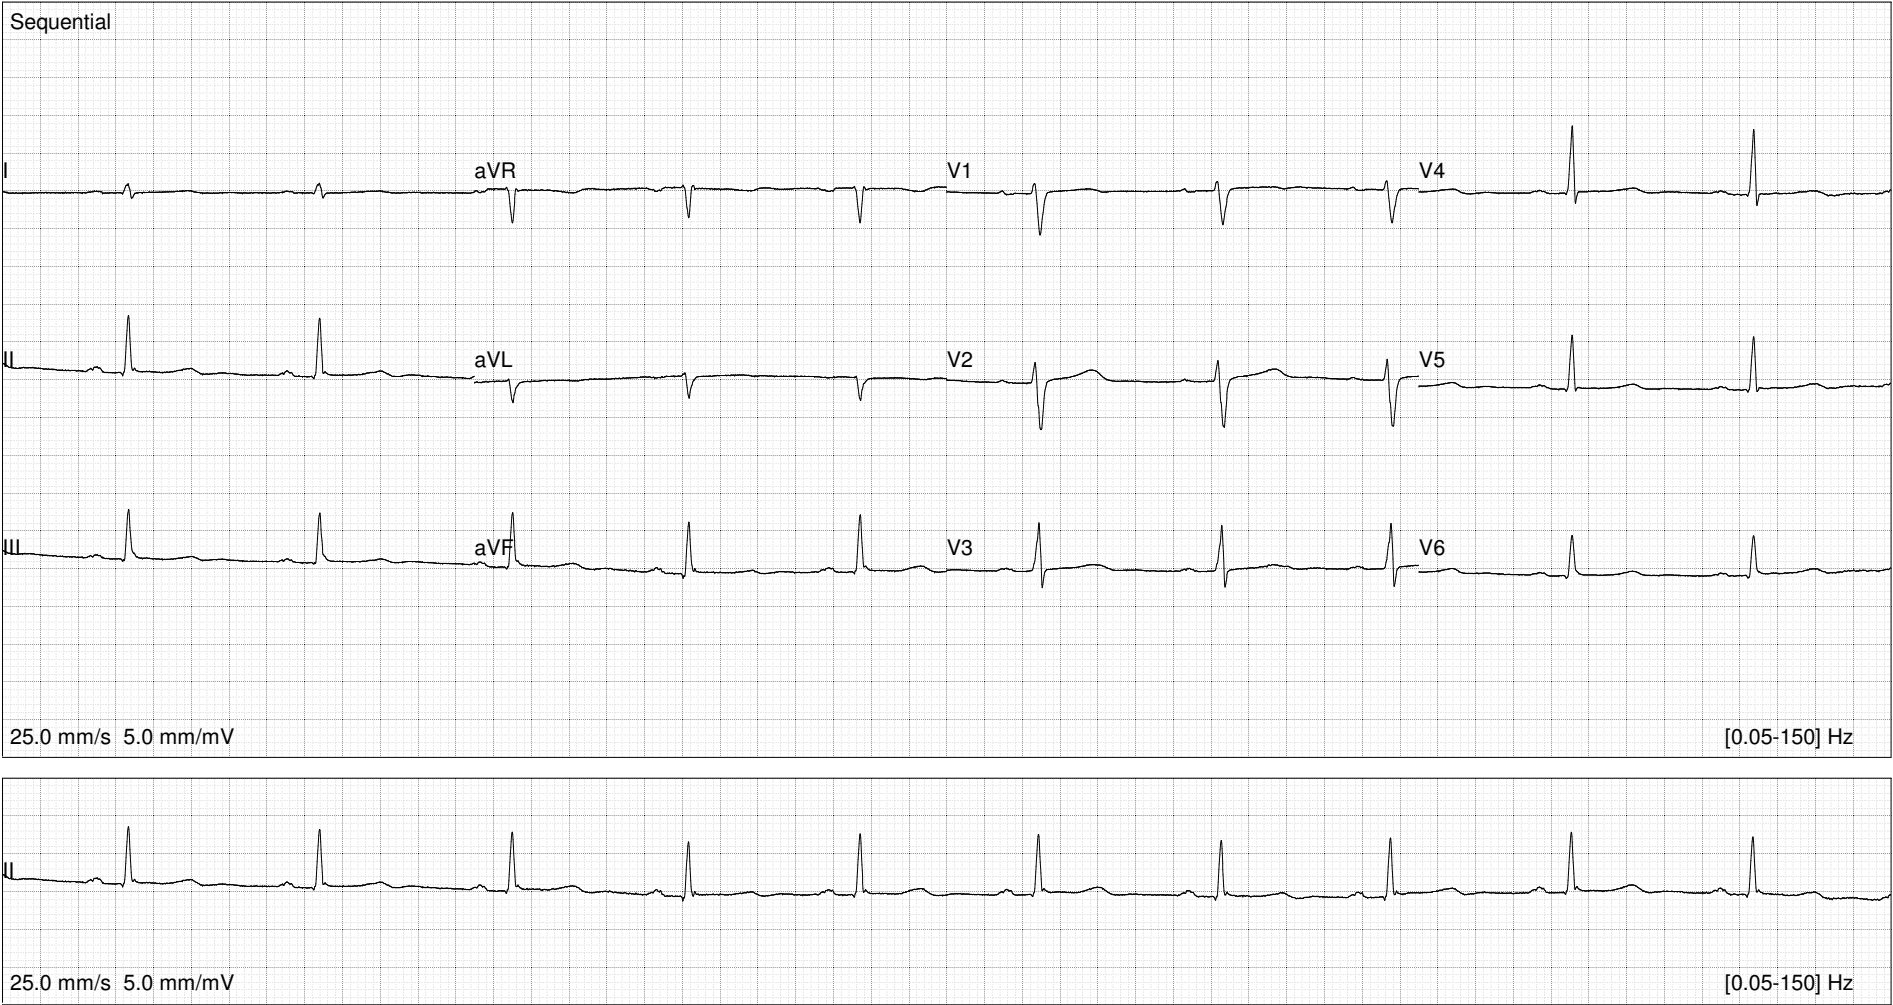



Anton Swart Biokinetic Rehabilitation Practice

Name: 006 006 006
Number: 006
Gender: Female
Birthdate: 25/01/1979 39 years
P / PQ: 103 ms / 182 ms
QRS: 90 ms
QT / QTc / QTd: 441 ms / 458 ms / -
P/QRS/T axis: 72° / 86° / 71°
Heartrate: 70 bpm

Recorded: 01/05/2018 08:34:40
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW



Beats		RR	
Total:	344	Minimum	763 ms
Normal:	344	Maximum	1018 ms
Other:	0	Mean:	868 ms
		SD:	46 ms

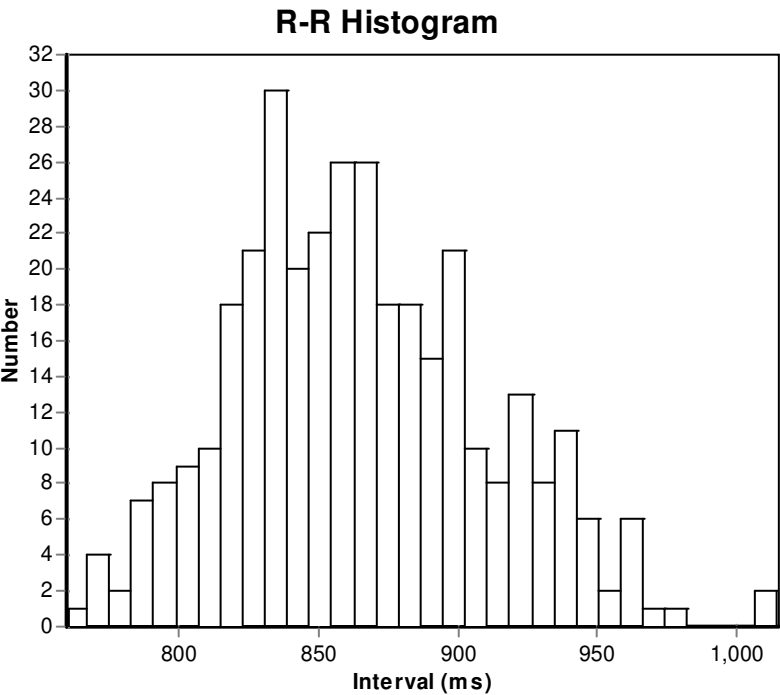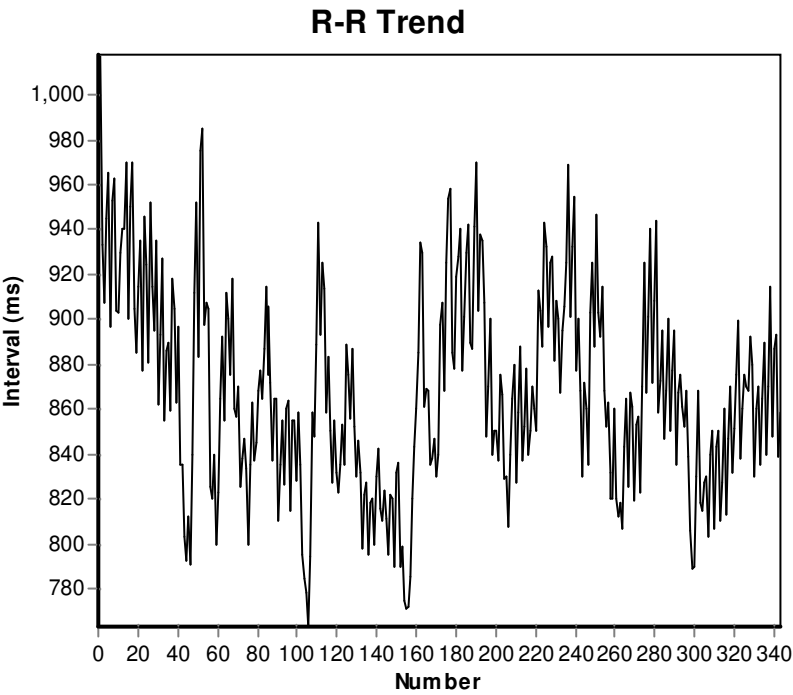

Heart Rate Variability: Time Domain Analysis

Name: 006, 006 006
 Number: 006
 Gender: Female


Birthdate: 25/01/1979
 Recorded: 01/05/2018 08:34:40

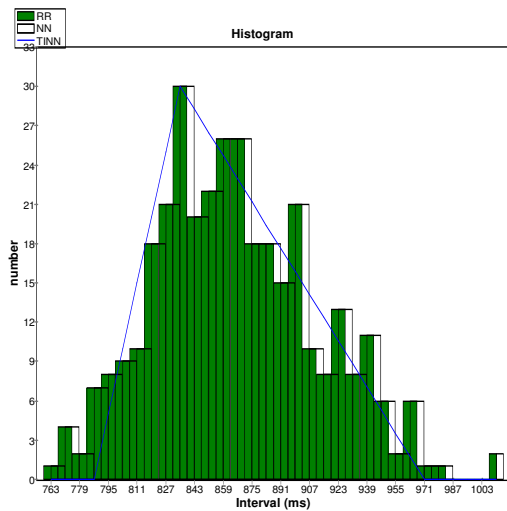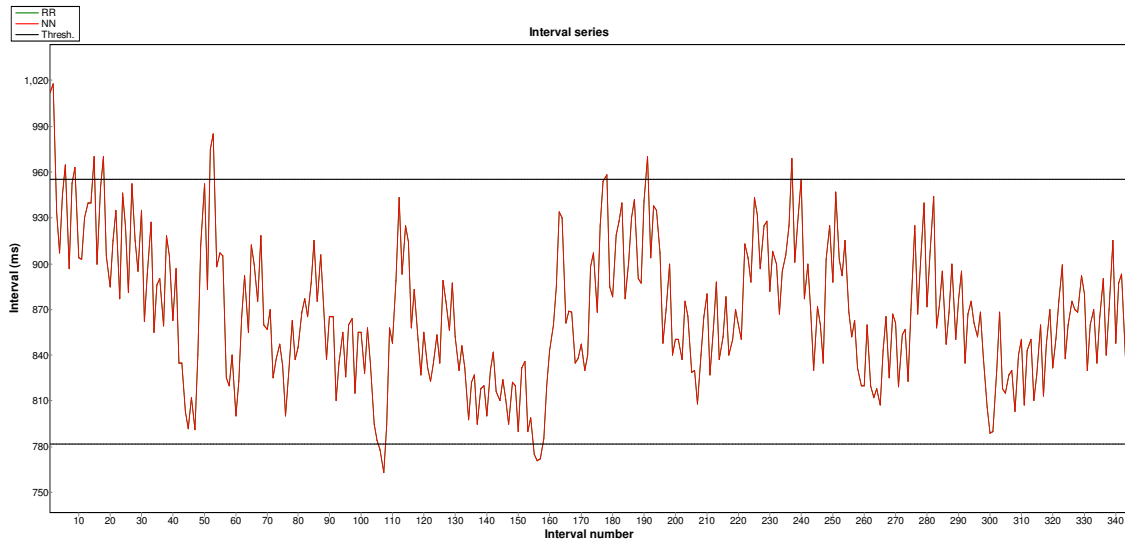

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	46	46
Triangular Interpolation (ms)	184	184
Triangular Index	11.47	11.47

Interval statistics	NN	RR
Number	344	344
Minimum (ms)	763	763
Maximum (ms)	1018	1018
Range (ms)	255	255
Avg (ms)	868	868
SD (ms)	46	46
AvgDev (ms)	37	37
p5 (ms)	797	797
p50 (ms)	865	865
p95 (ms)	949	949
Skewness	0.37	0.37
Kurtosis	2.89	2.89

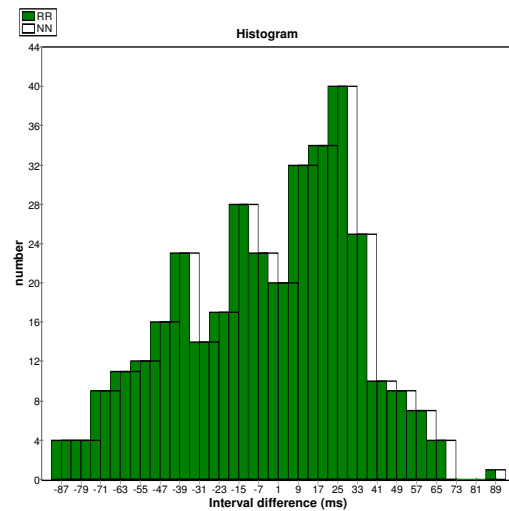



HRV parameters	NN	RR
SDSD (ms)	35	35
RMSSD (ms)	35	35
NN50	51	51
NN50(1)	33	33
NN50(2)	18	18
pNN50	0.15	0.15
pNN50(1)	0.10	0.10
pNN50(2)	0.05	0.05
Logarithmic Index	0.32	0.32
SD(Logarithmic Index)	0.05	0.05

Interval statistics	NN	RR
Number	343	343
Minimum (ms)	-87	-87
Maximum (ms)	92	92
Range (ms)	179	179
Avg (ms)	-0	-0
SD (ms)	35	35
AvgDev (ms)	29	29
p5 (ms)	-63	-63
p50 (ms)	4	4
p95 (ms)	54	54
Skewness	-0.30	-0.30
Kurtosis	2.42	2.42

Heart Rate Variability: Frequency Domain Analysis

Name: 006, 006 006
Number: 006
Gender: Female

Birthdate: 25/01/1979
Recorded: 01/05/2018 08:34:40

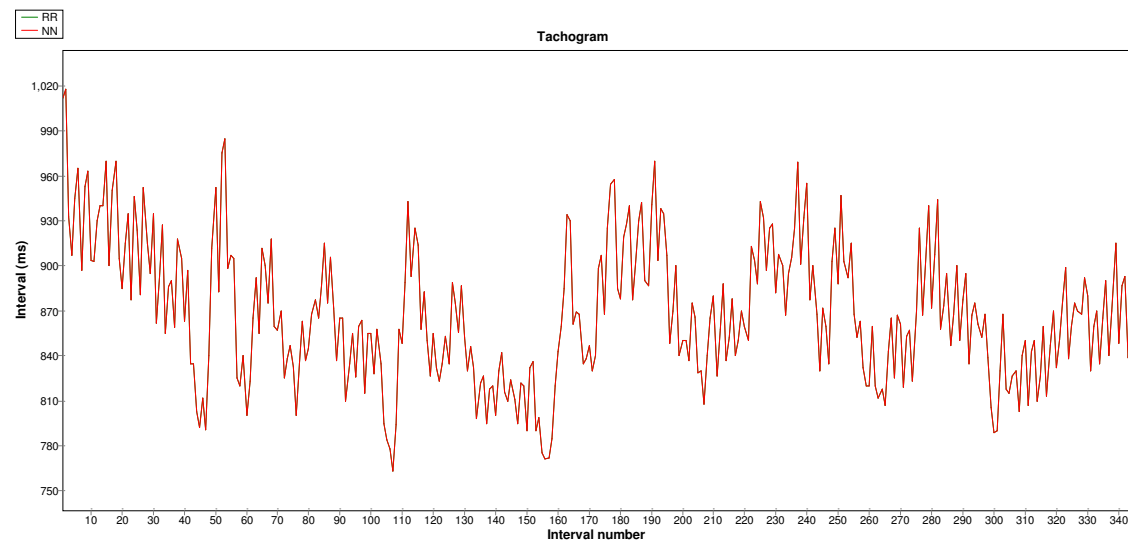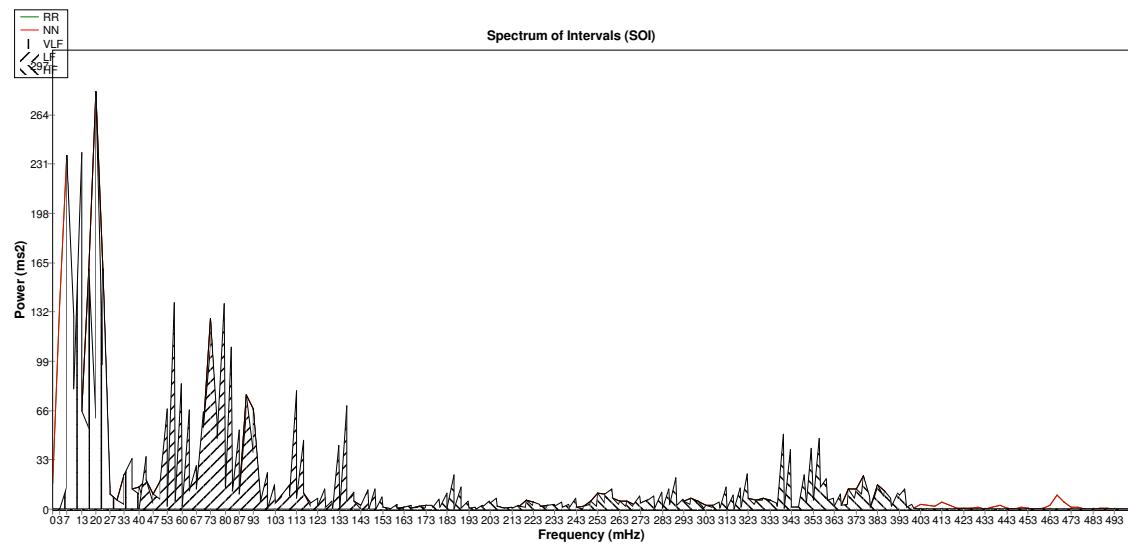

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	1918	1918	Spectrum of Intervals (SOI)	
VLF (ms2)	1052	1052	Frequency resolution (mHz)	3
LF (ms2)	564	564	VLF lower boundary (mHz)	3
HF (ms2)	302	302	VLF upper boundary (mHz)	40
LF/HF	1.87	1.87	LF upper boundary (mHz)	150
LF normalized	65.10	65.10	HF upper boundary (mHz)	400
HF normalized	34.90	34.90	Smoothing factor	1
VLF peak (mHz)	20	20	Tapering	Hann
LF peak (mHz)	73	73	Fourier transform	DFT
HF peak (mHz)	376	376	Sample frequency (Hz)	1.15
			Interval correction	Annotation
			Interval threshold (%)	10