


Anton Swart Biokinetic Rehabilitation Practice

Name: 006 006 006
Number: 006
Gender: Female
Birthdate: 25/01/1979 39 years

P / PQ: 112 ms / 182 ms
QRS: 88 ms
QT / QTc / QTd: 366 ms / 418 ms / -
P/QRS/T axis: 69° / 85° / 71°
Heartrate: 90 bpm

Recorded: 04/05/2018 13:58:55
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

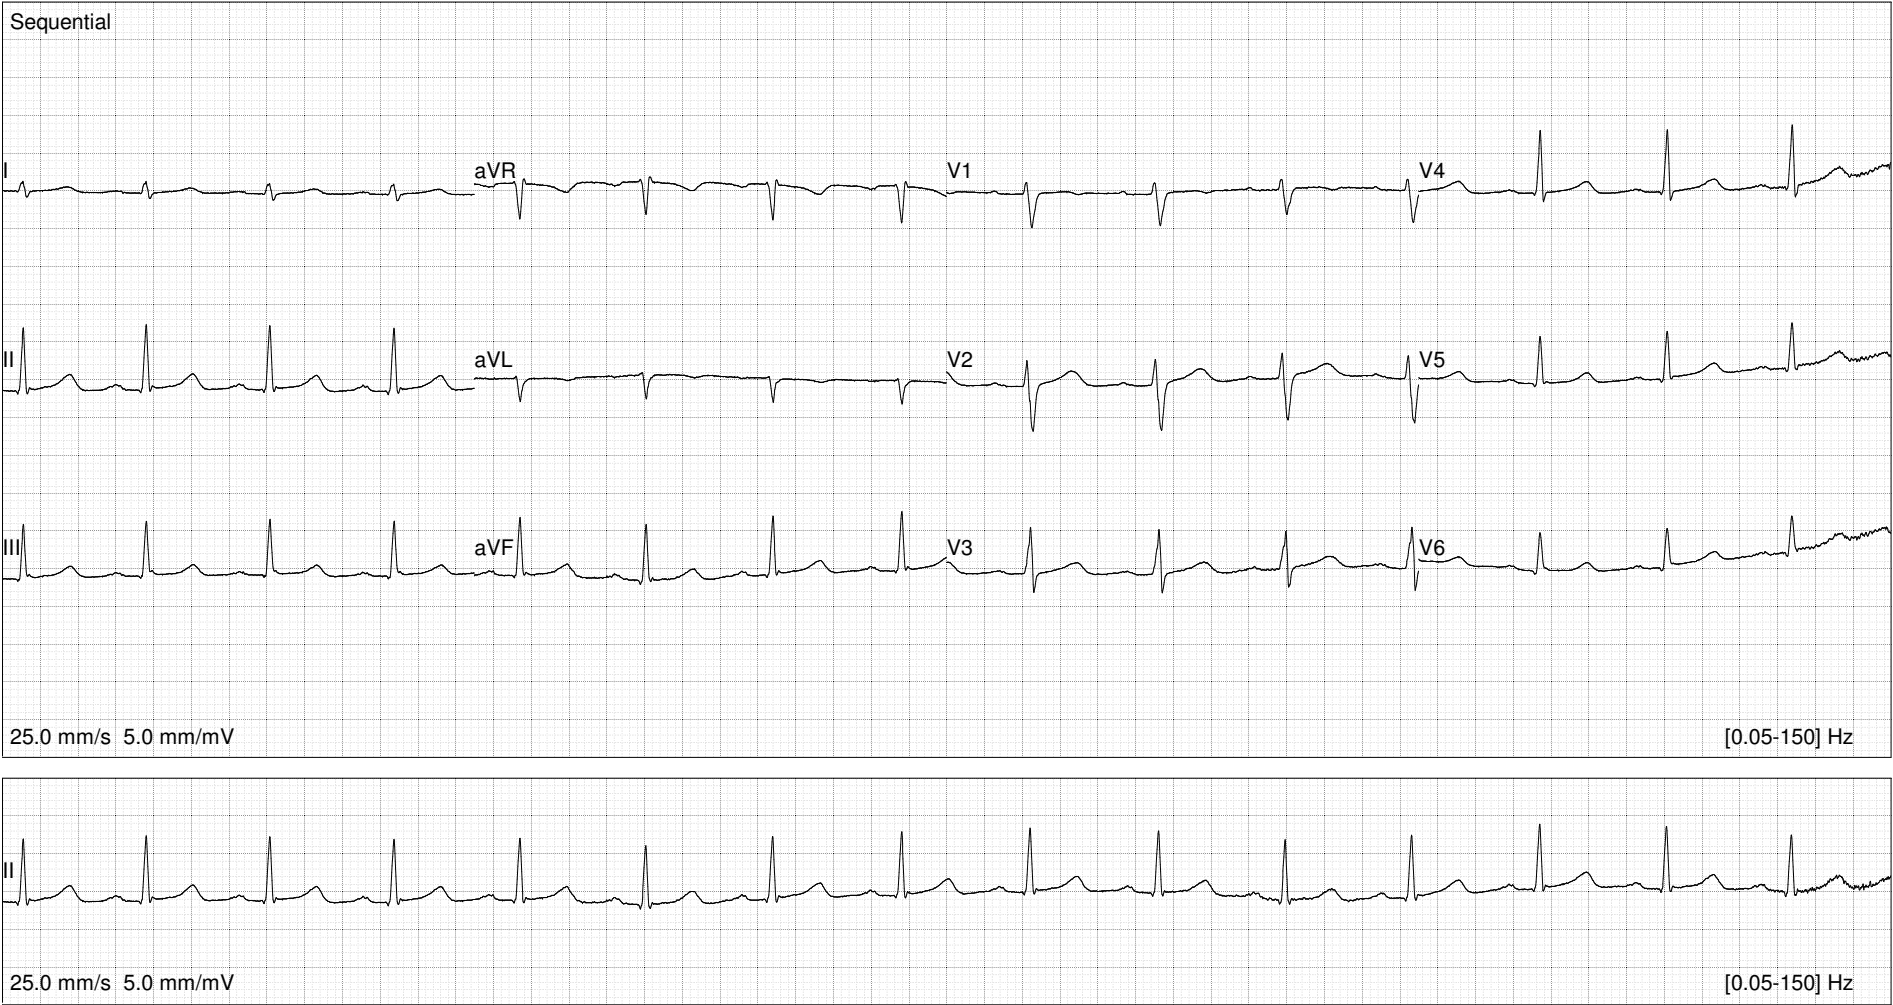



Anton Swart Biokinetic Rehabilitation Practice

Name: 006 006 006
Number: 006
Gender: Female
Birthdate: 25/01/1979 39 years
P / PQ: 112 ms / 182 ms
QRS: 88 ms
QT / QTc / QTd: 366 ms / 418 ms / -
P/QRS/T axis: 69° / 85° / 71°
Heartrate: 90 bpm

Recorded: 04/05/2018 13:58:55
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW



Beats		RR	
Total:	450	Minimum	610 ms
Normal:	450	Maximum	703 ms
Other:	0	Mean:	665 ms
		SD:	14 ms

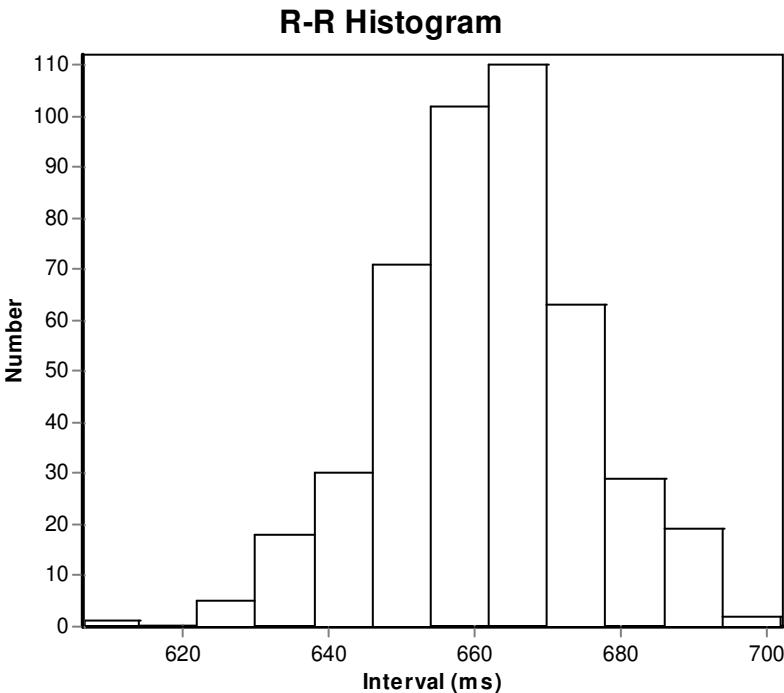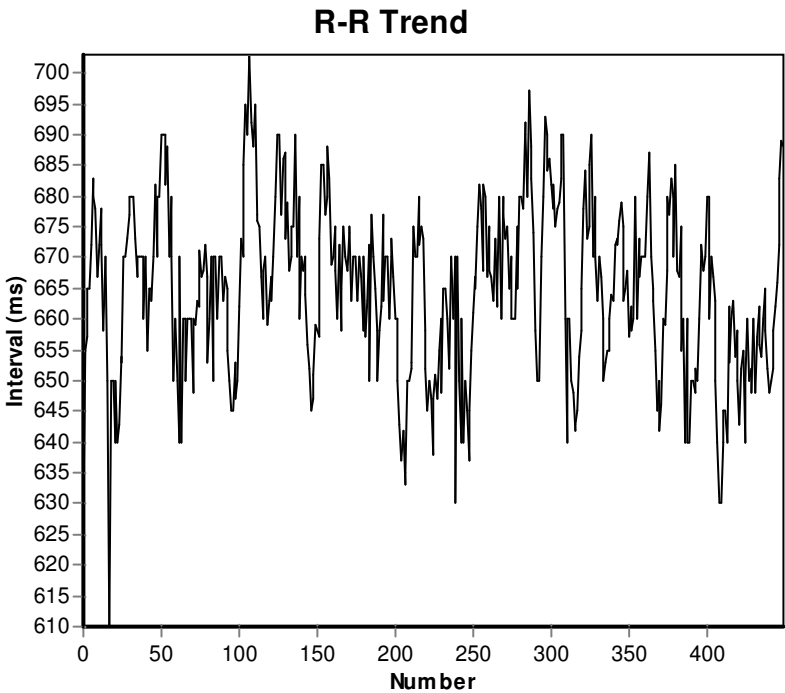

Heart Rate Variability: Time Domain Analysis

Name: 006, 006 006
 Number: 006
 Gender: Female


Birthdate: 25/01/1979
 Recorded: 04/05/2018 13:58:55

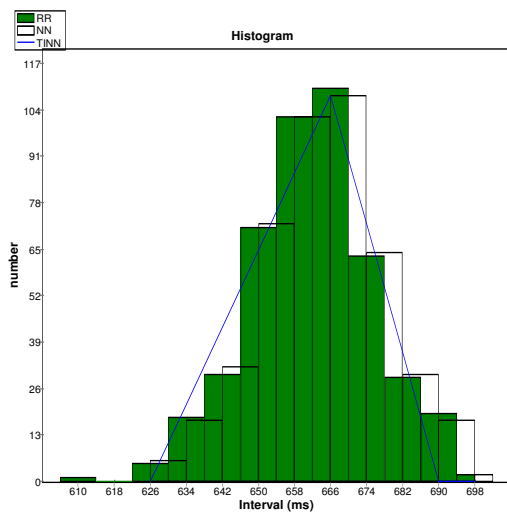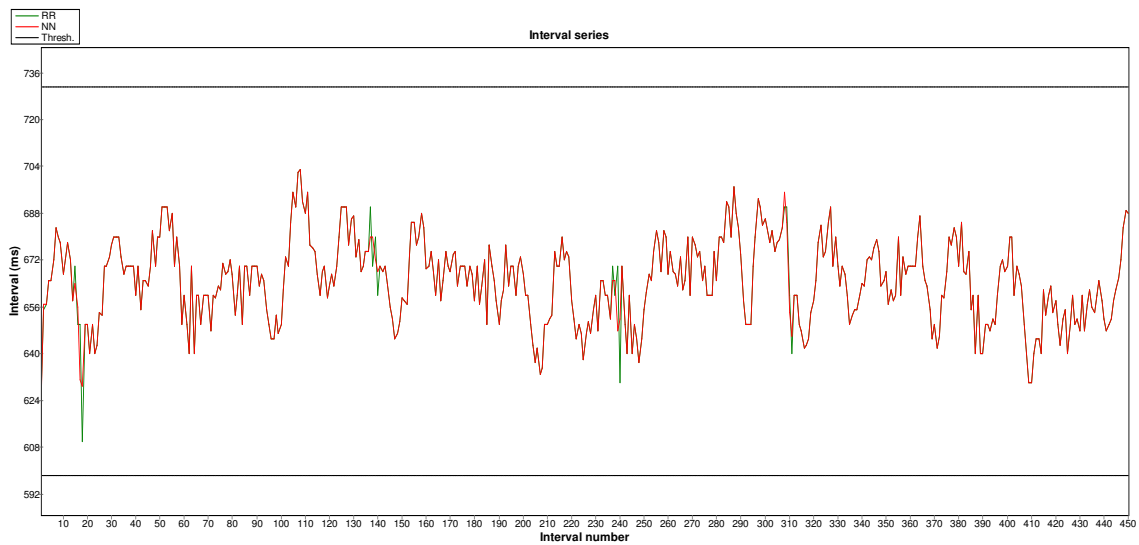

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	14	14
Triangular Interpolation (ms)	64	64
Triangular Index	4.17	4.09

Interval statistics	NN	RR
Number	450	450
Minimum (ms)	626	610
Maximum (ms)	703	703
Range (ms)	77	93
Avg (ms)	665	665
SD (ms)	14	14
AvgDev (ms)	11	11
p5 (ms)	640	640
p50 (ms)	665	665
p95 (ms)	688	689
Skewness	-0.07	-0.16
Kurtosis	2.72	3.03


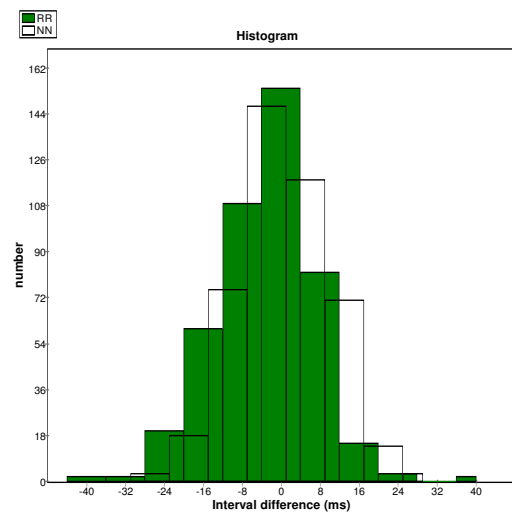


HRV parameters	NN	RR
SDSD (ms)	9	10
RMSSD (ms)	9	10
NN50	0	0
NN50(1)	0	0
NN50(2)	0	0
pNN50	0.00	0.00
pNN50(1)	0.00	0.00
pNN50(2)	0.00	0.00
Logarithmic Index	1.28	1.17
SD(Logarithmic Index)	0.20	0.16

Interval statistics	NN	RR
Number	449	449
Minimum (ms)	-31	-40
Maximum (ms)	31	40
Range (ms)	62	80
Avg (ms)	0	0
SD (ms)	9	10
AvgDev (ms)	7	8
p5 (ms)	-15	-17
p50 (ms)	0	0
p95 (ms)	15	15
Skewness	-0.04	-0.07
Kurtosis	3.35	4.53

Heart Rate Variability: Frequency Domain Analysis

Name: 006, 006 006 Birthdate: 25/01/1979
 Number: 006 Recorded: 04/05/2018 13:58:55
 Gender: Female

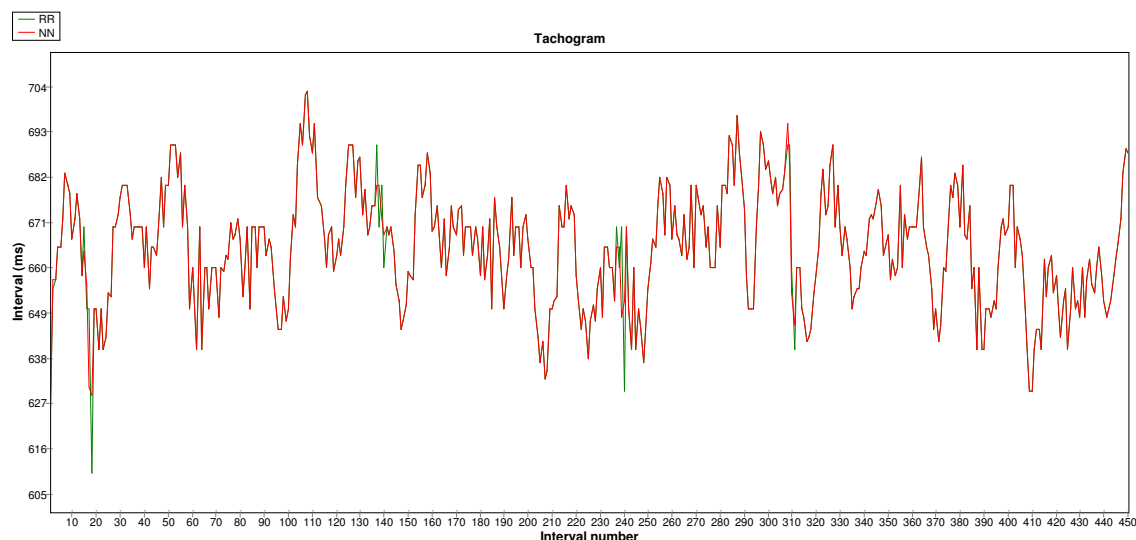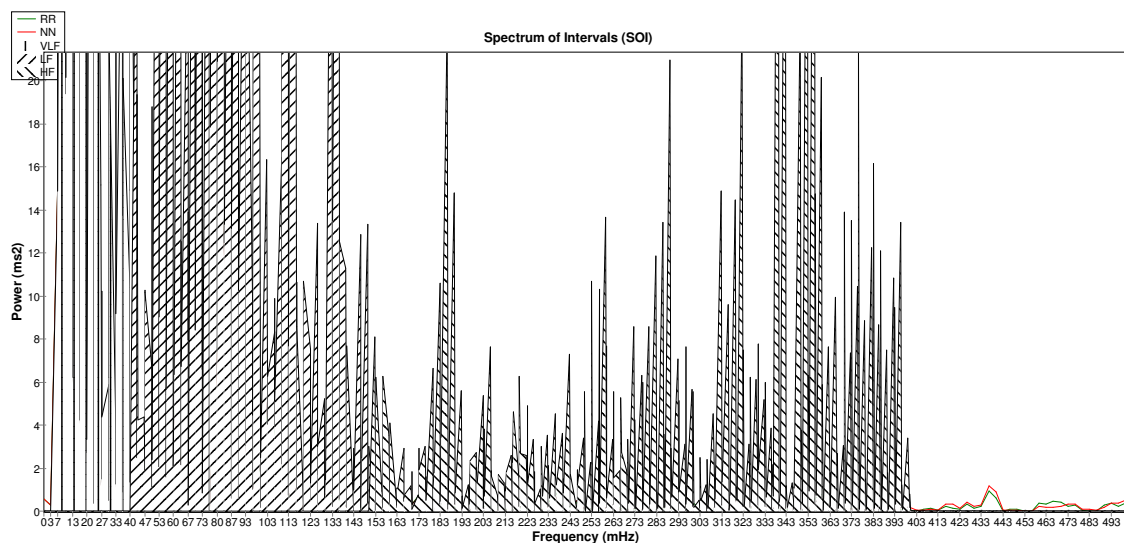

HRV parameters		NN	RR	HRV spectral settings	
TP (ms2)	160	161		Spectrum of Intervals (SOI)	
VLF (ms2)	54	54		Frequency resolution (mHz)	3
LF (ms2)	92	93		VLF lower boundary (mHz)	3
HF (ms2)	14	15		VLF upper boundary (mHz)	40
LF/HF	6.53	6.37		LF upper boundary (mHz)	150
LF normalized	86.73	86.43		HF upper boundary (mHz)	400
HF normalized	13.27	13.57		Smoothing factor	1
VLF peak (mHz)	10	10		Tapering	Hann
LF peak (mHz)	70	70		Fourier transform	DFT
HF peak (mHz)	176	176		Sample frequency (Hz)	1.50
				Interval correction	Annotation
				Interval threshold (%)	10