


Anton Swart Biokinetic Rehabilitation Practice

Name: 006 006 006
Number: 006
Gender: Female
Birthdate: 25/01/1979 39 years

P / PQ: 100 ms / 173 ms
QRS: 82 ms
QT / QTc / QTd: 420 ms / 444 ms / -
P/QRS/T axis: 75° / 86° / 77°
Heartrate: 74 bpm

Recorded: 06/05/2018 06:50:14
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

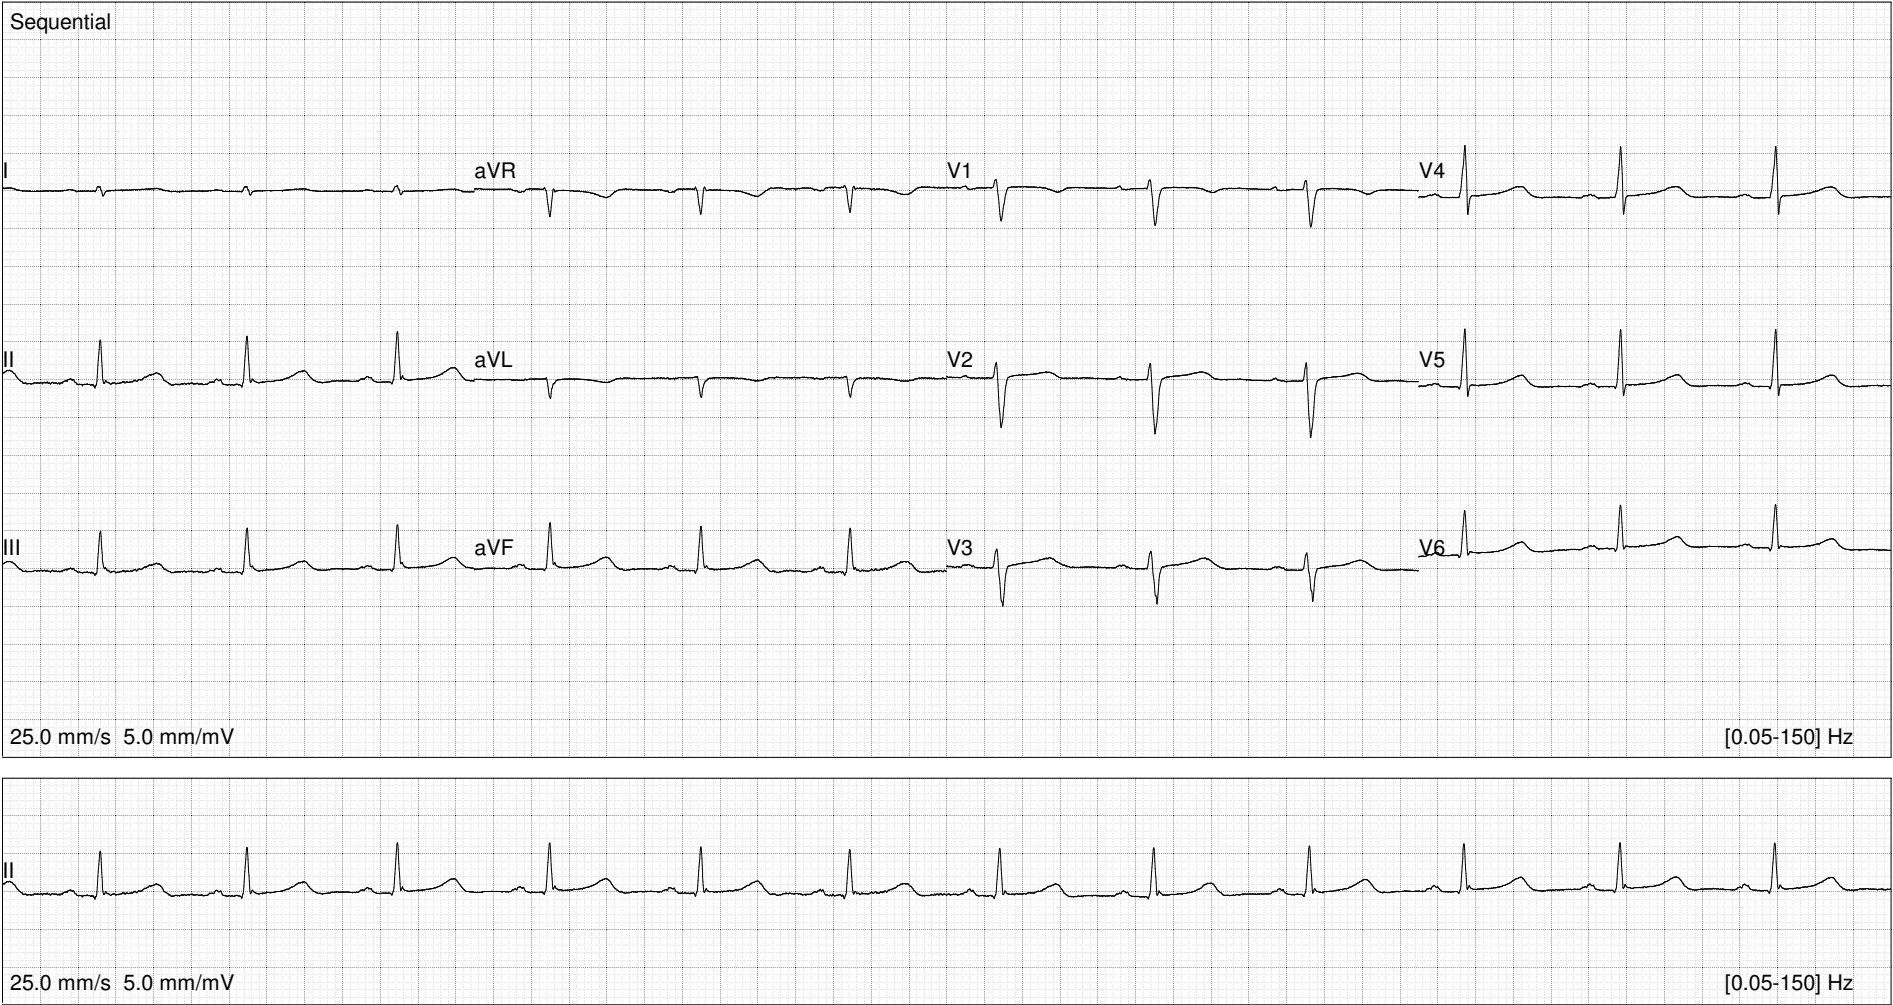



Anton Swart Biokinetic Rehabilitation Practice

Name: 006 006 006
Number: 006
Gender: Female
Birthdate: 25/01/1979 39 years
P / PQ: 100 ms / 173 ms
QRS: 82 ms
QT / QTc / QTd: 420 ms / 444 ms / -
P/QRS/T axis: 75° / 86° / 77°
Heartrate: 74 bpm

Recorded: 06/05/2018 06:50:14
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW



Beats		RR	
Total:	369	Minimum	720 ms
Normal:	369	Maximum	930 ms
Other:	0	Mean:	809 ms
		SD:	34 ms

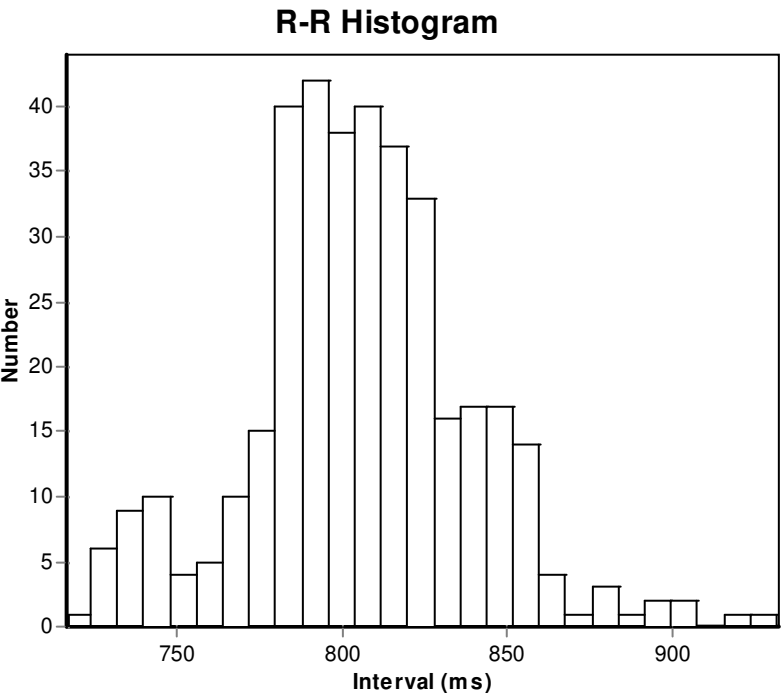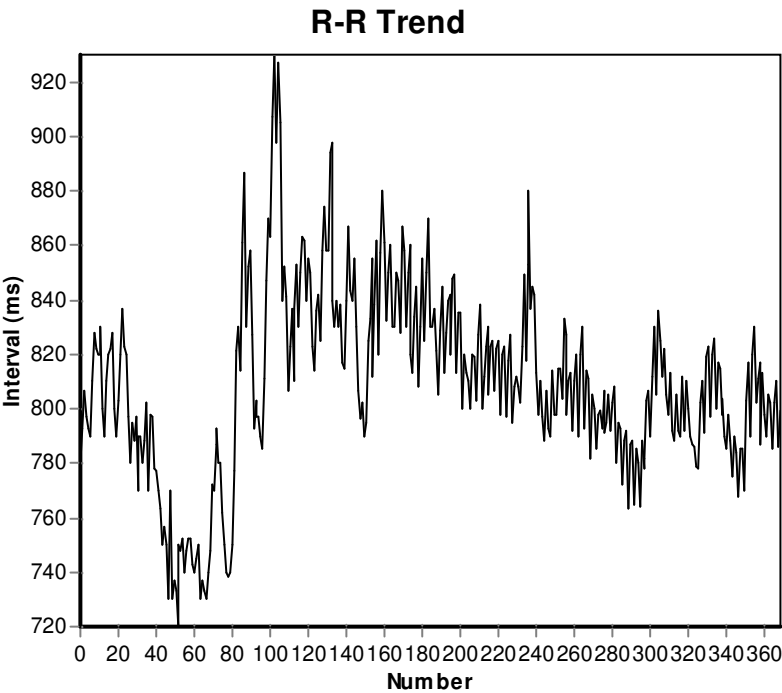

Heart Rate Variability: Time Domain Analysis

Name: 006, 006 006
 Number: 006
 Gender: Female


Birthdate: 25/01/1979
 Recorded: 06/05/2018 06:50:14

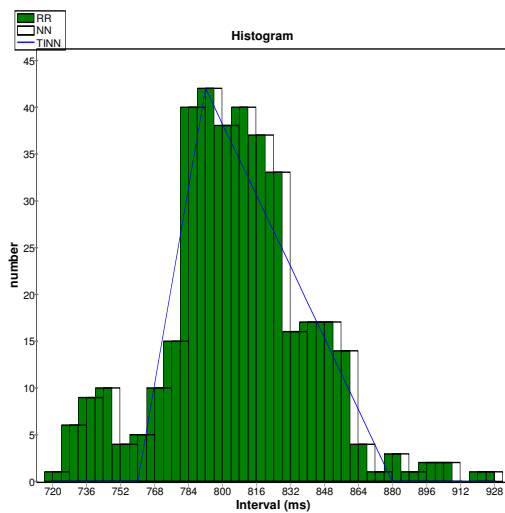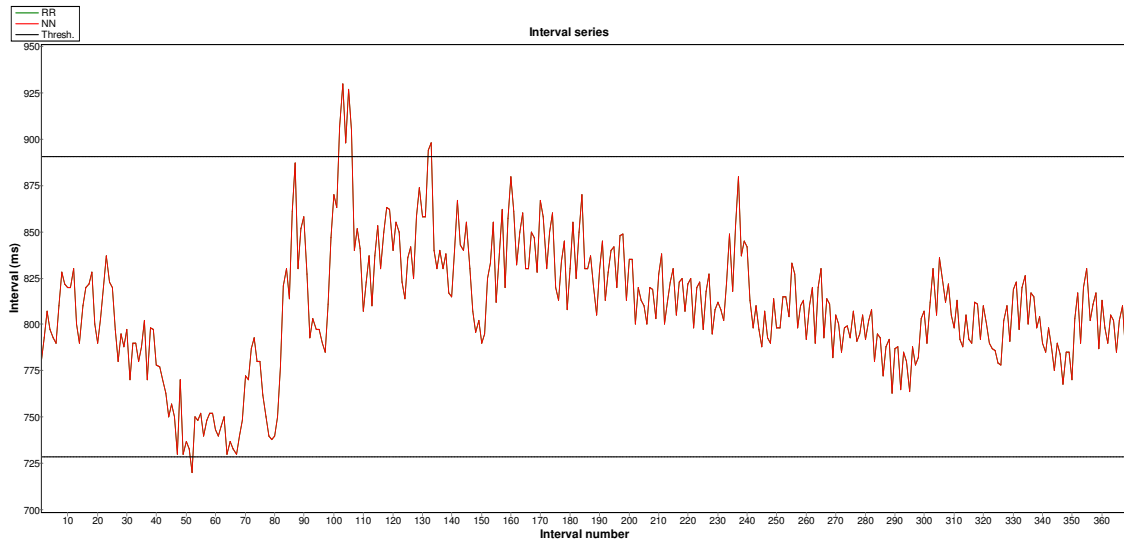

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	34	34
Triangular Interpolation (ms)	120	120
Triangular Index	8.79	8.79

Interval statistics	NN	RR
Number	369	369
Minimum (ms)	720	720
Maximum (ms)	930	930
Range (ms)	210	210
Avg (ms)	809	809
SD (ms)	34	34
AvgDev (ms)	26	26
p5 (ms)	748	748
p50 (ms)	810	810
p95 (ms)	862	862
Skewness	0.15	0.15
Kurtosis	3.80	3.80


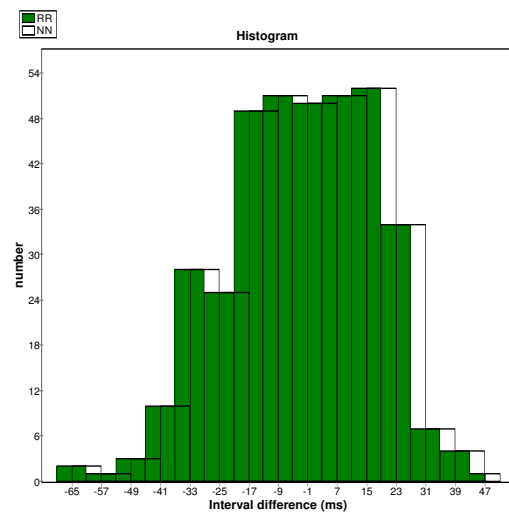


HRV parameters	NN	RR
SDSD (ms)	20	20
RMSSD (ms)	20	20
NN50	3	3
NN50(1)	3	3
NN50(2)	0	0
pNN50	0.01	0.01
pNN50(1)	0.01	0.01
pNN50(2)	0.00	0.00
Logarithmic Index	0.70	0.70
SD(Logarithmic Index)	0.09	0.09

Interval statistics	NN	RR
Number	368	368
Minimum (ms)	-65	-65
Maximum (ms)	47	47
Range (ms)	112	112
Avg (ms)	0	0
SD (ms)	20	20
AvgDev (ms)	16	16
p5 (ms)	-32	-32
p50 (ms)	0	0
p95 (ms)	29	29
Skewness	-0.29	-0.29
Kurtosis	2.75	2.75

Heart Rate Variability: Frequency Domain Analysis

Name: 006, 006 006 Birthdate: 25/01/1979
 Number: 006 Recorded: 06/05/2018 06:50:14
 Gender: Female

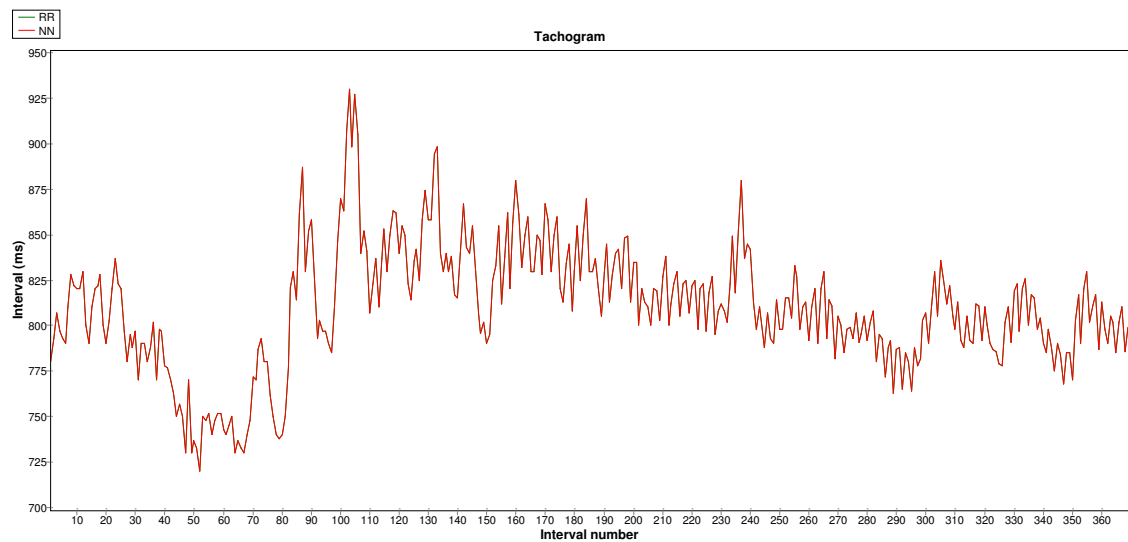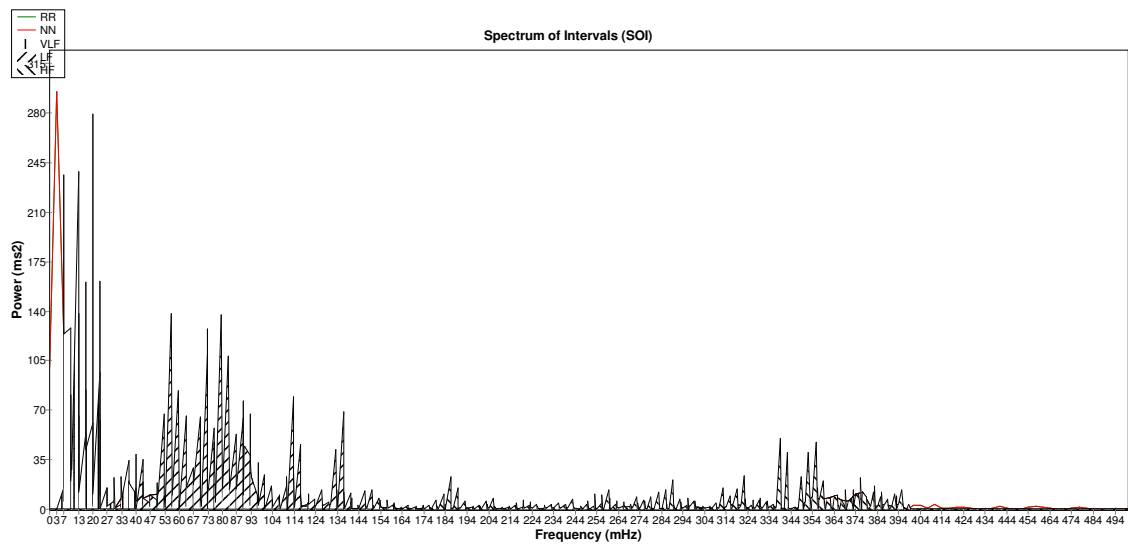

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	609	609	Spectrum of Intervals (SOI)	
VLF (ms2)	253	253	Frequency resolution (mHz)	3
LF (ms2)	232	232	VLF lower boundary (mHz)	3
HF (ms2)	124	124	VLF upper boundary (mHz)	40
LF/HF	1.86	1.86	LF upper boundary (mHz)	150
LF normalized	65.07	65.07	HF upper boundary (mHz)	400
HF normalized	34.93	34.93	Smoothing factor	1
VLF peak (mHz)	7	7	Tapering	Hann
LF peak (mHz)	90	90	Fourier transform	DFT
HF peak (mHz)	377	377	Sample frequency (Hz)	1.24
			Interval correction	Annotation
			Interval threshold (%)	10