


Anton Swart Biokinetic Rehabilitation Practice

Name: 007 007 007
Number: 007
Gender: Male
Birthdate: 25/12/1976 41 years

P / PQ: 118 ms / 165 ms
QRS: 100 ms
QT / QTc / QTd: 382 ms / 436 ms / -
P/QRS/T axis: 77° / 84° / 73°
Heartrate: 91 bpm

Recorded: 03/05/2018 16:09:58
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

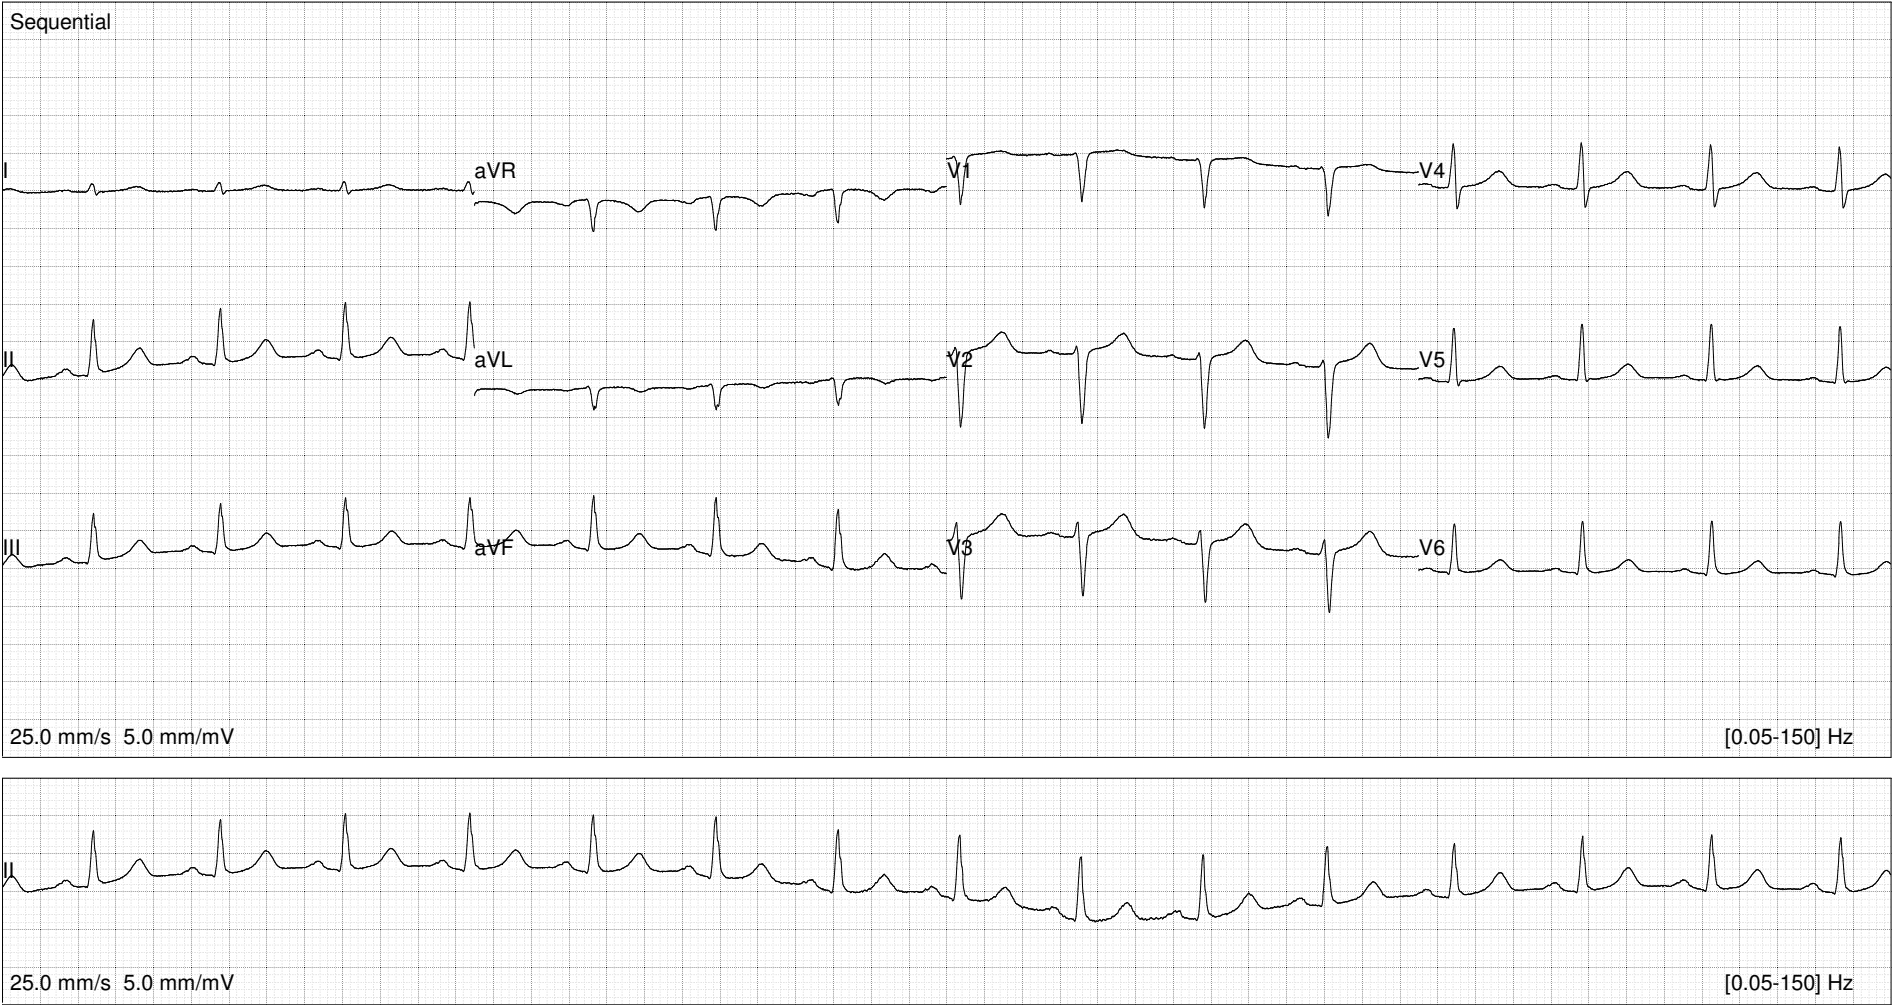

Anton Swart Biokinetic Rehabilitation Practice

Name:

007 007 007

Number:

007

Gender:

Male

Birthdate:

25/12/1976 41 years

P / PQ:

118 ms / 165 ms

QRS:

100 ms

QT / QTc / QTd:

382 ms / 436 ms / -

P/QRS/T axis:

77° / 84° / 73°

Heartrate:

91 bpm

Recorded:

03/05/2018 16:09:58

Recorded by:

Mr. Anton Swart

Referring physician:

Location:

Anton Swart Biokinetic Rehabilitation Practice



Ordering physician:

Attending physician:

Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW



Beats		RR	
Total:	449	Minimum	620 ms
Normal:	449	Maximum	730 ms
Other:	0	Mean:	665 ms
		SD:	17 ms

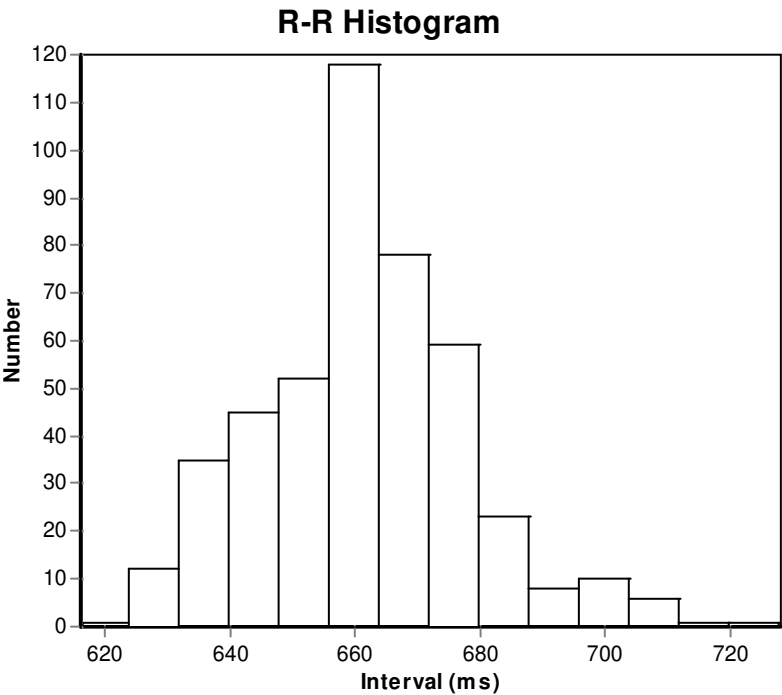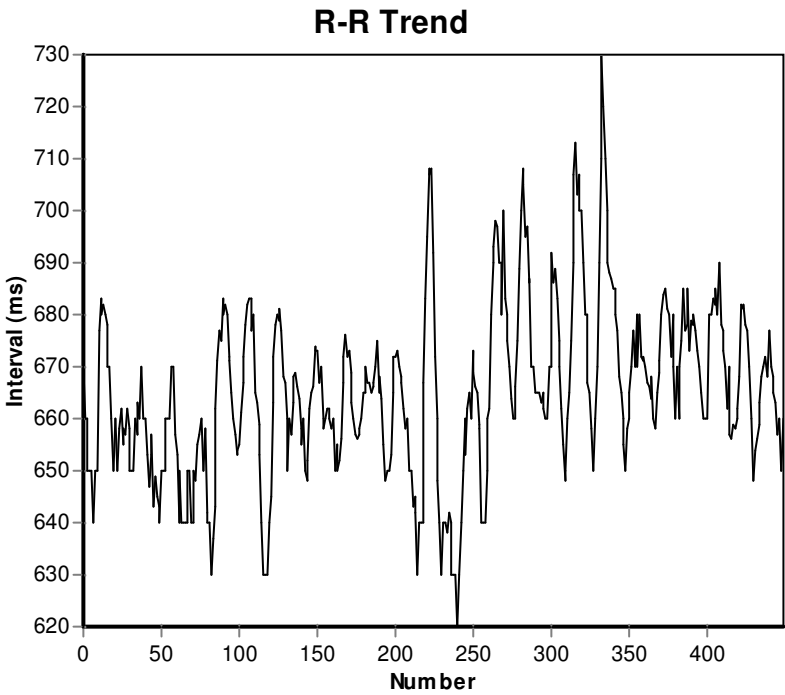

Heart Rate Variability: Time Domain Analysis

Name: 007, 007 007
Number: 007
Gender: Male


Birthdate: 25/12/1976
Recorded: 03/05/2018 16:09:58

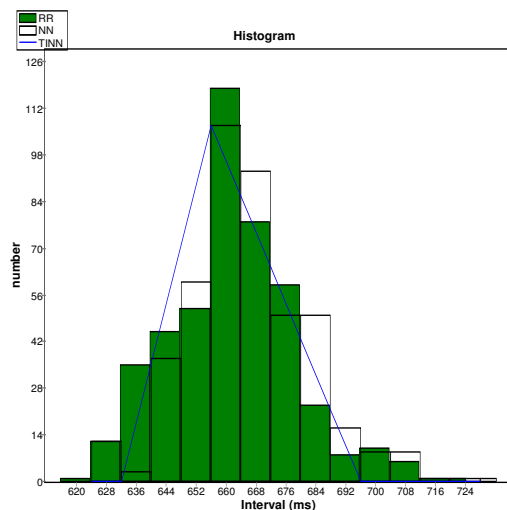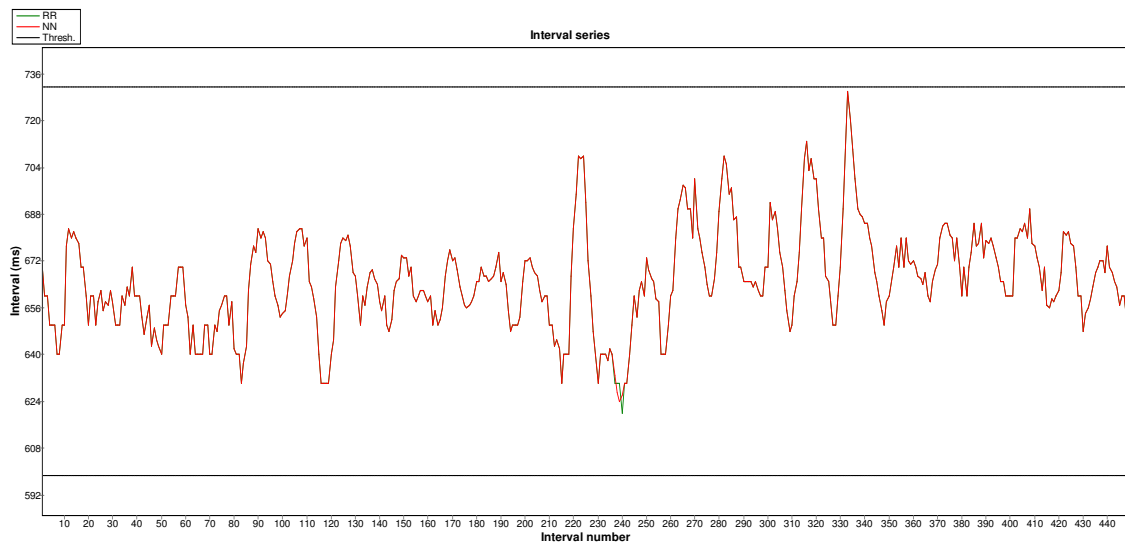

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	17	17
Triangular Interpolation (ms)	64	64
Triangular Index	4.20	3.81

Interval statistics	NN	RR
Number	449	449
Minimum (ms)	624	620
Maximum (ms)	730	730
Range (ms)	106	110
Avg (ms)	665	665
SD (ms)	17	17
AvgDev (ms)	13	13
p5 (ms)	640	640
p50 (ms)	665	665
p95 (ms)	695	695
Skewness	0.40	0.40
Kurtosis	3.71	3.72

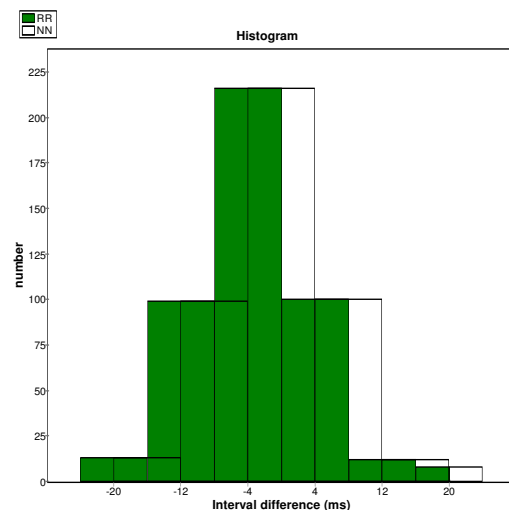



HRV parameters	NN	RR
SDSD (ms)	7	7
RMSSD (ms)	7	7
NN50	0	0
NN50(1)	0	0
NN50(2)	0	0
pNN50	0.00	0.00
pNN50(1)	0.00	0.00
pNN50(2)	0.00	0.00
Logarithmic Index	1.71	1.71
SD(Logarithmic Index)	0.20	0.20

Interval statistics	NN	RR
Number	448	448
Minimum (ms)	-20	-20
Maximum (ms)	27	27
Range (ms)	47	47
Avg (ms)	-0	-0
SD (ms)	7	7
AvgDev (ms)	5	5
p5 (ms)	-10	-10
p50 (ms)	0	0
p95 (ms)	11	11
Skewness	0.43	0.42
Kurtosis	3.76	3.72

Heart Rate Variability: Frequency Domain Analysis

Name: 007, 007 007
 Number: 007
 Gender: Male

Birthdate: 25/12/1976
 Recorded: 03/05/2018 16:09:58

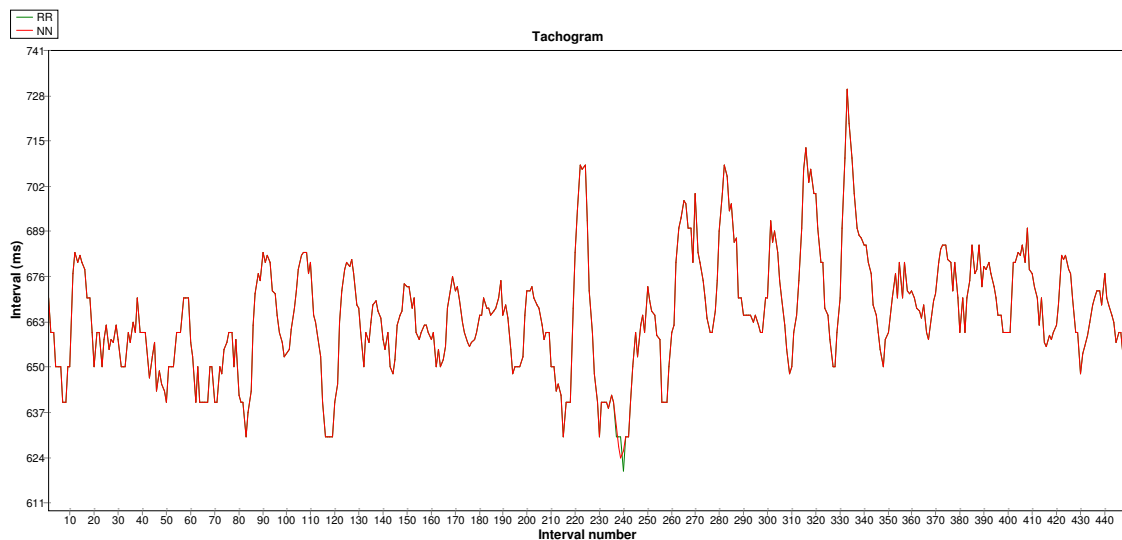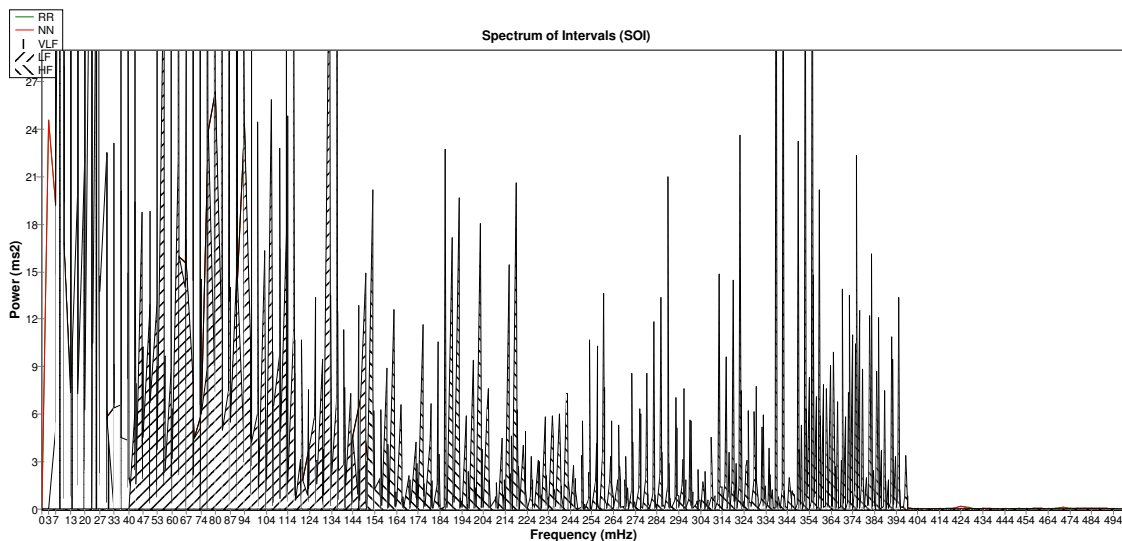

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	322	322	Spectrum of Intervals (SOI)	
VLF (ms2)	100	100	Frequency resolution (mHz)	3
LF (ms2)	211	211	VLF lower boundary (mHz)	3
HF (ms2)	11	11	VLF upper boundary (mHz)	40
LF/HF	18.90	19.20	LF upper boundary (mHz)	150
LF normalized	94.97	95.05	HF upper boundary (mHz)	400
HF normalized	5.03	4.95	Smoothing factor	1
VLF peak (mHz)	7	7	Tapering	Hann
LF peak (mHz)	80	80	Fourier transform	DFT
HF peak (mHz)	150	150	Sample frequency (Hz)	1.50
			Interval correction	Annotation
			Interval threshold (%)	10