


Anton Swart Biokinetic Rehabilitation Practice

Name: 011 011 011
Number: 011
Gender: Male
Birthdate: 18/01/1976 42 years

Recorded: 04/05/2018 12:24:00
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

P / PQ: 108 ms / 173 ms
QRS: 82 ms
QT / QTc / QTd: 369 ms / 413 ms / -
P/QRS/T axis: 83° / 81° / 74°
Heartrate: 85 bpm

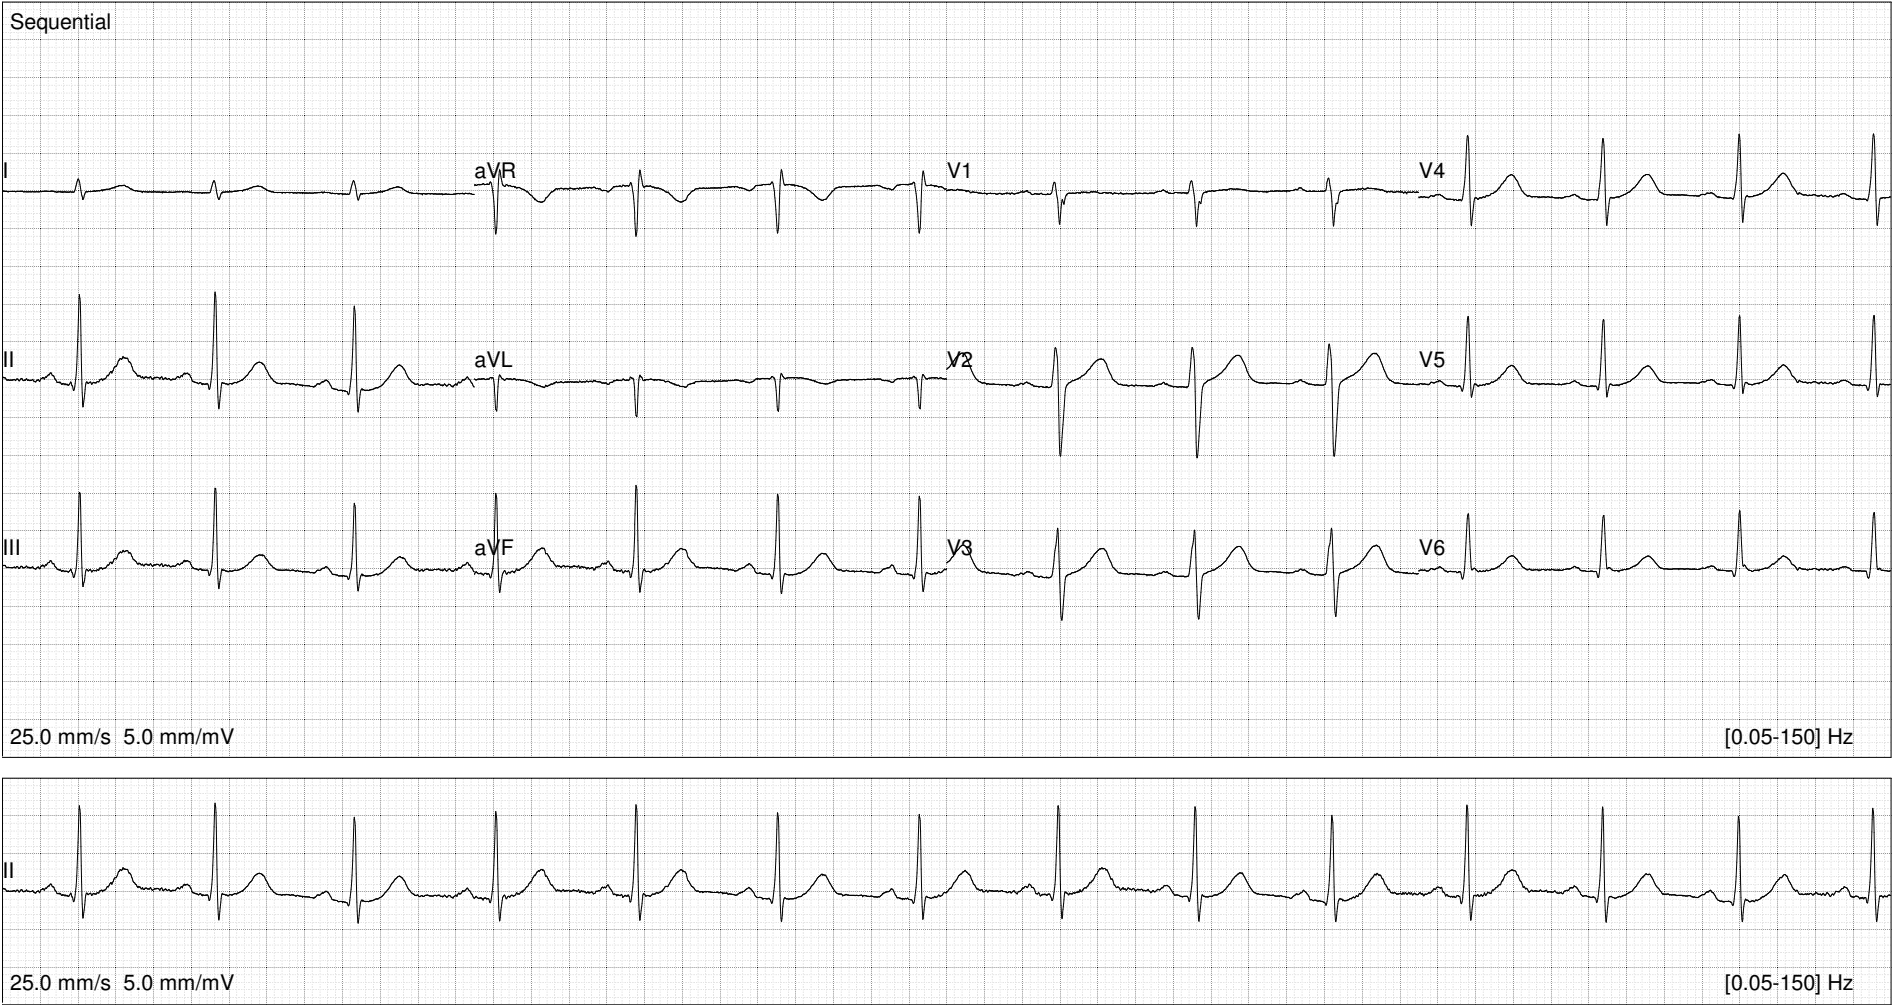



Anton Swart Biokinetic Rehabilitation Practice

Name: 011 011 011
Number: 011
Gender: Male
Birthdate: 18/01/1976 42 years
P / PQ: 108 ms / 173 ms
QRS: 82 ms
QT / QTc / QTd: 369 ms / 413 ms / -
P/QRS/T axis: 83° / 81° / 74°
Heartrate: 85 bpm

Recorded: 04/05/2018 12:24:00
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW



Beats		RR	
Total:	421	Minimum	637 ms
Normal:	421	Maximum	774 ms
Other:	0	Mean:	710 ms
		SD:	23 ms

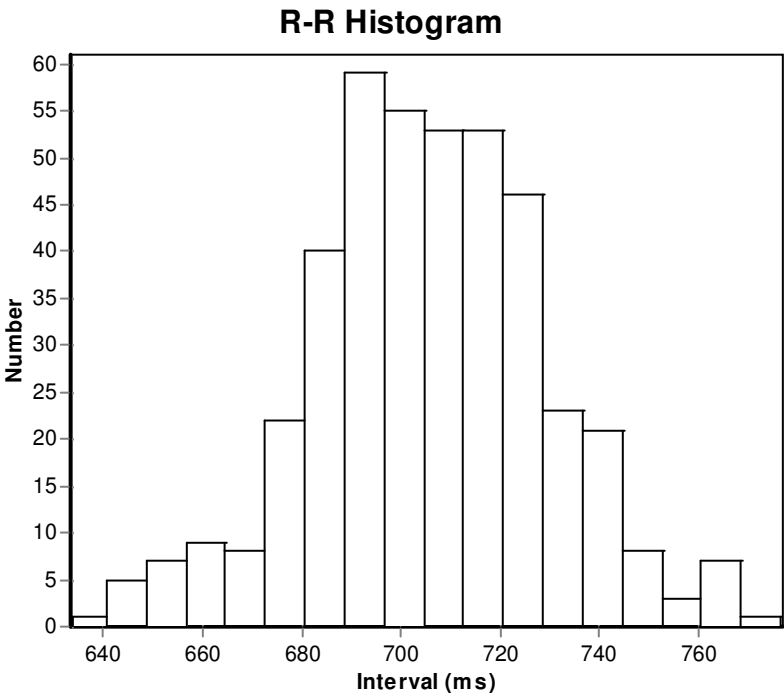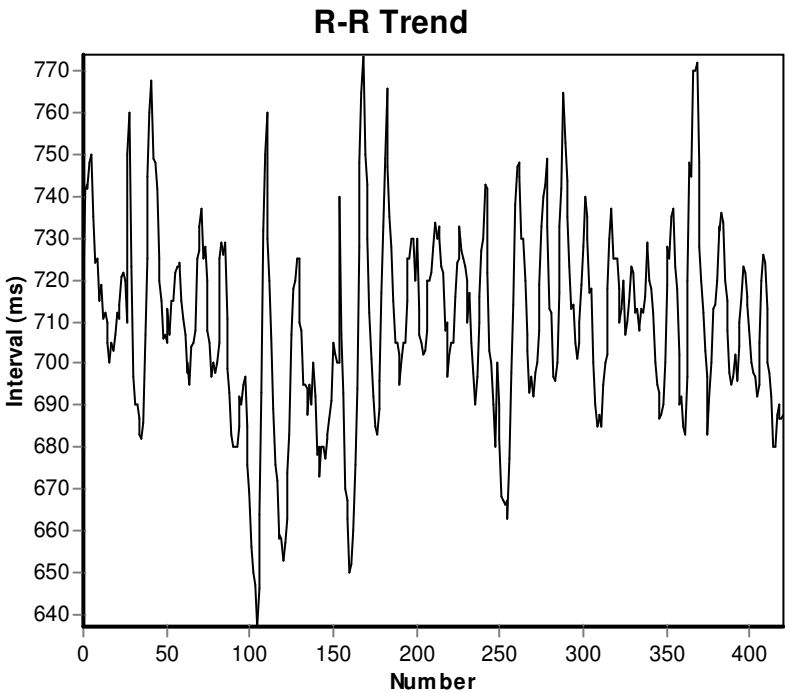

Heart Rate Variability: Time Domain Analysis

Name: 011, 011 011
 Number: 011
 Gender: Male


Birthdate: 18/01/1976
 Recorded: 04/05/2018 12:24:00

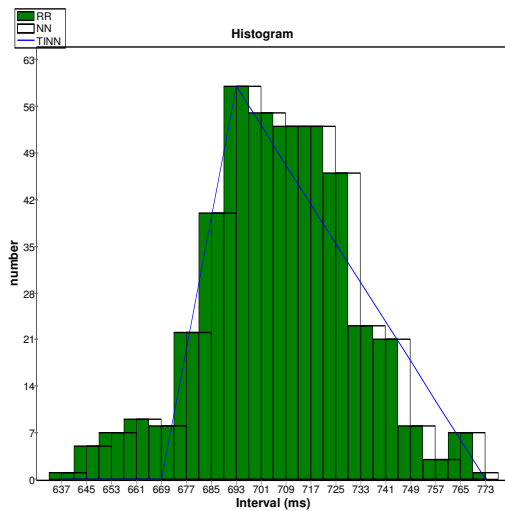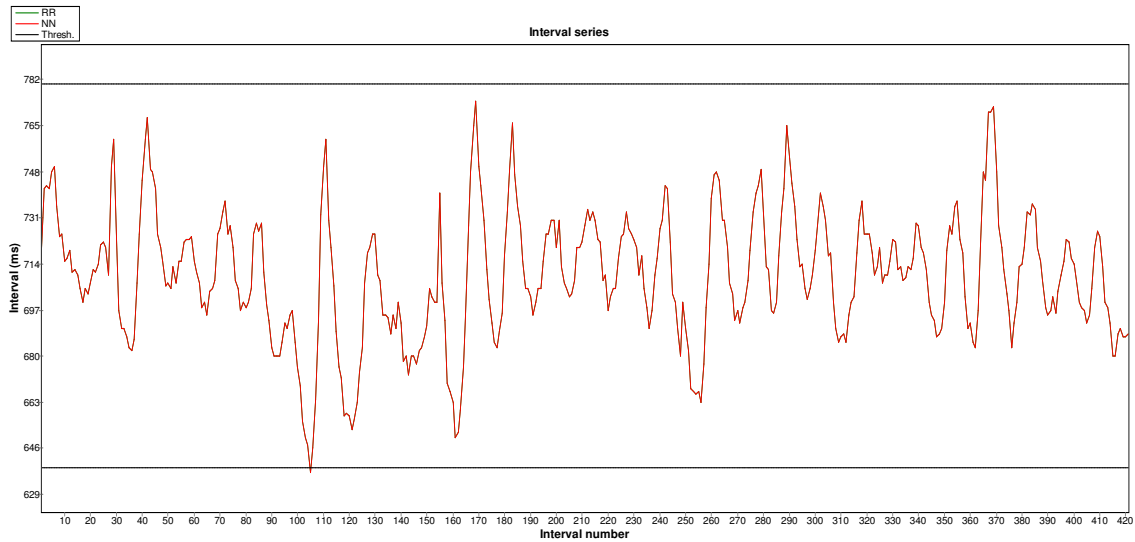

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	23	23
Triangular Interpolation (ms)	104	104
Triangular Index	7.14	7.14

Interval statistics	NN	RR
Number	421	421
Minimum (ms)	637	637
Maximum (ms)	774	774
Range (ms)	137	137
Avg (ms)	710	710
SD (ms)	23	23
AvgDev (ms)	18	18
p5 (ms)	668	668
p50 (ms)	710	710
p95 (ms)	748	748
Skewness	-0.08	-0.08
Kurtosis	3.29	3.29

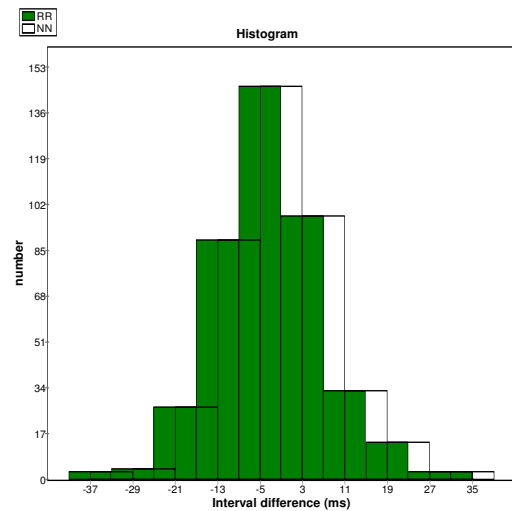



HRV parameters	NN	RR
SDSD (ms)	11	11
RMSSD (ms)	11	11
NN50	0	0
NN50(1)	0	0
NN50(2)	0	0
pNN50	0.00	0.00
pNN50(1)	0.00	0.00
pNN50(2)	0.00	0.00
Logarithmic Index	1.02	1.02
SD(Logarithmic Index)	0.05	0.05

Interval statistics	NN	RR
Number	420	420
Minimum (ms)	-37	-37
Maximum (ms)	40	40
Range (ms)	77	77
Avg (ms)	-0	-0
SD (ms)	11	11
AvgDev (ms)	8	8
p5 (ms)	-16	-16
p50 (ms)	0	0
p95 (ms)	18	18
Skewness	0.37	0.37
Kurtosis	4.38	4.38

Heart Rate Variability: Frequency Domain Analysis

Name: 011, 011 011
Number: 011
Gender: Male

Birthdate: 18/01/1976
Recorded: 04/05/2018 12:24:00

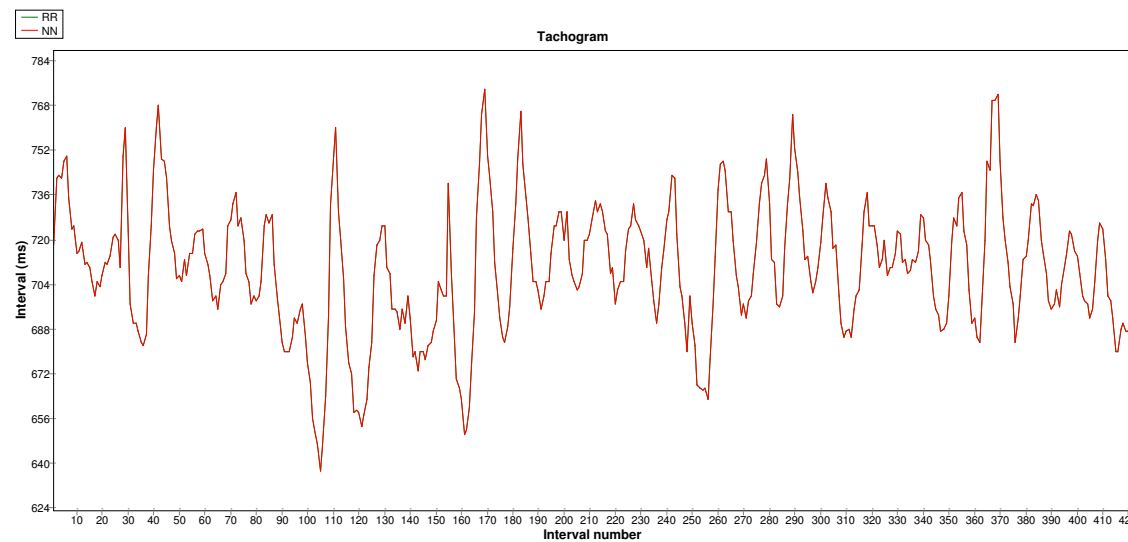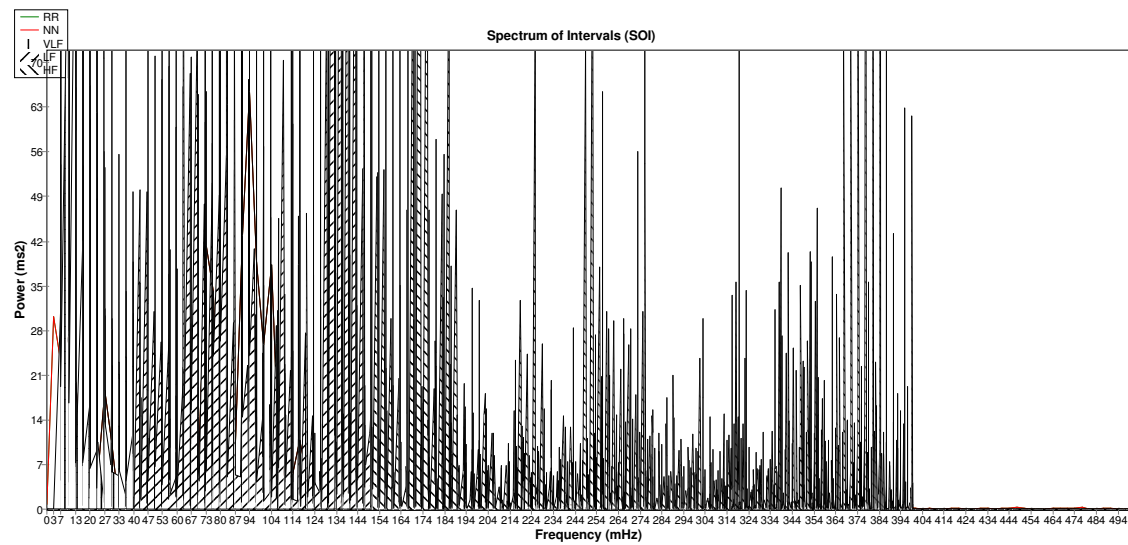

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	549	549	Spectrum of Intervals (SOI)	
VLF (ms2)	114	114	Frequency resolution (mHz)	3
LF (ms2)	409	409	VLF lower boundary (mHz)	3
HF (ms2)	26	26	VLF upper boundary (mHz)	40
LF/HF	15.75	15.75	LF upper boundary (mHz)	150
LF normalized	94.03	94.03	HF upper boundary (mHz)	400
HF normalized	5.97	5.97	Smoothing factor	1
VLF peak (mHz)	10	10	Tapering	Hann
LF peak (mHz)	94	94	Fourier transform	DFT
HF peak (mHz)	160	160	Sample frequency (Hz)	1.41
			Interval correction	Annotation
			Interval threshold (%)	10