


Anton Swart Biokinetic Rehabilitation Practice

Name: 011 011 011
Number: 011
Gender: Male
Birthdate: 18/01/1976 42 years

Recorded: 05/05/2018 12:05:08
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

P / PQ: 107 ms / 155 ms
QRS: 80 ms
QT / QTc / QTd: 387 ms / 420 ms / -
P/QRS/T axis: 85° / 84° / 80°
Heartrate: 79 bpm

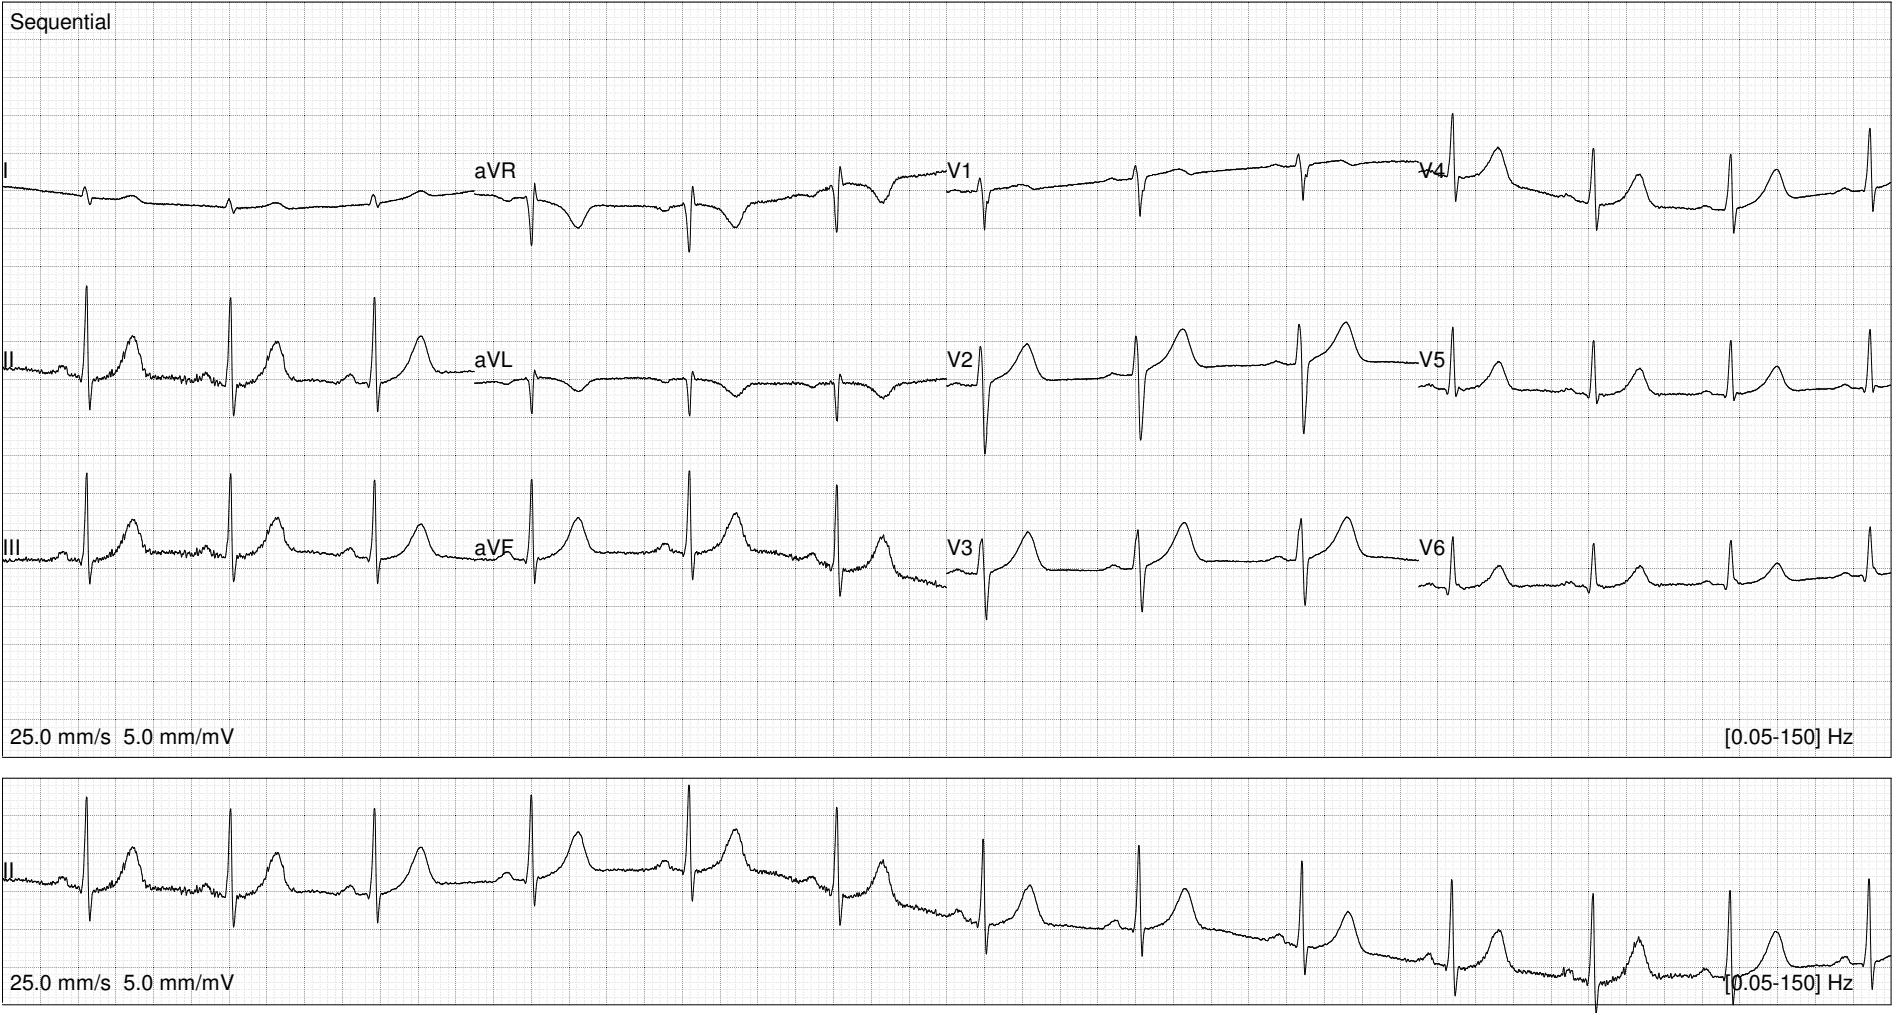

Anton Swart Biokinetic Rehabilitation Practice


Name: 011 011 011
Number: 011
Gender: Male
Birthdate: 18/01/1976 42 years
P / PQ: 107 ms / 155 ms
QRS: 80 ms
QT / QTc / QTd: 387 ms / 420 ms / -
P/QRS/T axis: 85° / 84° / 80°
Heartrate: 79 bpm

Recorded: 05/05/2018 12:05:08
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:


UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

Beats		RR	
Total:	387	Minimum	678 ms
Normal:	387	Maximum	1230 ms
Other:	0	Mean:	772 ms
		SD:	78 ms

R-R Trend

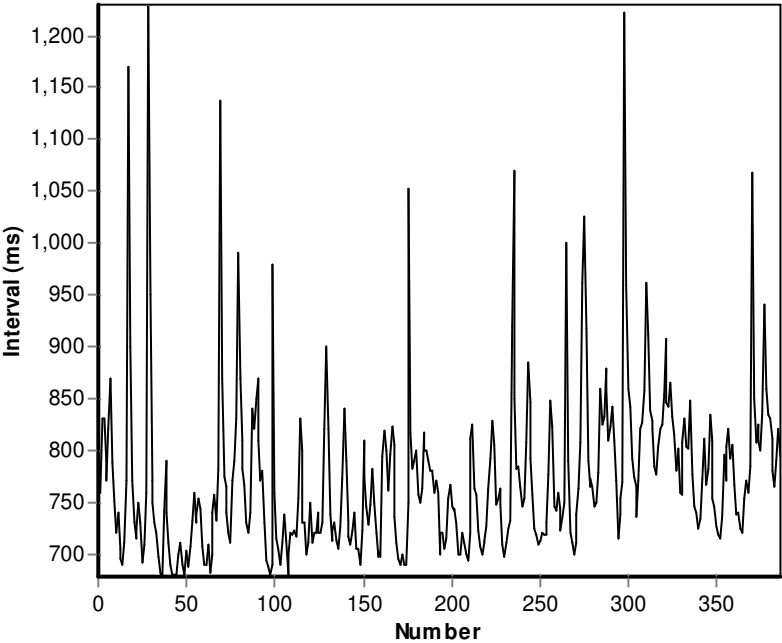



R-R Histogram

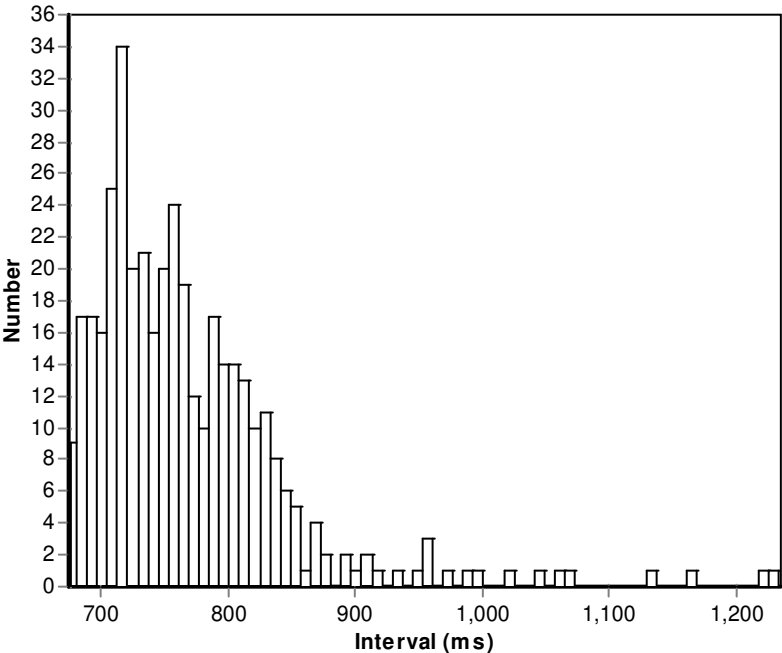

Heart Rate Variability: Time Domain Analysis

Name: 011, 011 011
Number: 011
Gender: Male


Birthdate: 18/01/1976
Recorded: 05/05/2018 12:05:08

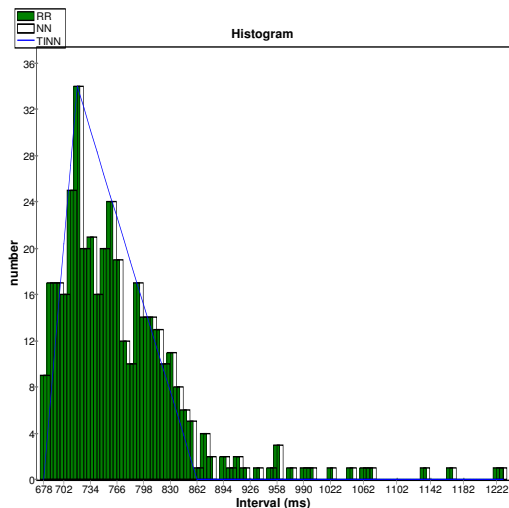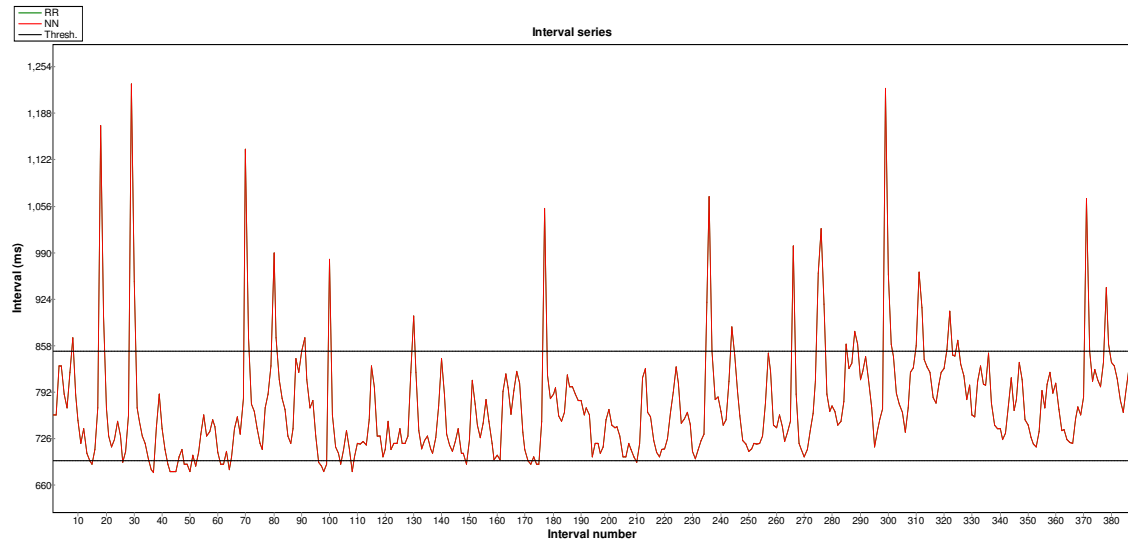

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	78	78
Triangular Interpolation (ms)	184	184
Triangular Index	11.38	11.38

Interval statistics	NN	RR
Number	387	387
Minimum (ms)	678	678
Maximum (ms)	1230	1230
Range (ms)	552	552
Avg (ms)	772	772
SD (ms)	78	78
AvgDev (ms)	54	54
p5 (ms)	690	690
p50 (ms)	757	757
p95 (ms)	912	912
Skewness	2.39	2.39
Kurtosis	11.77	11.77

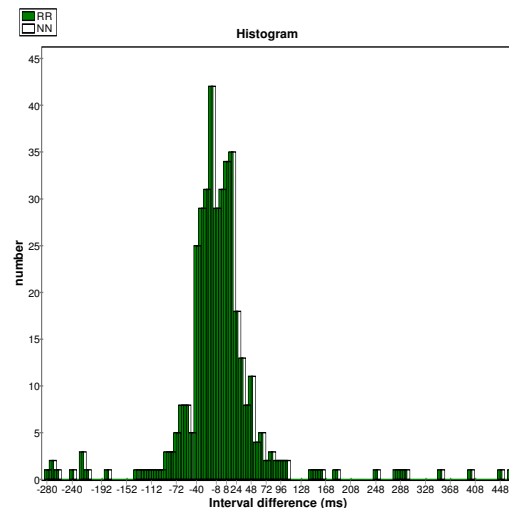



HRV parameters	NN	RR
SDSD (ms)	75	75
RMSSD (ms)	75	75
NN50	77	77
NN50(1)	38	38
NN50(2)	39	39
pNN50	0.20	0.20
pNN50(1)	0.10	0.10
pNN50(2)	0.10	0.10
Logarithmic Index	0.13	0.13
SD(Logarithmic Index)	0.01	0.01

Interval statistics	NN	RR
Number	386	386
Minimum (ms)	-280	-280
Maximum (ms)	470	470
Range (ms)	750	750
Avg (ms)	0	0
SD (ms)	75	75
AvgDev (ms)	41	41
p5 (ms)	-81	-81
p50 (ms)	-4	-4
p95 (ms)	84	84
Skewness	1.62	1.62
Kurtosis	15.82	15.82

Heart Rate Variability: Frequency Domain Analysis

Name: 011, 011 011
Number: 011
Gender: Male

Birthdate: 18/01/1976
Recorded: 05/05/2018 12:05:08

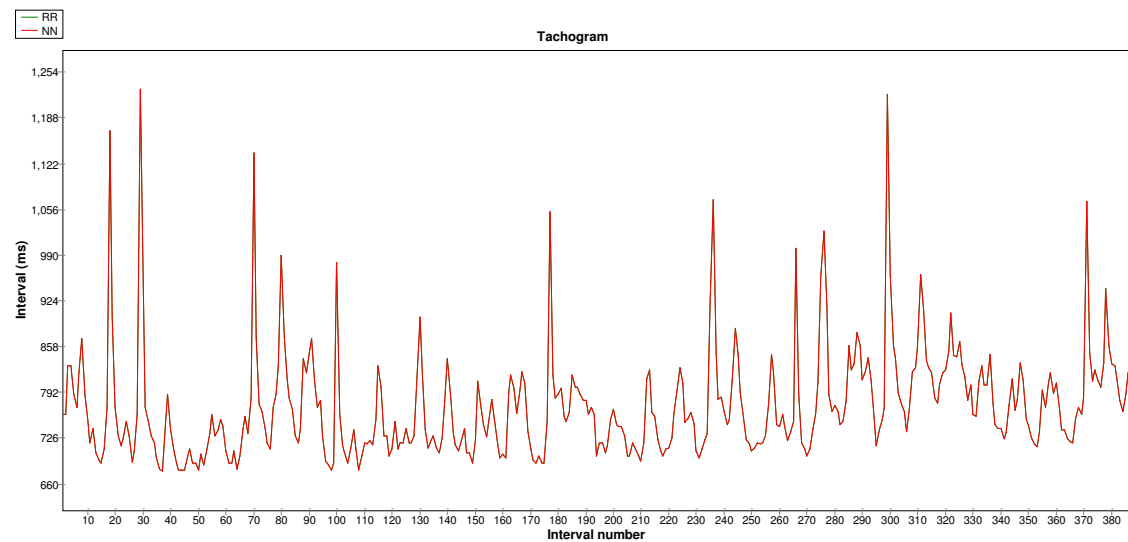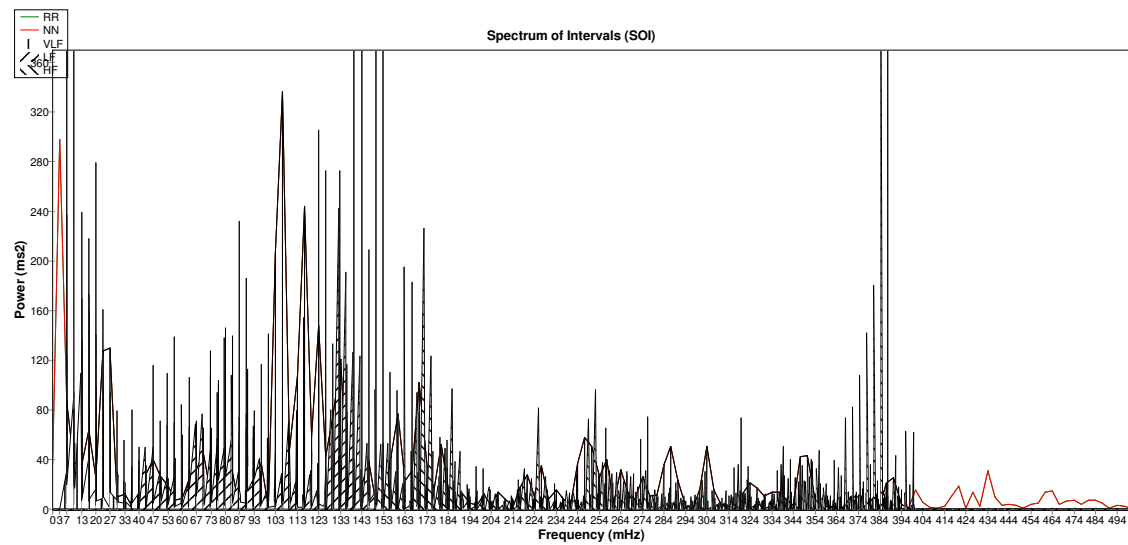

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	3787	3787	Spectrum of Intervals (SOI)	
VLF (ms2)	538	538	Frequency resolution (mHz)	3
LF (ms2)	1832	1832	VLF lower boundary (mHz)	3
HF (ms2)	1417	1417	VLF upper boundary (mHz)	40
LF/HF	1.29	1.29	LF upper boundary (mHz)	150
LF normalized	56.38	56.38	HF upper boundary (mHz)	400
HF normalized	43.62	43.62	Smoothing factor	1
VLF peak (mHz)	27	27	Tapering	Hann
LF peak (mHz)	107	107	Fourier transform	DFT
HF peak (mHz)	170	170	Sample frequency (Hz)	1.29
			Interval correction	Annotation
			Interval threshold (%)	10