


Anton Swart Biokinetic Rehabilitation Practice

Name: 011 011 011
Number: 011
Gender: Male
Birthdate: 18/01/1976 42 years

P / PQ: 110 ms / 190 ms
QRS: 85 ms
QT / QTc / QTd: 408 ms / 427 ms / -
P/QRS/T axis: 83° / 81° / 68°
Heartrate: 71 bpm

Recorded: 06/05/2018 07:38:07
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

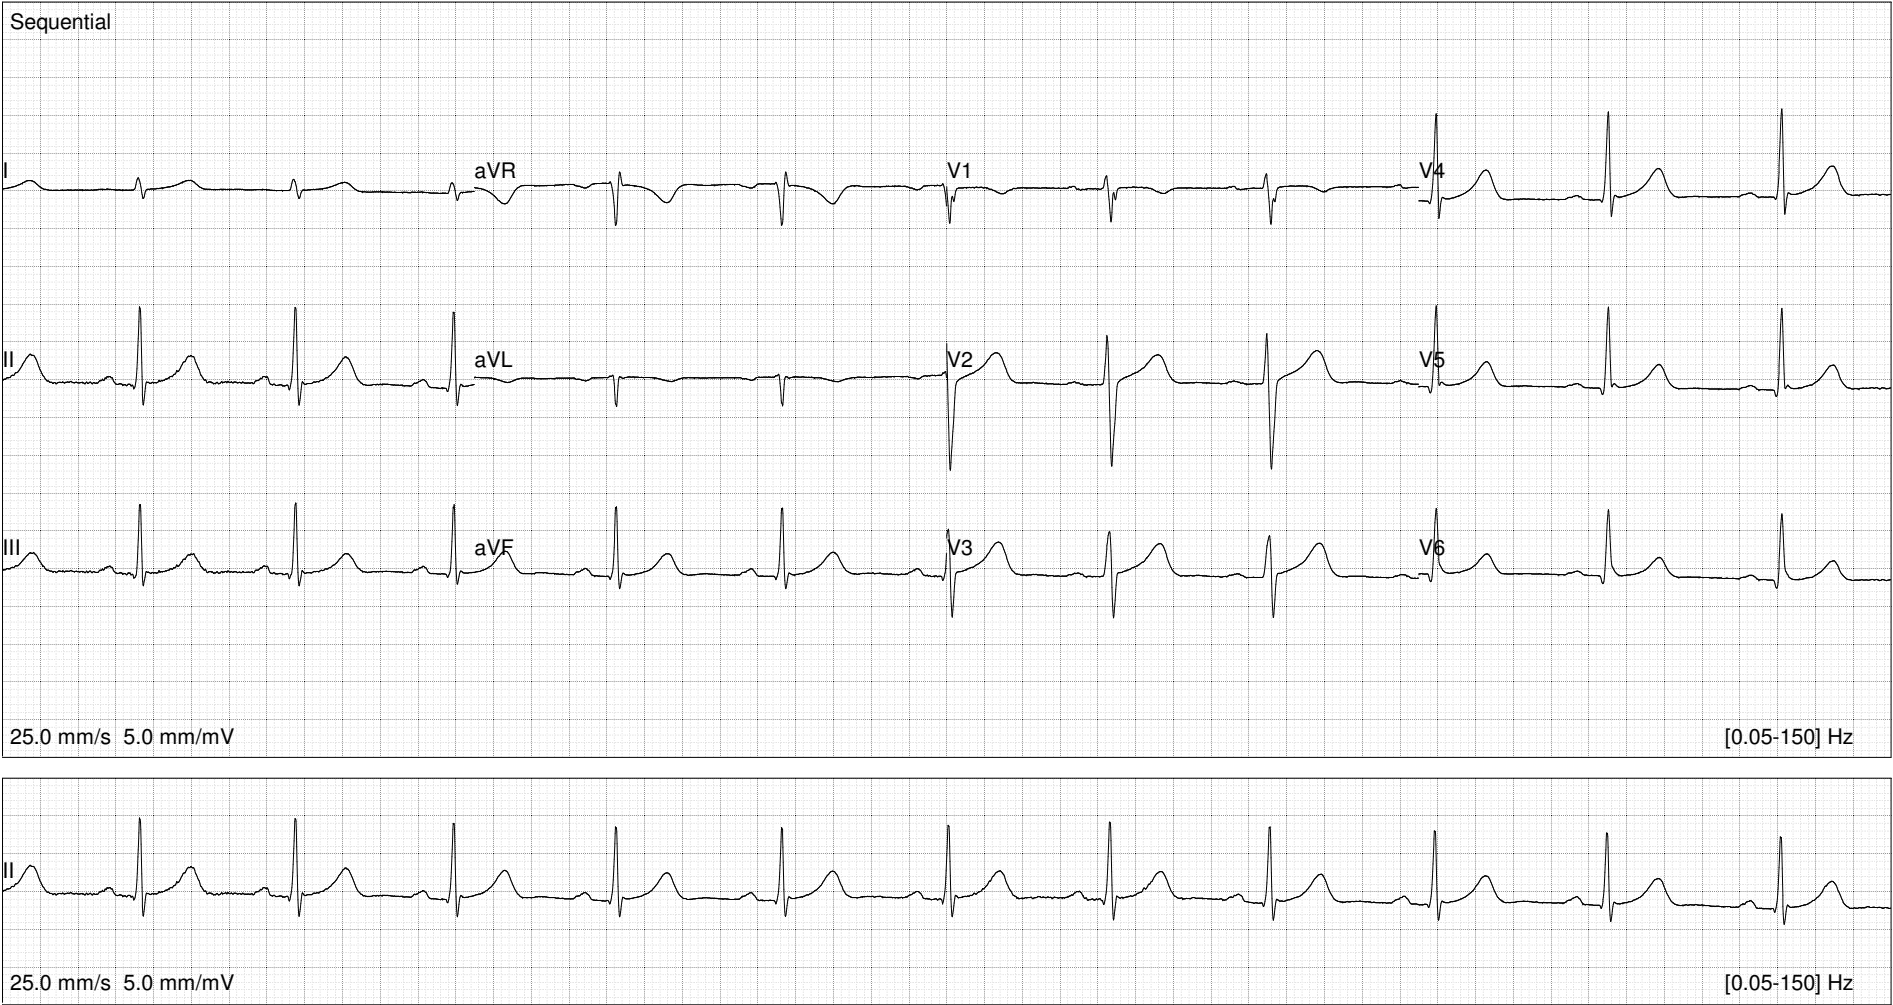

Anton Swart Biokinetic Rehabilitation Practice

Name:

011 011 011

Number:

011

Gender:

Male

Birthdate:

18/01/1976 42 years

P / PQ:

110 ms / 190 ms

QRS:

85 ms

QT / QTc / QTd:

408 ms / 427 ms / -

P/QRS/T axis:

83° / 81° / 68°

Heartrate:

71 bpm

Recorded:

06/05/2018 07:38:07

Recorded by:

Mr. Anton Swart

Referring physician:

Location:

Anton Swart Biokinetic Rehabilitation Practice



Ordering physician:

Attending physician:

Comment:



UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

Beats		RR	
Total:	353	Minimum	740 ms
Normal:	353	Maximum	950 ms
Other:	0	Mean:	847 ms
		SD:	32 ms

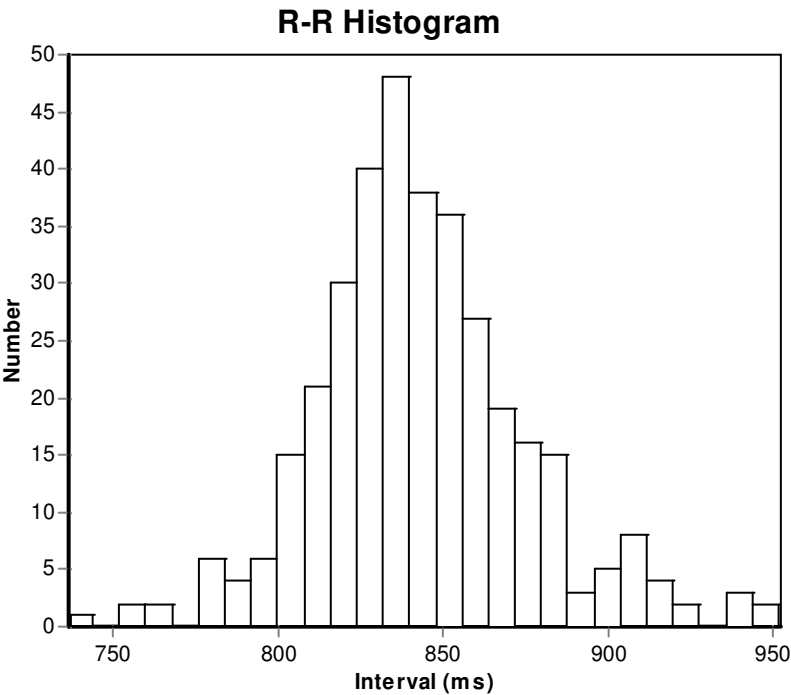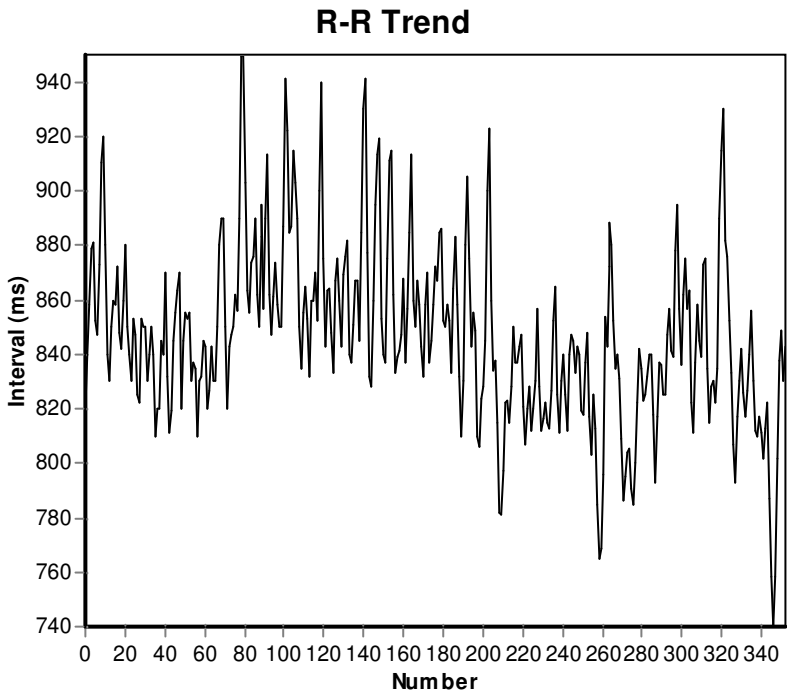

Heart Rate Variability: Time Domain Analysis


Name: 011, 011 011 Birthdate: 18/01/1976
 Number: 011 Recorded: 06/05/2018 07:38:07
 Gender: Male

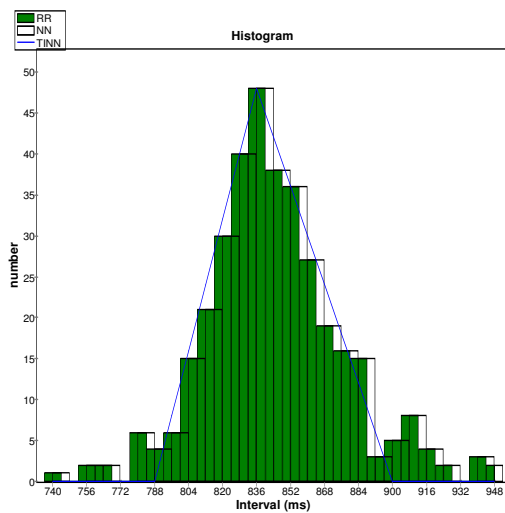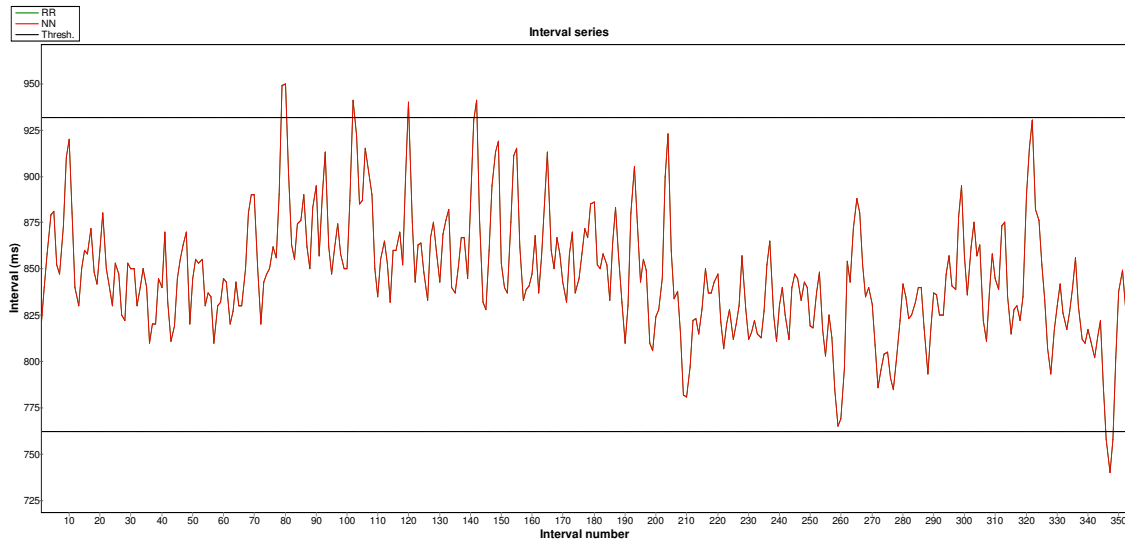

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	32	32
Triangular Interpolation (ms)	112	112
Triangular Index	7.35	7.35

Interval statistics	NN	RR
Number	353	353
Minimum (ms)	740	740
Maximum (ms)	950	950
Range (ms)	210	210
Avg (ms)	847	847
SD (ms)	32	32
AvgDev (ms)	24	24
p5 (ms)	800	800
p50 (ms)	845	845
p95 (ms)	913	913
Skewness	0.36	0.36
Kurtosis	3.98	3.98

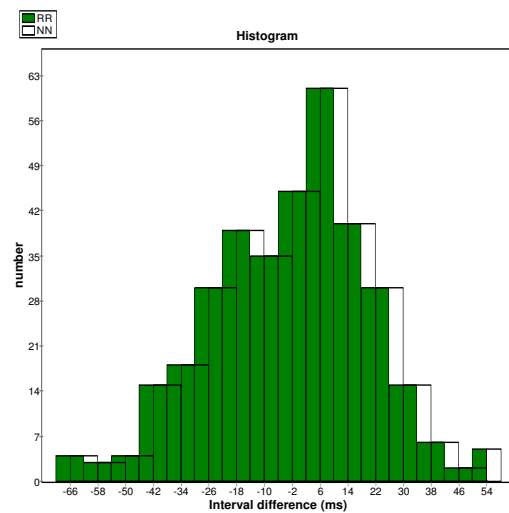



HRV parameters	NN	RR
SDSD (ms)	23	23
RMSSD (ms)	23	23
NN50	12	12
NN50(1)	7	7
NN50(2)	5	5
pNN50	0.03	0.03
pNN50(1)	0.02	0.02
pNN50(2)	0.01	0.01
Logarithmic Index	0.48	0.48
SD(Logarithmic Index)	0.05	0.05

Interval statistics	NN	RR
Number	352	352
Minimum (ms)	-66	-66
Maximum (ms)	59	59
Range (ms)	125	125
Avg (ms)	0	0
SD (ms)	23	23
AvgDev (ms)	18	18
p5 (ms)	-40	-40
p50 (ms)	2	2
p95 (ms)	36	36
Skewness	-0.23	-0.23
Kurtosis	2.99	2.99

Heart Rate Variability: Frequency Domain Analysis

Name: 011, 011 011
Number: 011
Gender: Male

Birthdate: 18/01/1976
Recorded: 06/05/2018 07:38:07

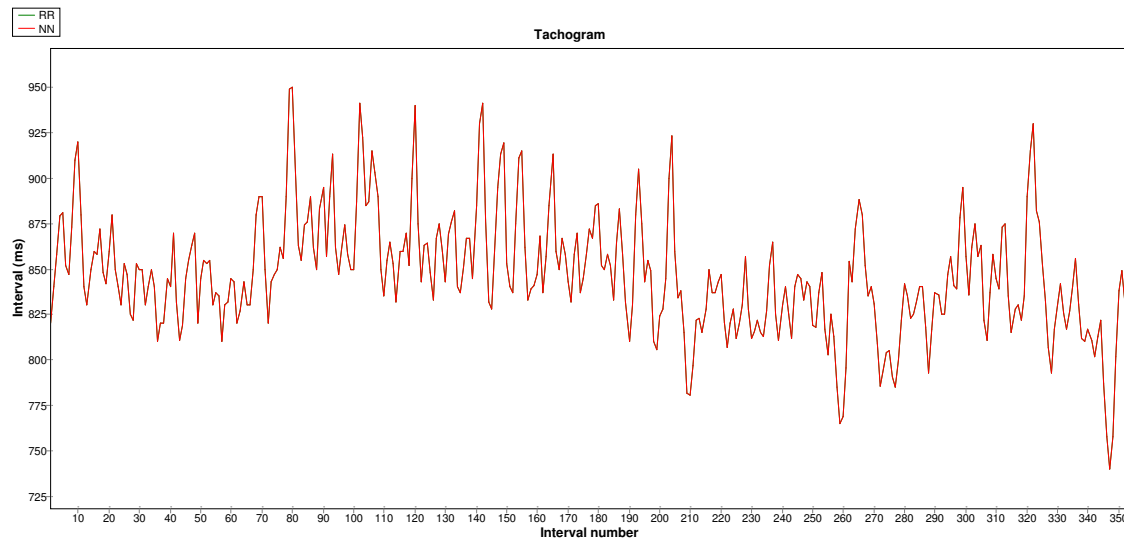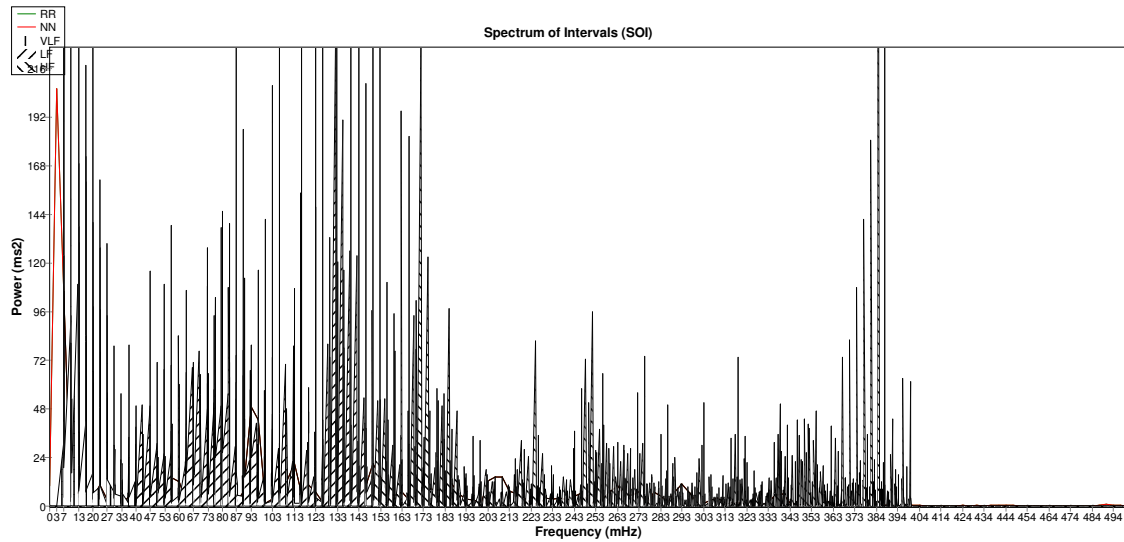

HRV parameters

	NN	RR
TP (ms2)	804	804
VLF (ms2)	154	154
LF (ms2)	337	337
HF (ms2)	314	314
LF/HF	1.07	1.07
LF normalized	51.79	51.79
HF normalized	48.21	48.21
VLF peak (mHz)	7	7
LF peak (mHz)	93	93
HF peak (mHz)	207	207

HRV spectral settings

Spectrum of Intervals (SOI)	
Frequency resolution (mHz)	3
VLF lower boundary (mHz)	3
VLF upper boundary (mHz)	40
LF upper boundary (mHz)	150
HF upper boundary (mHz)	400
Smoothing factor	1
Tapering	Hann
Fourier transform	DFT
Sample frequency (Hz)	1.18
Interval correction	Annotation
Interval threshold (%)	10