


Anton Swart Biokinetic Rehabilitation Practice

Name: 013 013
Number: 013
Gender: Male
Birthdate: 04/02/1971 47 years

P / PQ: 127 ms / 192 ms
QRS: 98 ms
QT / QTc / QTd: 391 ms / 412 ms / -
P/QRS/T axis: 65° / 95° / 62°
Heartrate: 72 bpm

Recorded: 01/05/2018 16:17:53
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

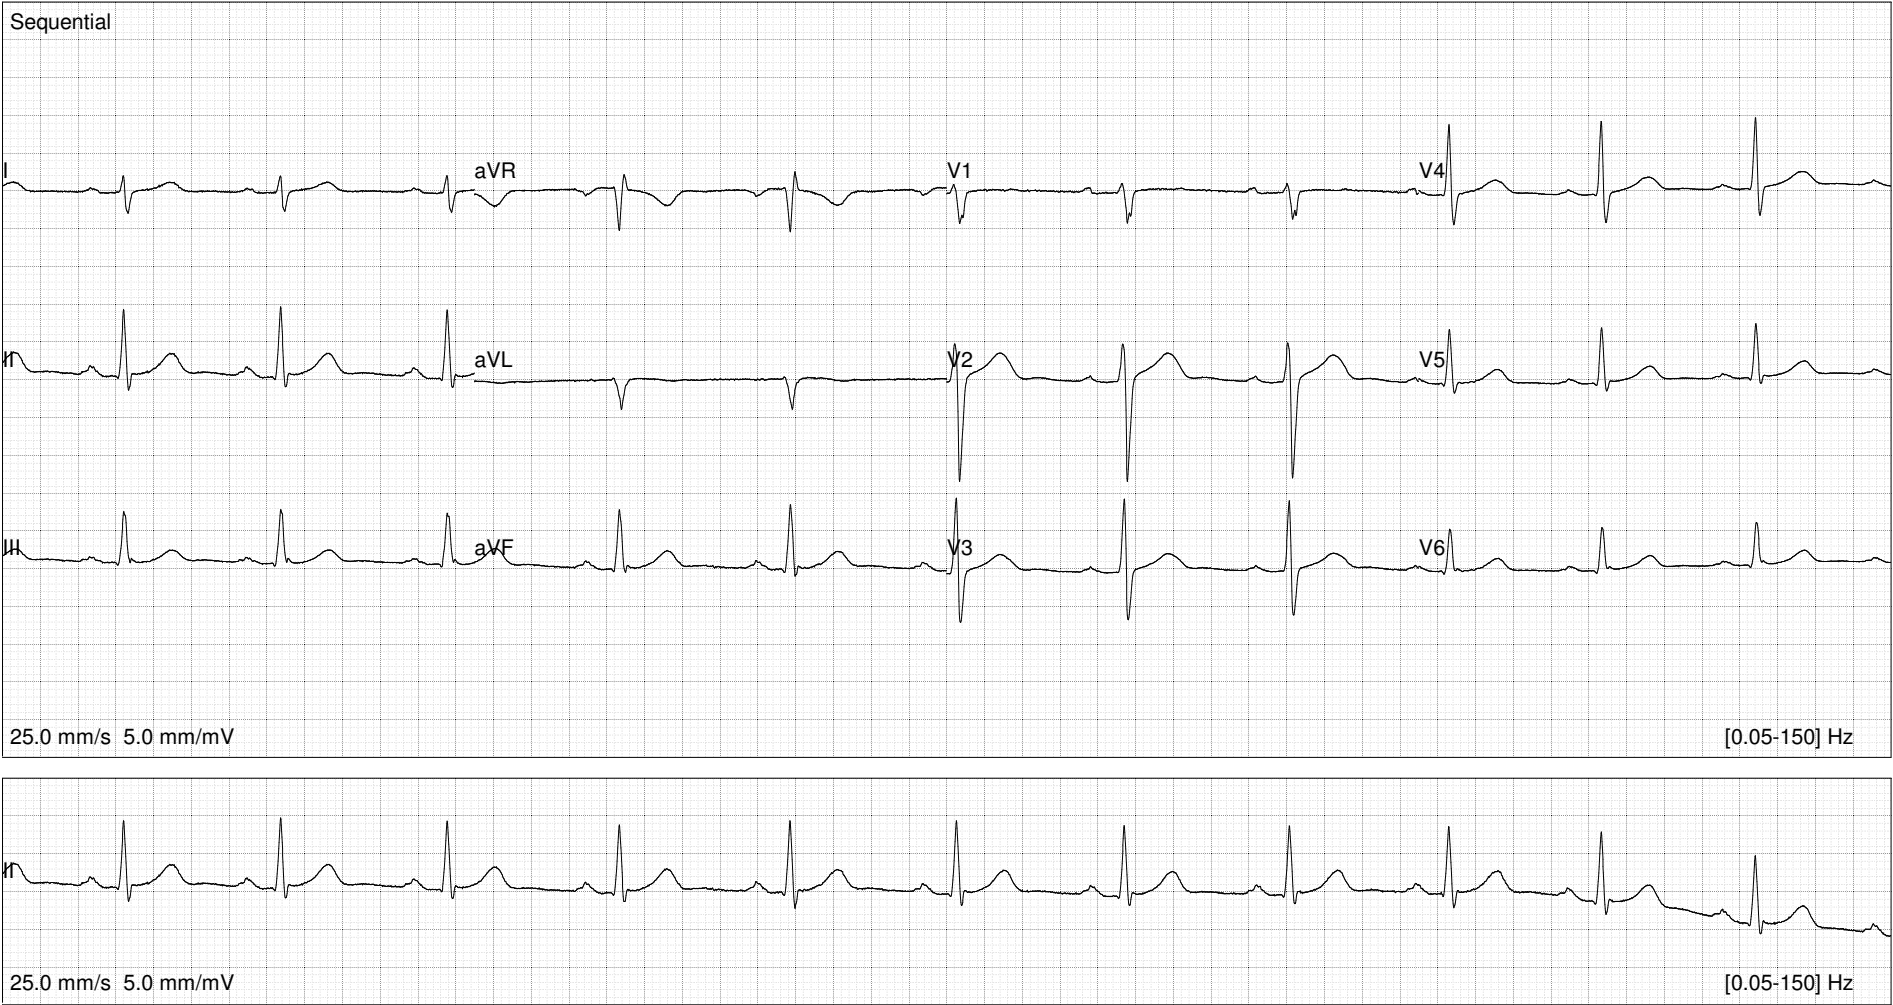

Anton Swart Biokinetic Rehabilitation Practice

Name: 013 013
Number: 013
Gender: Male
Birthdate: 04/02/1971 47 years


P / PQ: 127 ms / 192 ms
QRS: 98 ms
QT / QTc / QTd: 391 ms / 412 ms / -
P/QRS/T axis: 65° / 95° / 62°
Heartrate: 72 bpm

Recorded: 01/05/2018 16:17:53
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:


UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

Beats		RR	
Total:	357	Minimum	720 ms
Normal:	357	Maximum	932 ms
Other:	0	Mean:	837 ms
		SD:	31 ms

R-R Trend

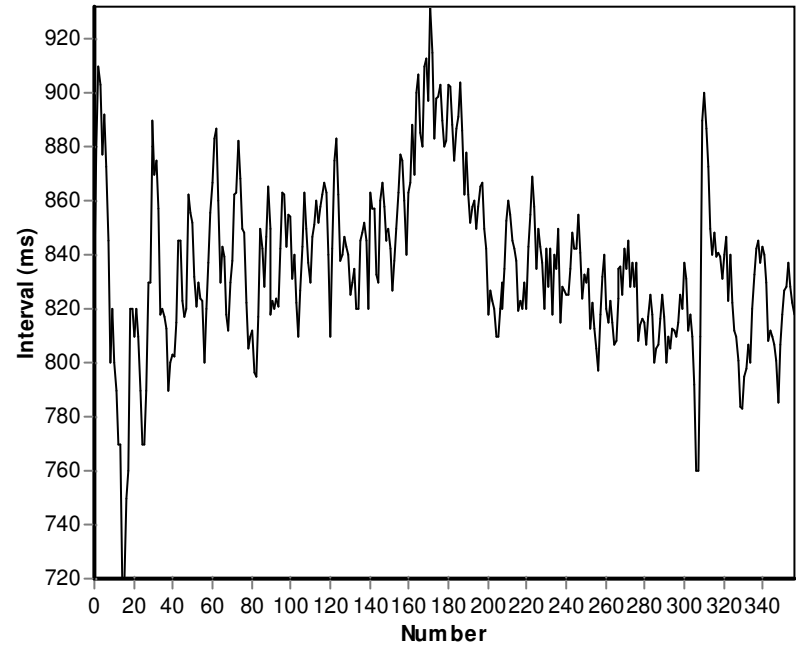



R-R Histogram

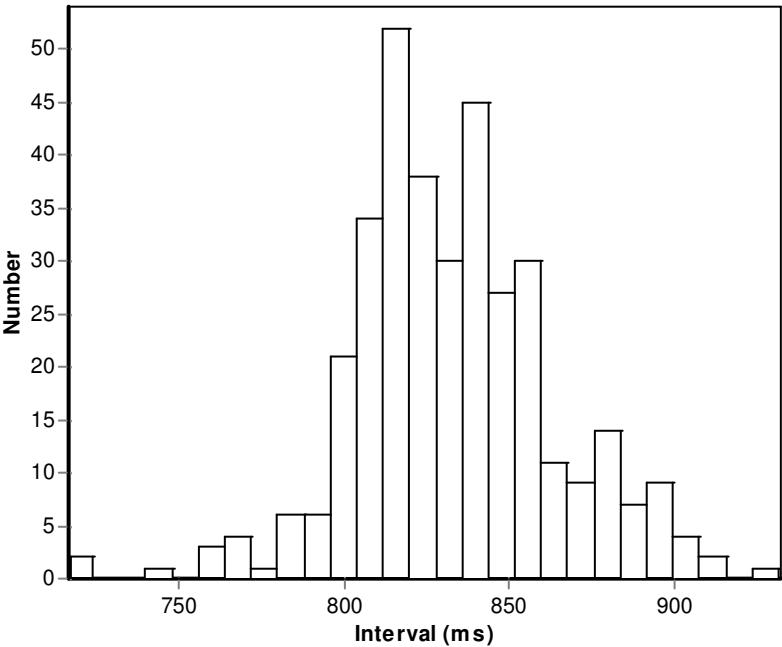

Heart Rate Variability: Time Domain Analysis

Name: 013, 013
Number: 013
Gender: Male


Birthdate: 04/02/1971
Recorded: 01/05/2018 16:17:53

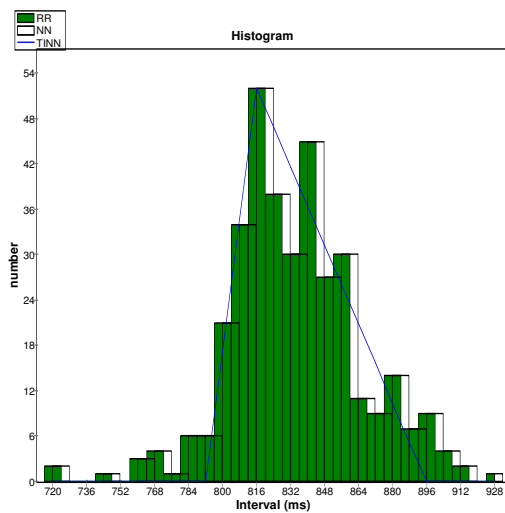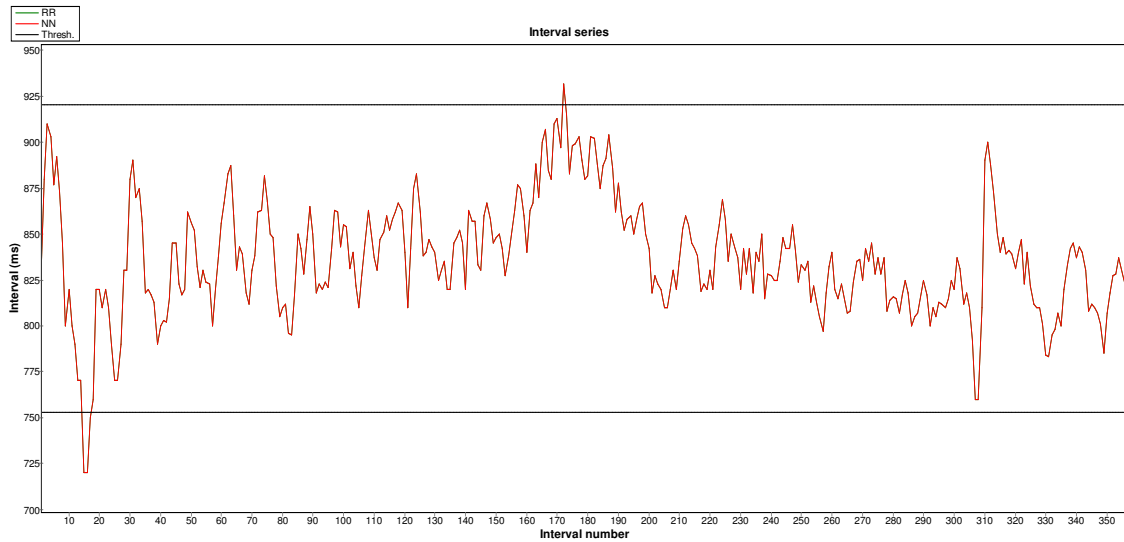

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	31	31
Triangular Interpolation (ms)	104	104
Triangular Index	6.87	6.87

Interval statistics	NN	RR
Number	357	357
Minimum (ms)	720	720
Maximum (ms)	932	932
Range (ms)	212	212
Avg (ms)	837	837
SD (ms)	31	31
AvgDev (ms)	24	24
p5 (ms)	792	792
p50 (ms)	835	835
p95 (ms)	892	892
Skewness	0.02	0.02
Kurtosis	4.04	4.04

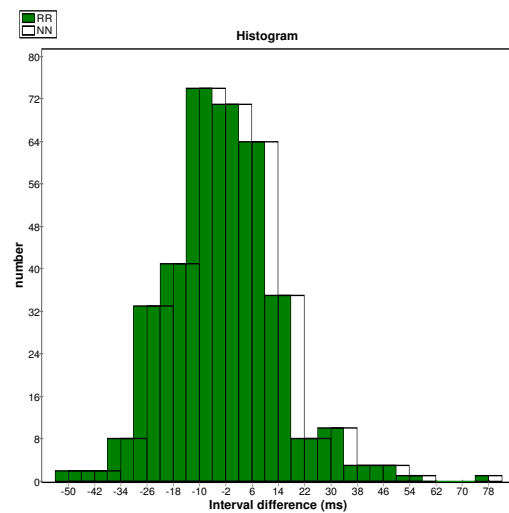



HRV parameters	NN	RR
SDSD (ms)	17	17
RMSSD (ms)	17	17
NN50	2	2
NN50(1)	0	0
NN50(2)	2	2
pNN50	0.01	0.01
pNN50(1)	0.00	0.00
pNN50(2)	0.01	0.01
Logarithmic Index	0.69	0.69
SD(Logarithmic Index)	0.05	0.05

Interval statistics	NN	RR
Number	356	356
Minimum (ms)	-50	-50
Maximum (ms)	80	80
Range (ms)	130	130
Avg (ms)	-0	-0
SD (ms)	17	17
AvgDev (ms)	13	13
p5 (ms)	-24	-24
p50 (ms)	0	0
p95 (ms)	30	30
Skewness	0.56	0.56
Kurtosis	4.77	4.77

Heart Rate Variability: Frequency Domain Analysis

Name: 013, 013
Number: 013
Gender: Male

Birthdate: 04/02/1971
Recorded: 01/05/2018 16:17:53

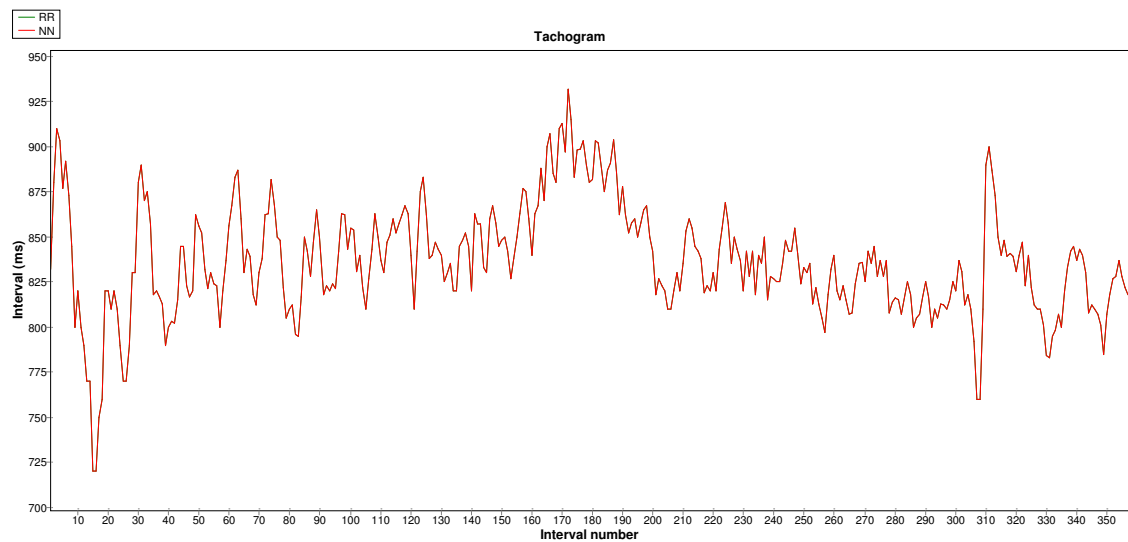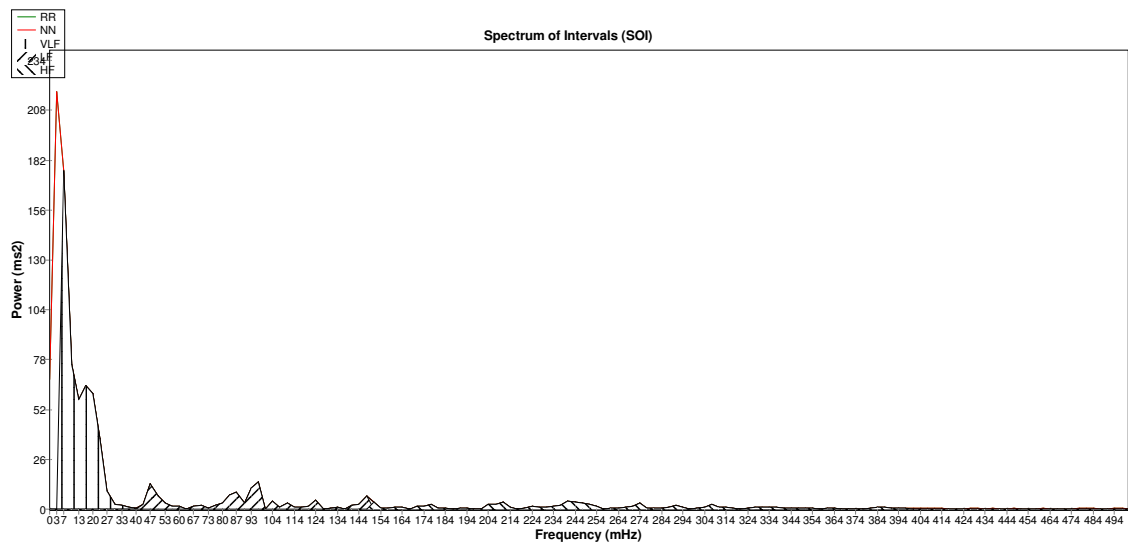

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	683	683	Spectrum of Intervals (SOI)	
VLF (ms2)	487	487	Frequency resolution (mHz)	3
LF (ms2)	115	115	VLF lower boundary (mHz)	3
HF (ms2)	82	82	VLF upper boundary (mHz)	40
LF/HF	1.40	1.40	LF upper boundary (mHz)	150
LF normalized	58.35	58.35	HF upper boundary (mHz)	400
HF normalized	41.65	41.65	Smoothing factor	1
VLF peak (mHz)	7	7	Tapering	Hann
LF peak (mHz)	97	97	Fourier transform	DFT
HF peak (mHz)	240	240	Sample frequency (Hz)	1.20
			Interval correction	Annotation
			Interval threshold (%)	10