


Anton Swart Biokinetic Rehabilitation Practice

Name: 013 013
Number: 013
Gender: Male
Birthdate: 04/02/1971 47 years

P / PQ: 122 ms / 182 ms
QRS: 96 ms
QT / QTc / QTd: 366 ms / 432 ms / -
P/QRS/T axis: 74° / 92° / 66°
Heartrate: 98 bpm

Recorded: 05/05/2018 12:47:21
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

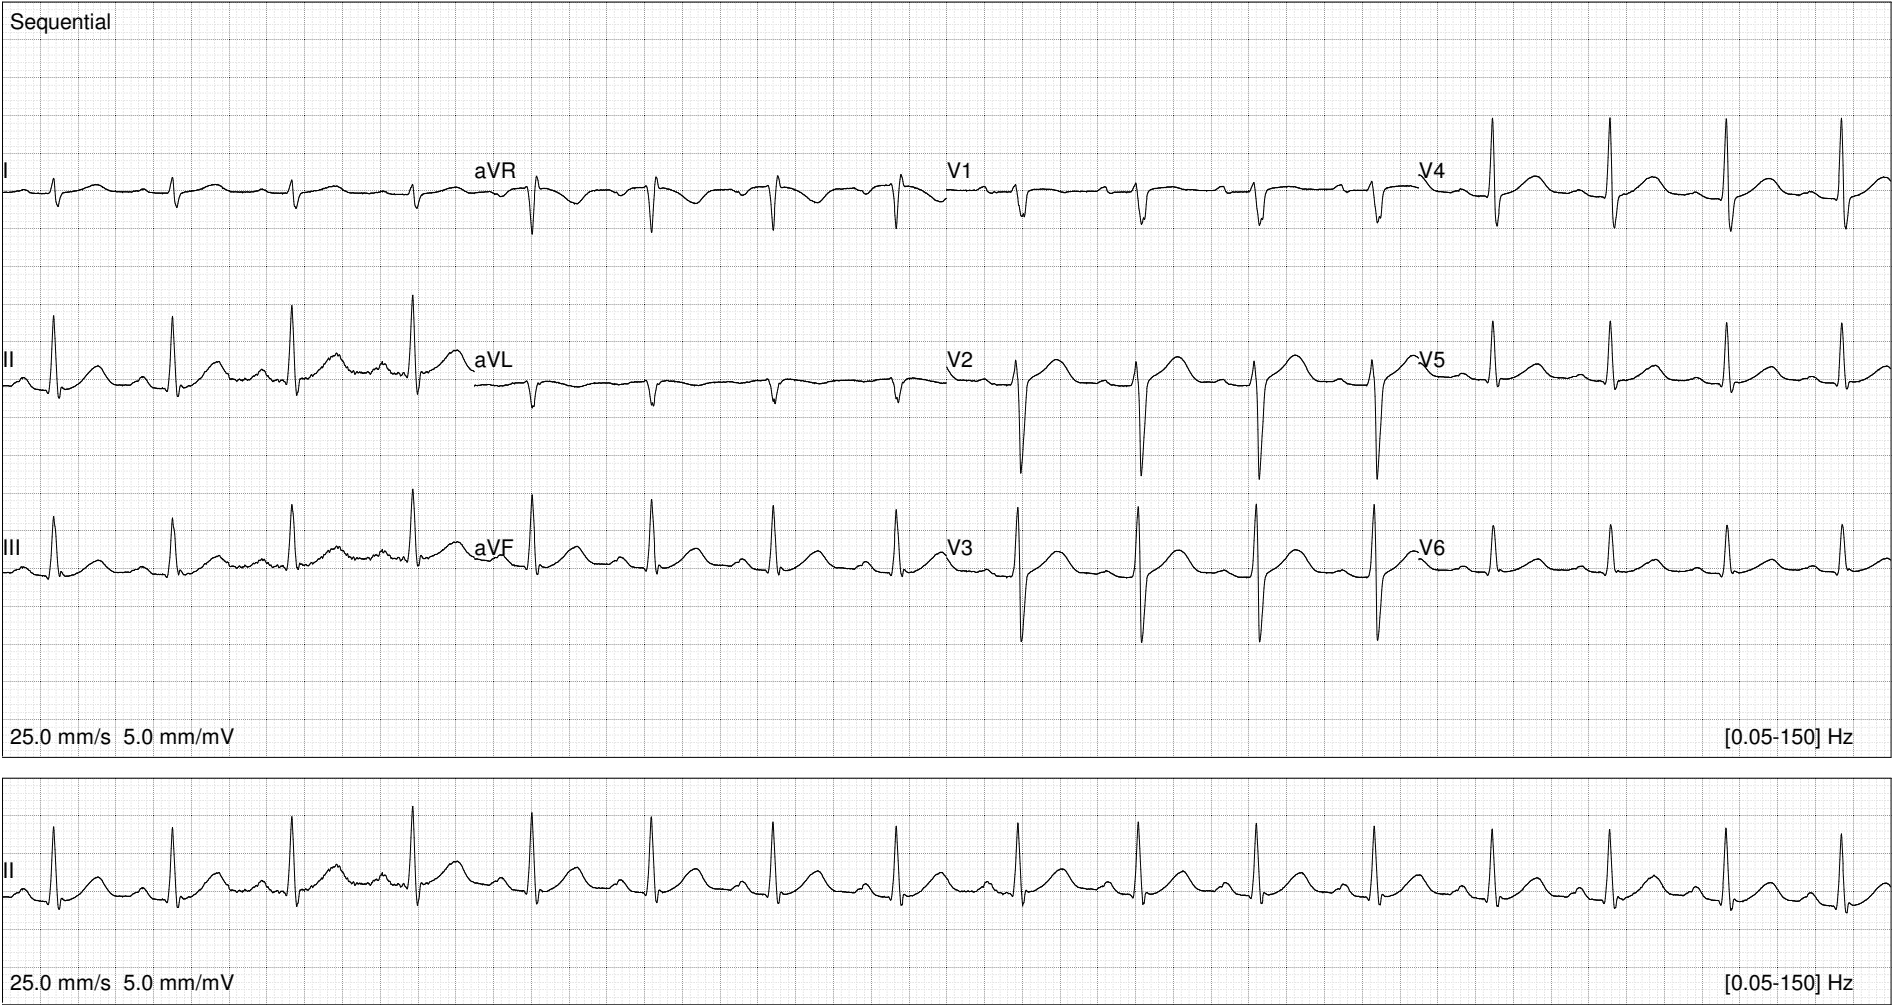

Anton Swart Biokinetic Rehabilitation Practice

Name:

013 013

Number:

013

Gender:

Male

Birthdate:

04/02/1971 47 years

P / PQ:

122 ms / 182 ms

QRS:

96 ms

QT / QTc / QTd:

366 ms / 432 ms / -

P/QRS/T axis:

74° / 92° / 66°

Heartrate:

98 bpm

Recorded:

05/05/2018 12:47:21

Recorded by:

Mr. Anton Swart

Referring physician:

Location:

Anton Swart Biokinetic Rehabilitation Practice



Ordering physician:

Attending physician:

Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW




Beats		RR	
Total:	489	Minimum	580 ms
Normal:	489	Maximum	650 ms
Other:	0	Mean:	612 ms
		SD:	11 ms

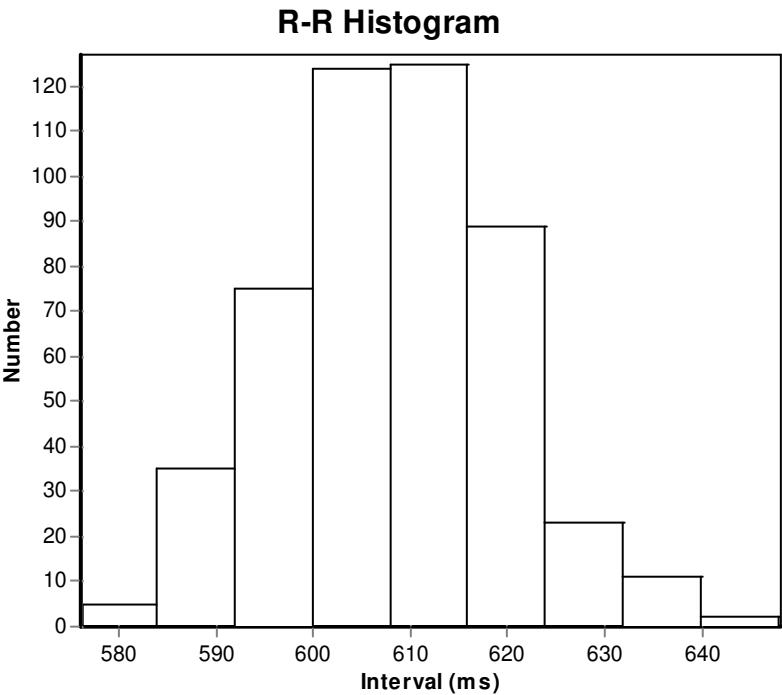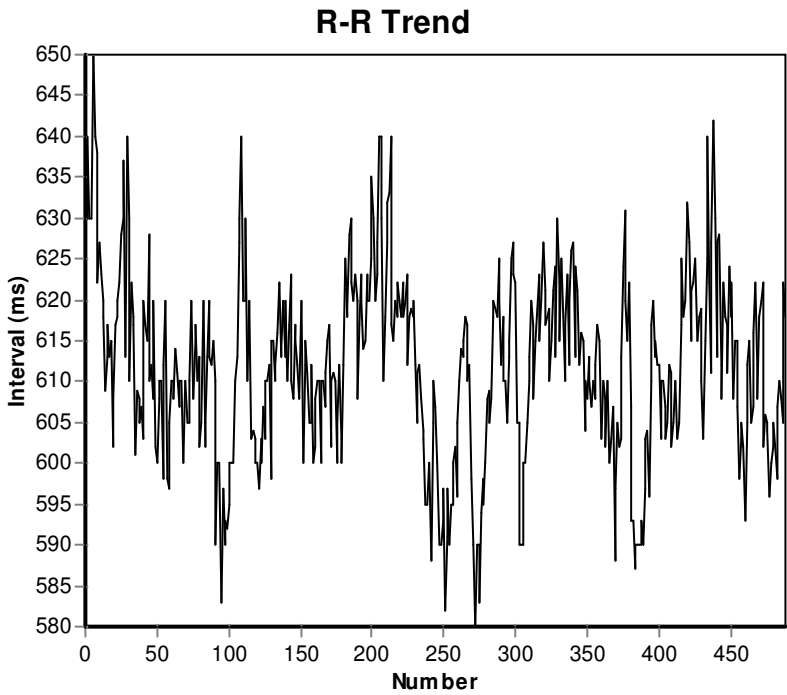

Heart Rate Variability: Time Domain Analysis

Name: 013, 013
Number: 013
Gender: Male

Birthdate: 04/02/1971
Recorded: 05/05/2018 12:47:21

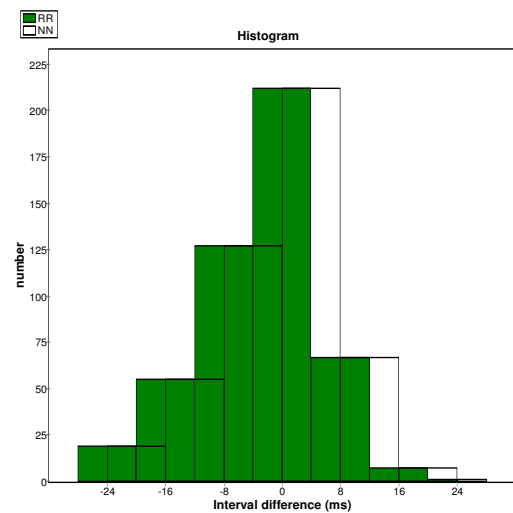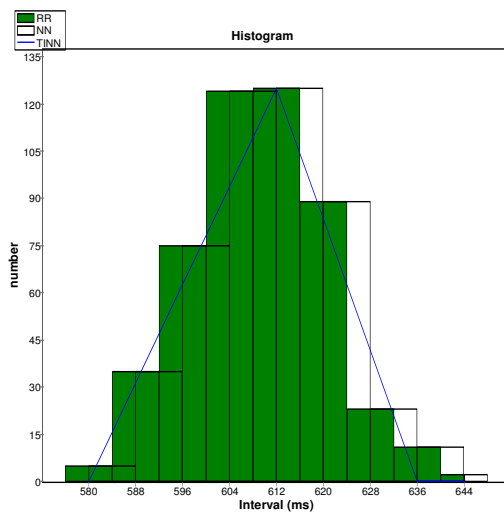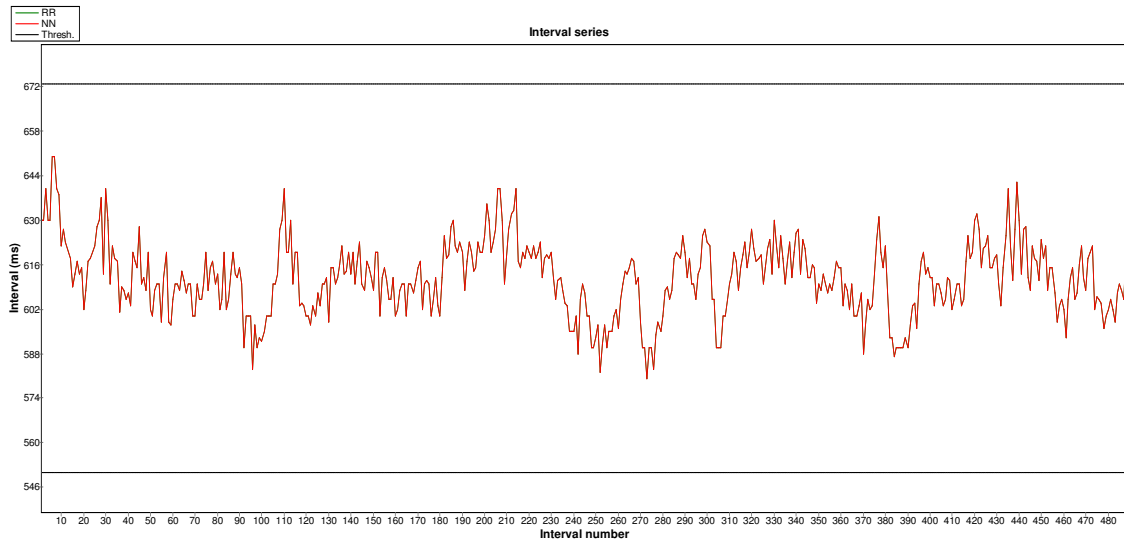

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	11	11
Triangular Interpolation (ms)	56	56
Triangular Index	3.91	3.91



HRV parameters	NN	RR
SDSD (ms)	8	8
RMSSD (ms)	8	8
NN50	0	0
NN50(1)	0	0
NN50(2)	0	0
pNN50	0.00	0.00
pNN50(1)	0.00	0.00
pNN50(2)	0.00	0.00
Logarithmic Index	1.68	1.68
SD(Logarithmic Index)	0.27	0.27

Interval statistics	NN	RR
Number	489	489
Minimum (ms)	580	580
Maximum (ms)	650	650
Range (ms)	70	70
Avg (ms)	612	612
SD (ms)	11	11
AvgDev (ms)	9	9
p5 (ms)	591	591
p50 (ms)	612	612
p95 (ms)	630	630
Skewness	0.11	0.11
Kurtosis	3.33	3.33

Interval statistics	NN	RR
Number	488	488
Minimum (ms)	-24	-24
Maximum (ms)	27	27
Range (ms)	51	51
Avg (ms)	-0	-0
SD (ms)	8	8
AvgDev (ms)	6	6
p5 (ms)	-15	-15
p50 (ms)	0	0
p95 (ms)	12	12
Skewness	-0.35	-0.35
Kurtosis	3.26	3.26

Heart Rate Variability: Frequency Domain Analysis

Name: 013, 013 Birthdate: 04/02/1971
 Number: 013 Recorded: 05/05/2018 12:47:21
 Gender: Male

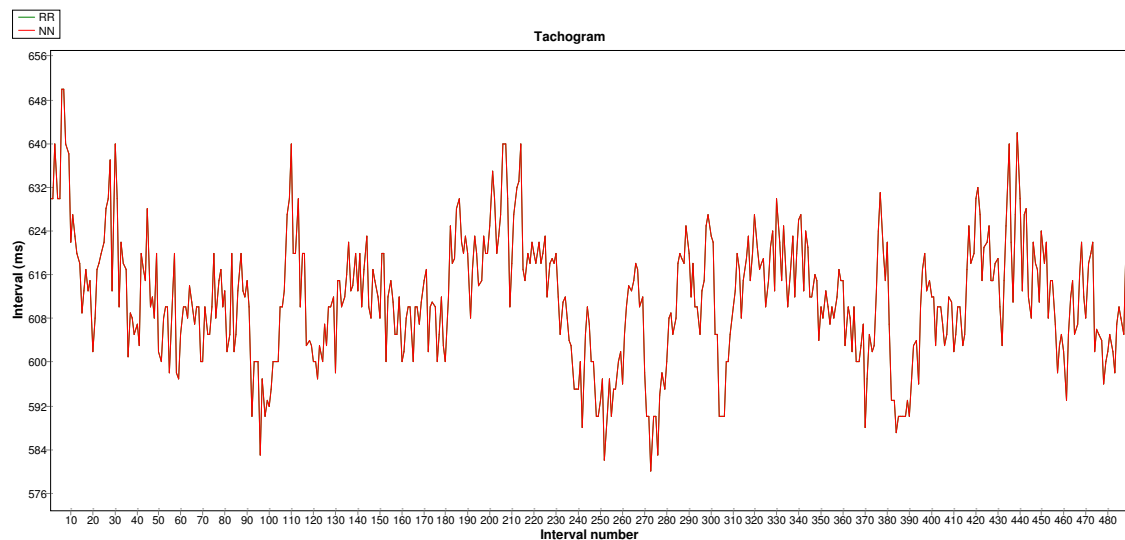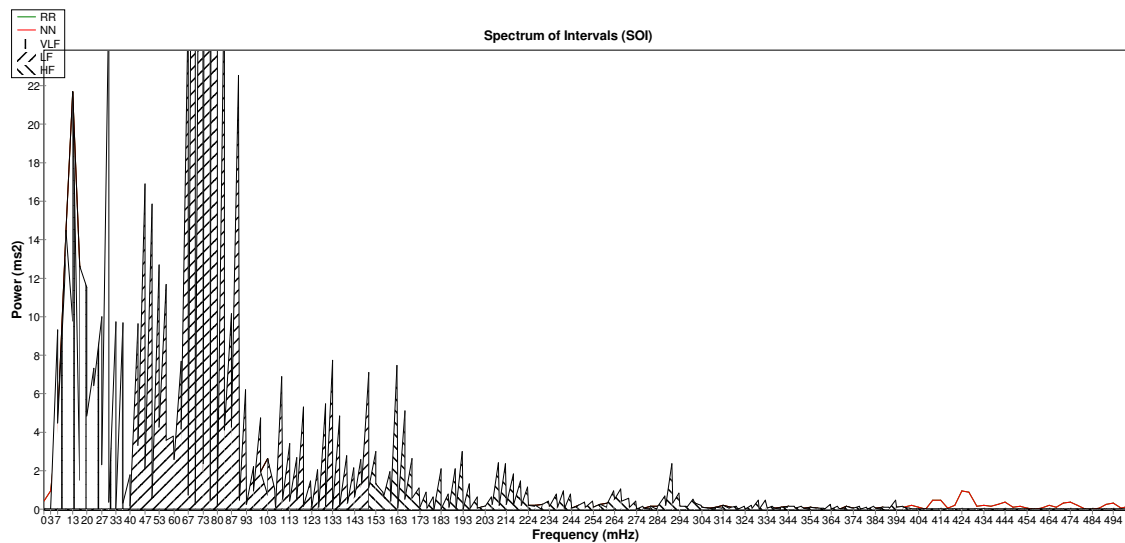

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	125	125	Spectrum of Intervals (SOI)	
VLF (ms2)	68	68	Frequency resolution (mHz)	3
LF (ms2)	44	44	VLF lower boundary (mHz)	3
HF (ms2)	13	13	VLF upper boundary (mHz)	40
LF/HF	3.31	3.31	LF upper boundary (mHz)	150
LF normalized	76.80	76.80	HF upper boundary (mHz)	400
HF normalized	23.20	23.20	Smoothing factor	1
VLF peak (mHz)	13	13	Tapering	Hann
LF peak (mHz)	87	87	Fourier transform	DFT
HF peak (mHz)	153	153	Sample frequency (Hz)	1.63
			Interval correction	Annotation
			Interval threshold (%)	10