


Anton Swart Biokinetic Rehabilitation Practice

Name: 013 013
Number: 013
Gender: Male
Birthdate: 04/02/1971 47 years

Recorded: 06/05/2018 07:01:04
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

P / PQ: 127 ms / 203 ms
QRS: 97 ms
QT / QTc / QTd: 427 ms / 438 ms / -
P/QRS/T axis: 69° / 96° / 71°
Heartrate: 66 bpm

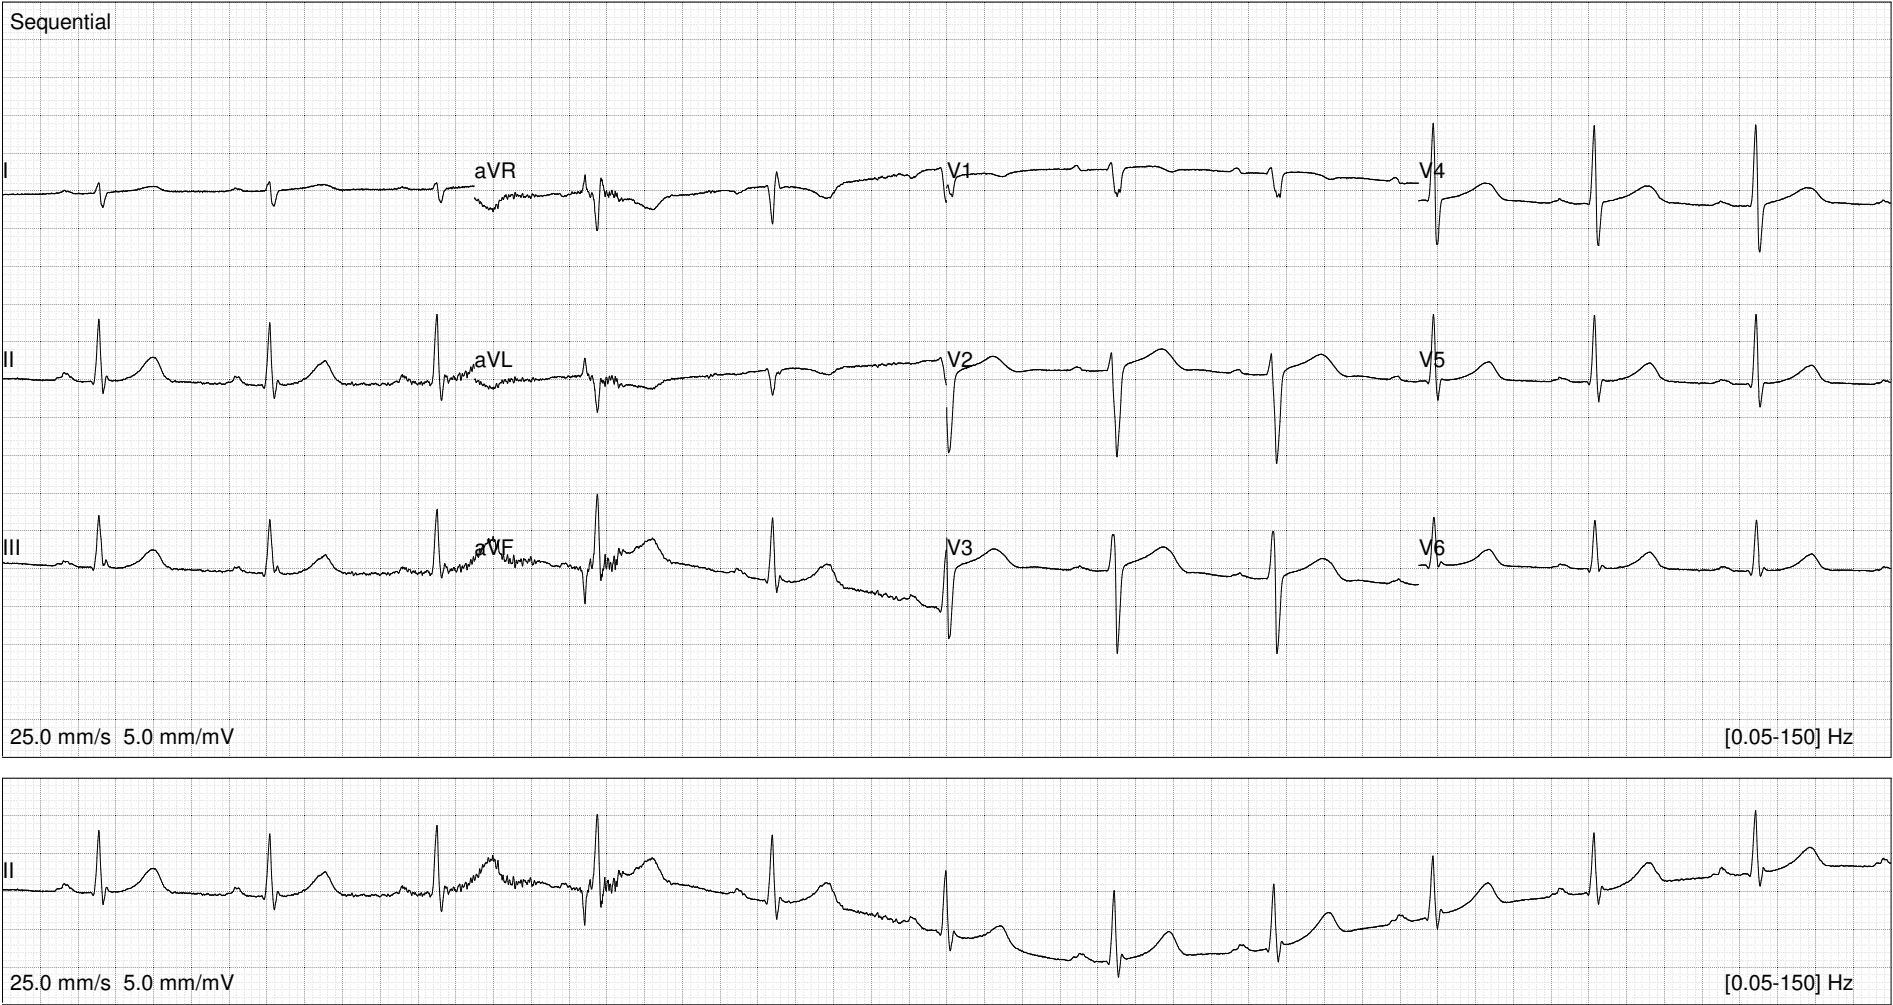



Anton Swart Biokinetic Rehabilitation Practice

Name: 013 013
Number: 013
Gender: Male
Birthdate: 04/02/1971 47 years
P / PQ: 127 ms / 203 ms
QRS: 97 ms
QT / QTc / QTd: 427 ms / 438 ms / -
P/QRS/T axis: 69° / 96° / 71°
Heartrate: 66 bpm

Recorded: 06/05/2018 07:01:04
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:




UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

Beats		RR	
Total:	332	Minimum	340 ms
Normal:	332	Maximum	985 ms
Other:	0	Mean:	901 ms
		SD:	55 ms

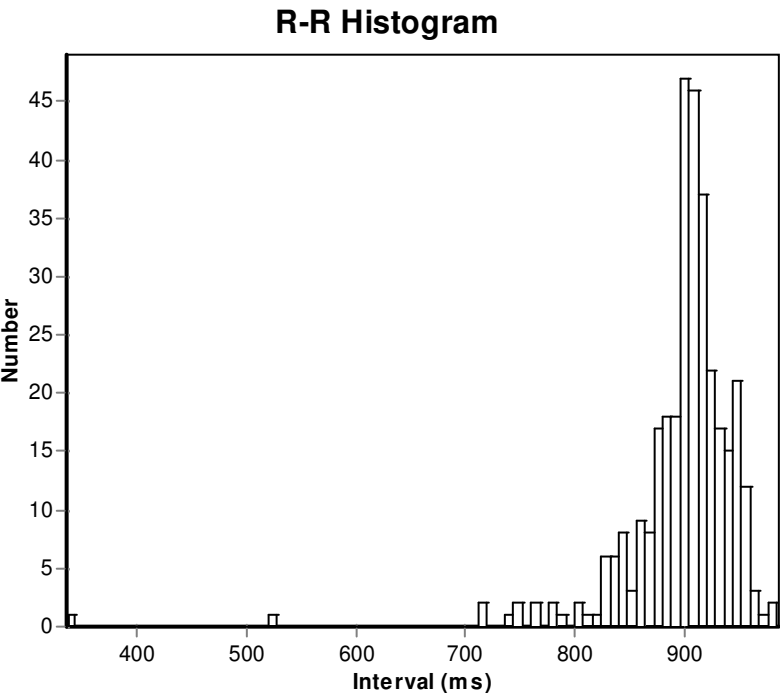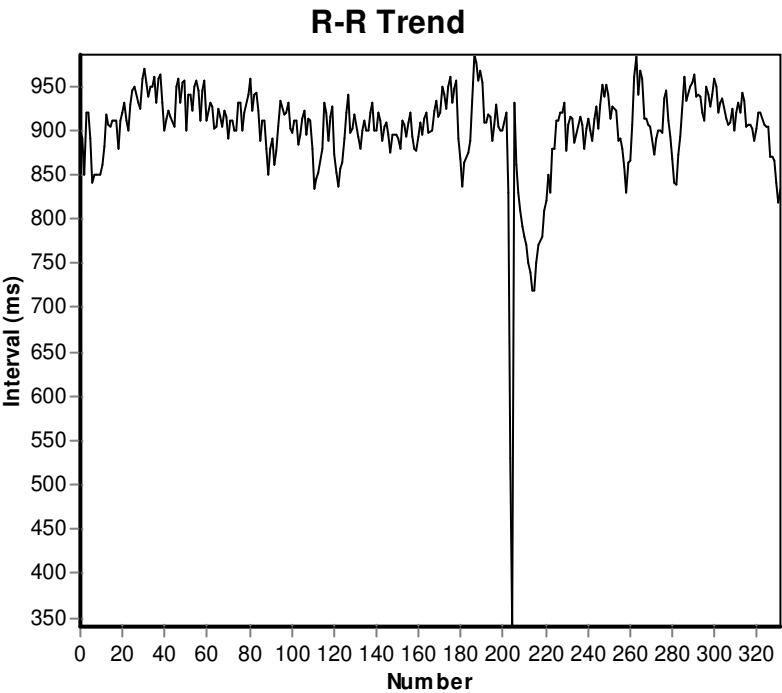

Heart Rate Variability: Time Domain Analysis

Name: 013, 013 Birthdate: 04/02/1971
 Number: 013 Recorded: 06/05/2018 07:01:04
 Gender: Male

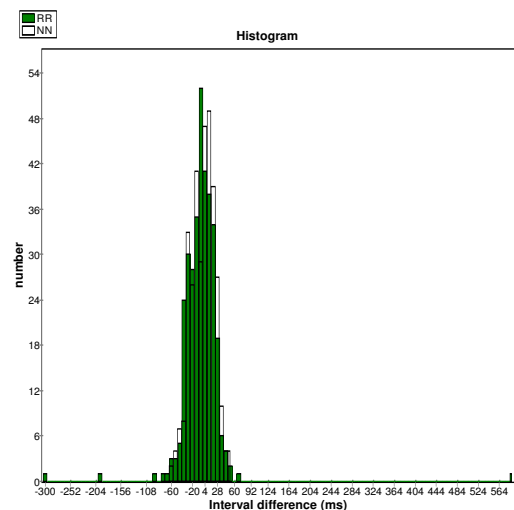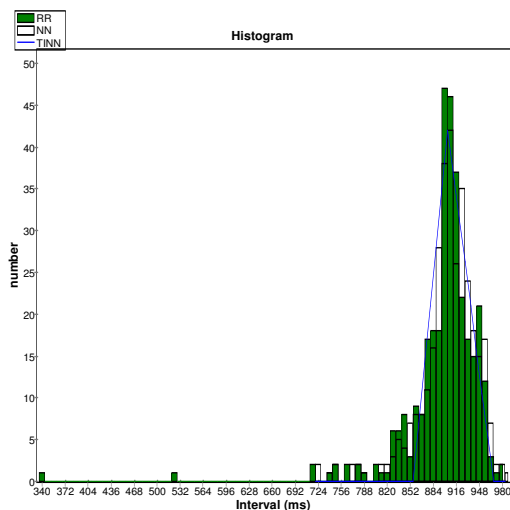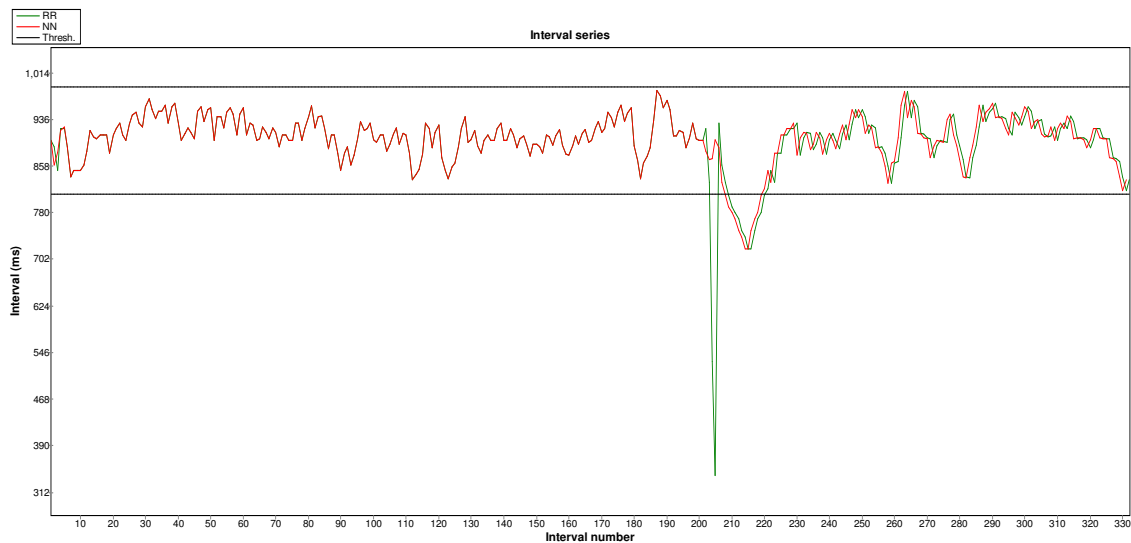

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	41	55
Triangular Interpolation (ms)	112	104
Triangular Index	7.88	7.06

HRV parameters	NN	RR
SDSD (ms)	22	44
RMSSD (ms)	22	44
NN50	8	13
NN50(1)	5	8
NN50(2)	3	5
pNN50	0.02	0.04
pNN50(1)	0.02	0.02
pNN50(2)	0.01	0.02
Logarithmic Index	0.61	0.50
SD(Logarithmic Index)	0.08	0.04



Interval statistics	NN	RR
Number	331	332
Minimum (ms)	720	340
Maximum (ms)	985	985
Range (ms)	265	645
Avg (ms)	904	901
SD (ms)	41	55
AvgDev (ms)	29	32
p5 (ms)	830	825
p50 (ms)	910	910
p95 (ms)	957	957
Skewness	-1.52	-4.59
Kurtosis	6.91	39.90

Interval statistics	NN	RR
Number	330	331
Minimum (ms)	-64	-300
Maximum (ms)	55	590
Range (ms)	119	890
Avg (ms)	-0	-0
SD (ms)	22	44
AvgDev (ms)	18	21
p5 (ms)	-35	-36
p50 (ms)	0	0
p95 (ms)	34	34
Skewness	-0.18	5.99
Kurtosis	2.70	104.12

Heart Rate Variability: Frequency Domain Analysis

Name: 013, 013
Number: 013
Gender: Male

Birthdate: 04/02/1971
Recorded: 06/05/2018 07:01:04

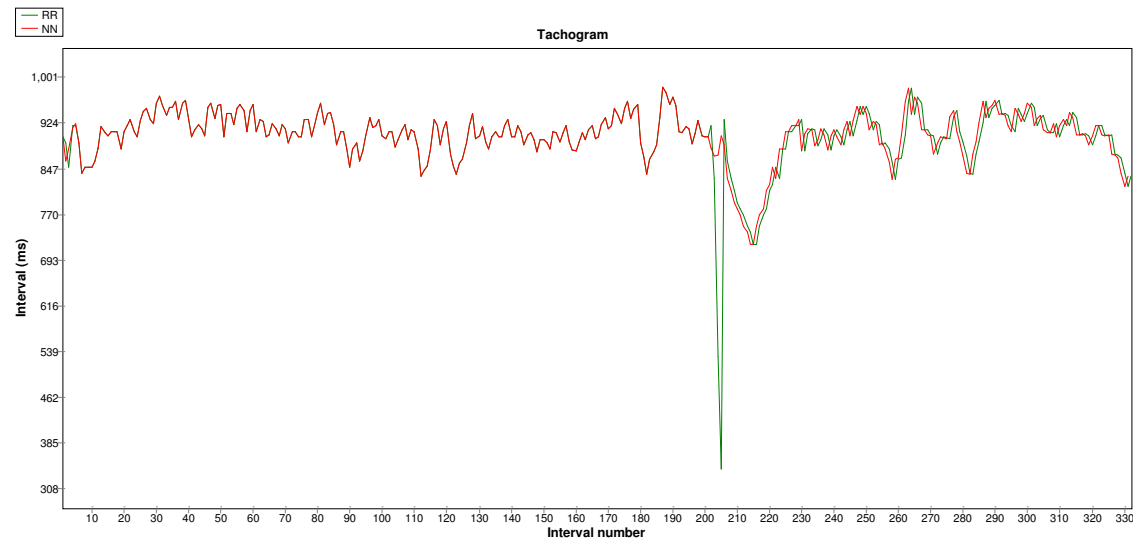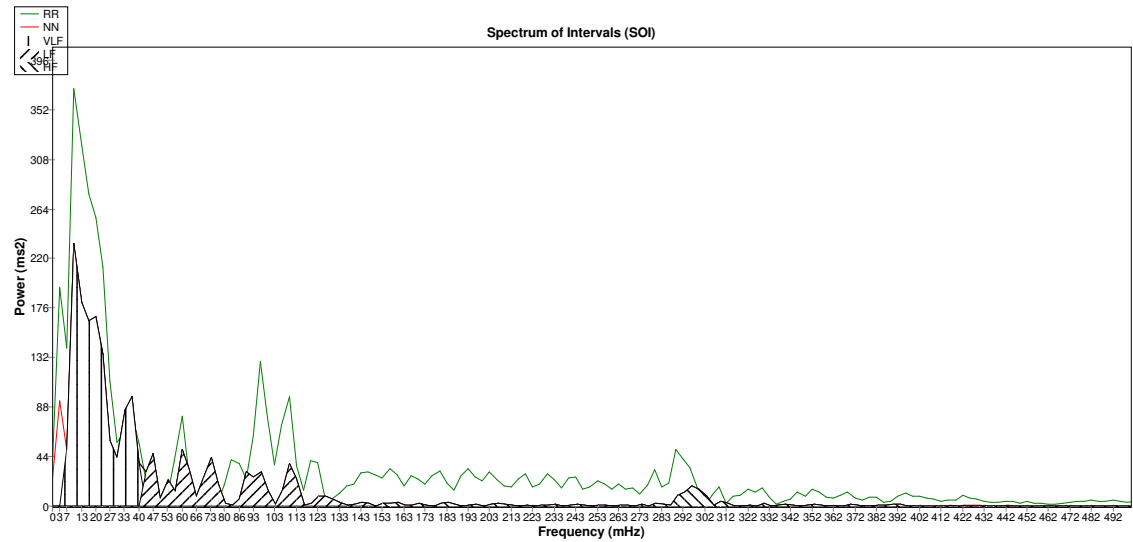

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	1931	4395	Spectrum of Intervals (SOI)	
VLF (ms2)	1256	1946	Frequency resolution (mHz)	3
LF (ms2)	532	1124	VLF lower boundary (mHz)	3
HF (ms2)	143	1325	VLF upper boundary (mHz)	40
LF/HF	3.73	0.85	LF upper boundary (mHz)	150
LF normalized	78.85	45.89	HF upper boundary (mHz)	400
HF normalized	21.15	54.11	Smoothing factor	1
VLF peak (mHz)	10	10	Tapering	Hann
LF peak (mHz)	60	96	Fourier transform	DFT
HF peak (mHz)	297	289	Sample frequency (Hz)	1.11
			Interval correction	Annotation
			Interval threshold (%)	10