


Anton Swart Biokinetic Rehabilitation Practice

Name: 015 015 015
Number: 015
Gender: Male
Birthdate: 26/01/1964 54 years

P / PQ: 128 ms / 190 ms
QRS: 103 ms
QT / QTc / QTd: 392 ms / 441 ms / -
P/QRS/T axis: 75° / 71° / 81°
Heartrate: 88 bpm

Recorded: 03/05/2018 17:37:57
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

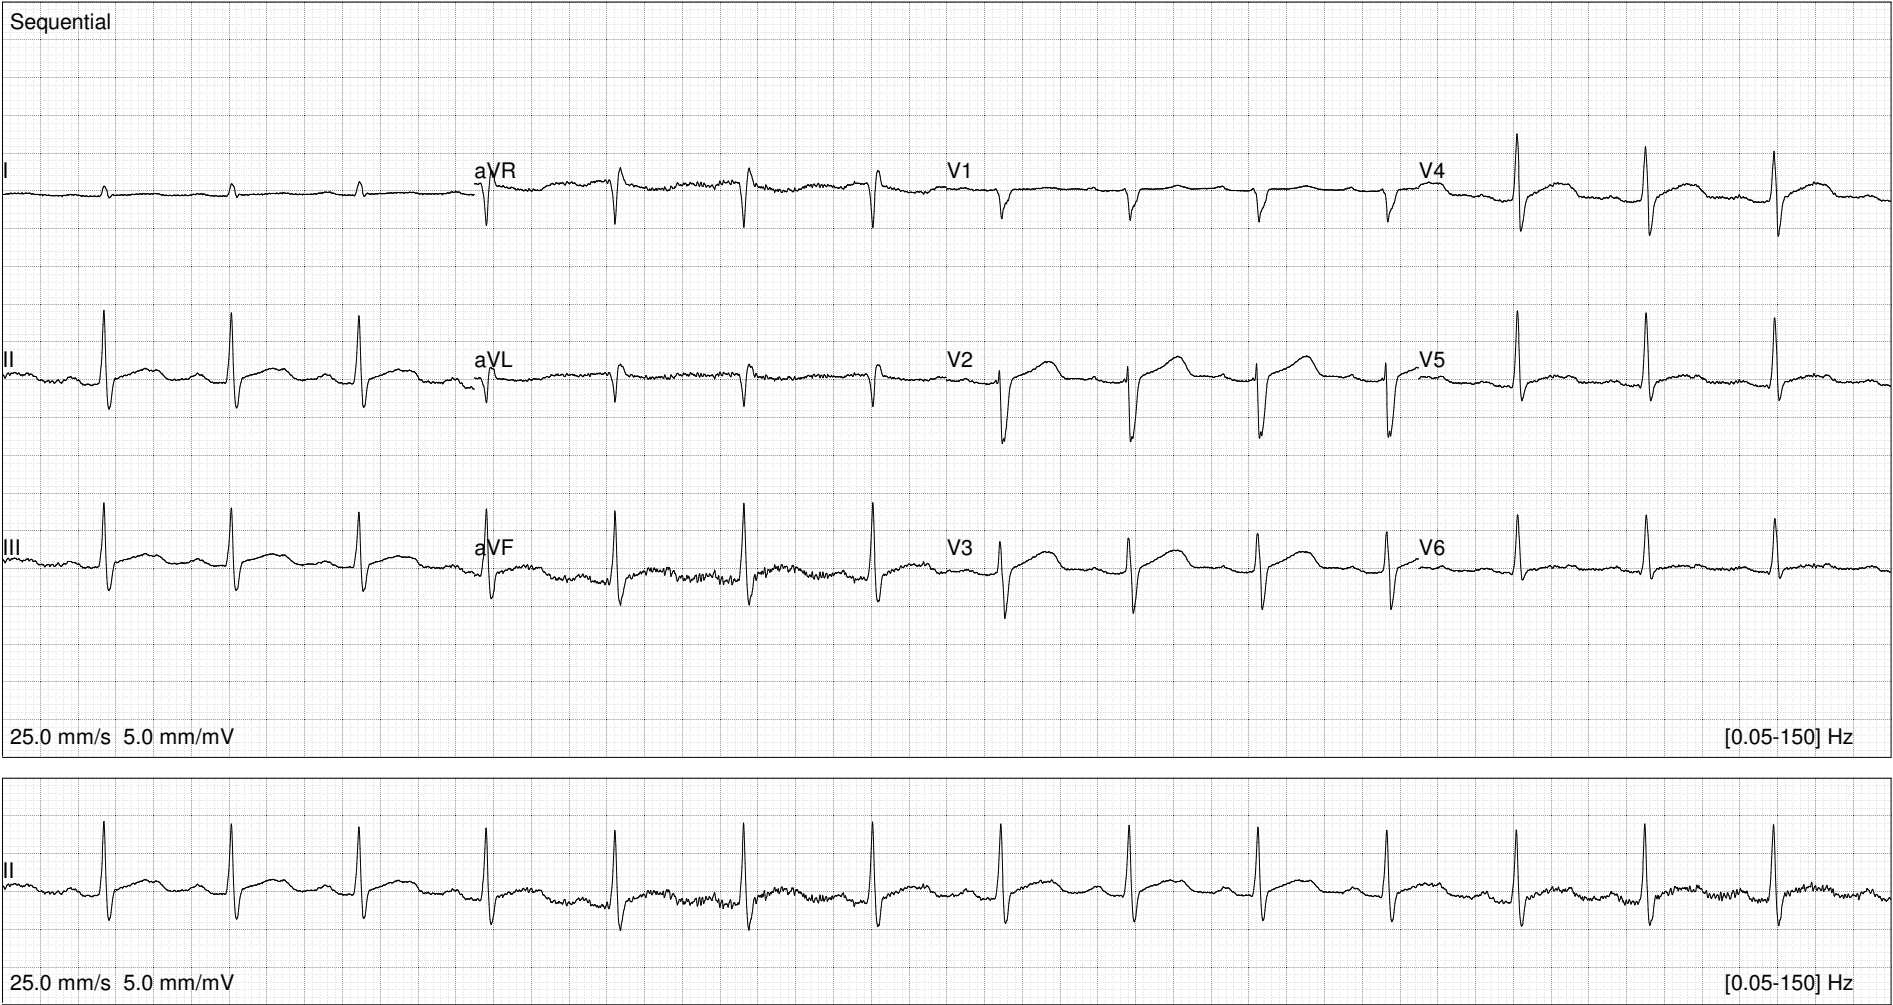



Anton Swart Biokinetic Rehabilitation Practice

Name: 015 015 015
Number: 015
Gender: Male
Birthdate: 26/01/1964 54 years
P / PQ: 128 ms / 190 ms
QRS: 103 ms
QT / QTc / QTd: 392 ms / 441 ms / -
P/QRS/T axis: 75° / 71° / 81°
Heartrate: 88 bpm

Recorded: 03/05/2018 17:37:57
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW




Beats		RR	
Total:	439	Minimum	500 ms
Normal:	439	Maximum	870 ms
Other:	0	Mean:	680 ms
		SD:	21 ms

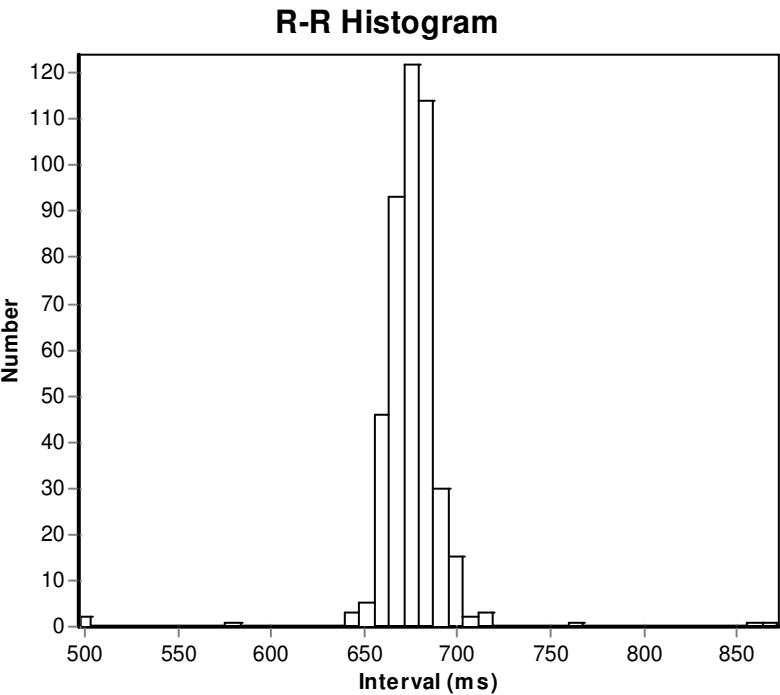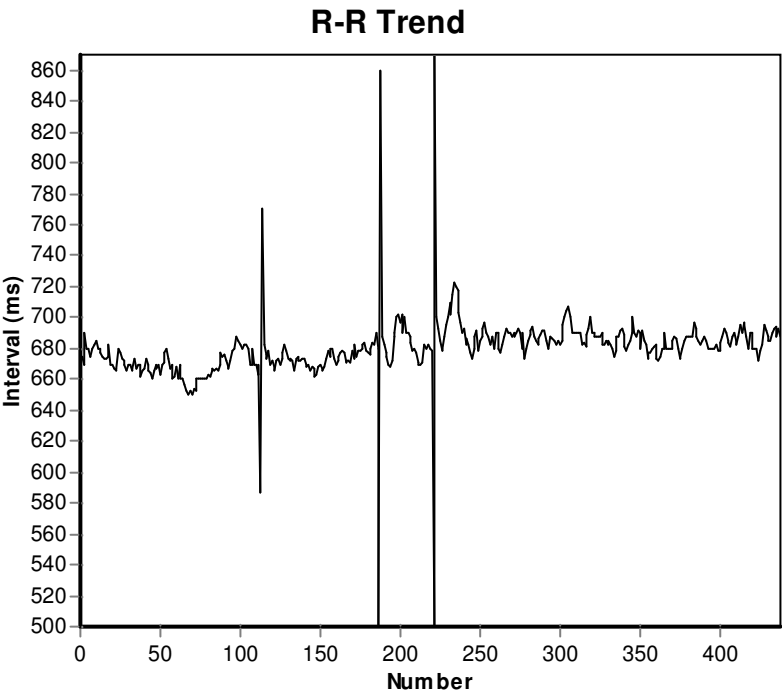

Heart Rate Variability: Time Domain Analysis

Name: 015, 015 015
 Number: 015
 Gender: Male

Birthdate: 26/01/1964
 Recorded: 03/05/2018 17:37:57

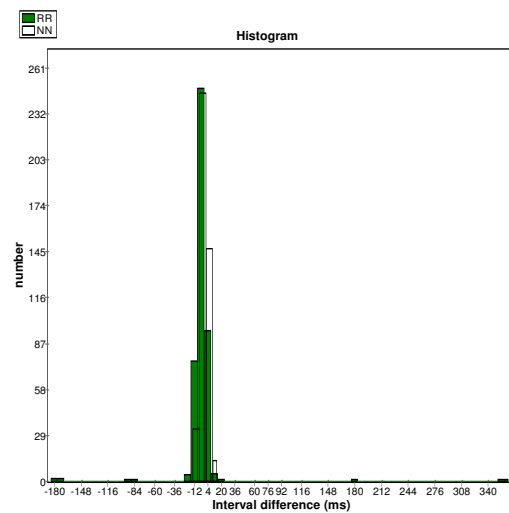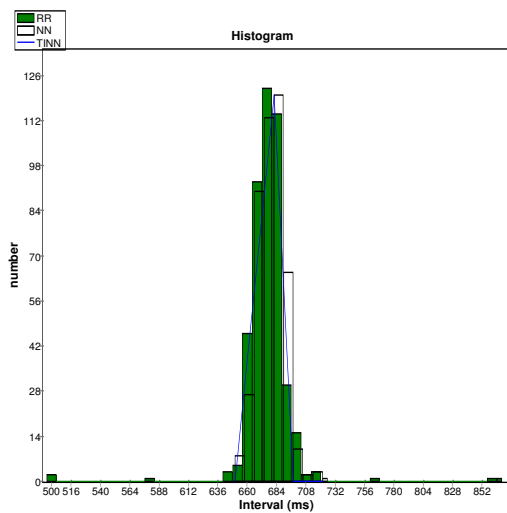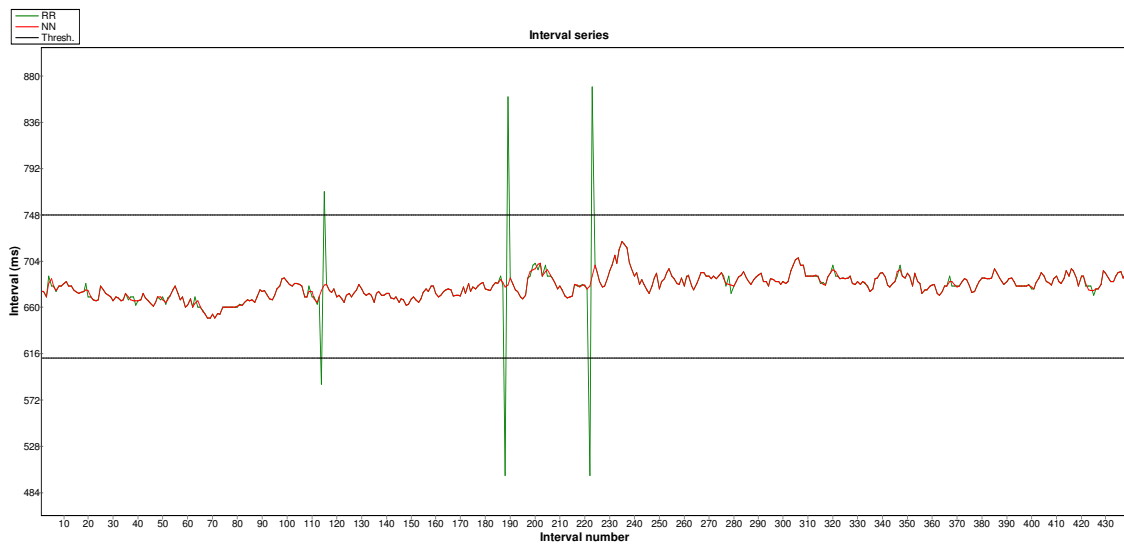

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	11	21
Triangular Interpolation (ms)	48	48
Triangular Index	3.66	3.60

HRV parameters	NN	RR
SDSD (ms)	5	32
RMSSD (ms)	5	32
NN50	0	9
NN50(1)	0	6
NN50(2)	0	3
pNN50	0.00	0.02
pNN50(1)	0.00	0.01
pNN50(2)	0.00	0.01
Logarithmic Index	2.99	0.59
SD(Logarithmic Index)	0.45	0.19



Interval statistics	NN	RR
Number	439	439
Minimum (ms)	650	500
Maximum (ms)	723	870
Range (ms)	73	370
Avg (ms)	680	680
SD (ms)	11	21
AvgDev (ms)	8	11
p5 (ms)	662	660
p50 (ms)	680	680
p95 (ms)	697	700
Skewness	0.16	0.23
Kurtosis	3.88	49.40

Interval statistics	NN	RR
Number	438	438
Minimum (ms)	-14	-180
Maximum (ms)	16	370
Range (ms)	30	550
Avg (ms)	0	0
SD (ms)	5	32
AvgDev (ms)	4	8
p5 (ms)	-7	-10
p50 (ms)	0	0
p95 (ms)	8	10
Skewness	0.13	5.61
Kurtosis	3.30	88.10

Heart Rate Variability: Frequency Domain Analysis

Name: 015, 015 015
Number: 015
Gender: Male

Birthdate: 26/01/1964
Recorded: 03/05/2018 17:37:57

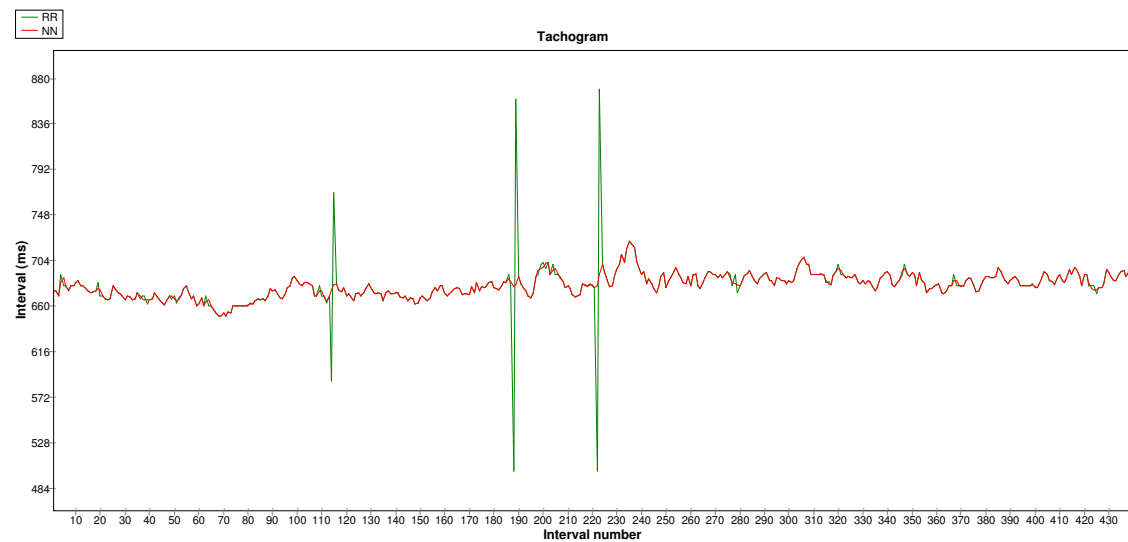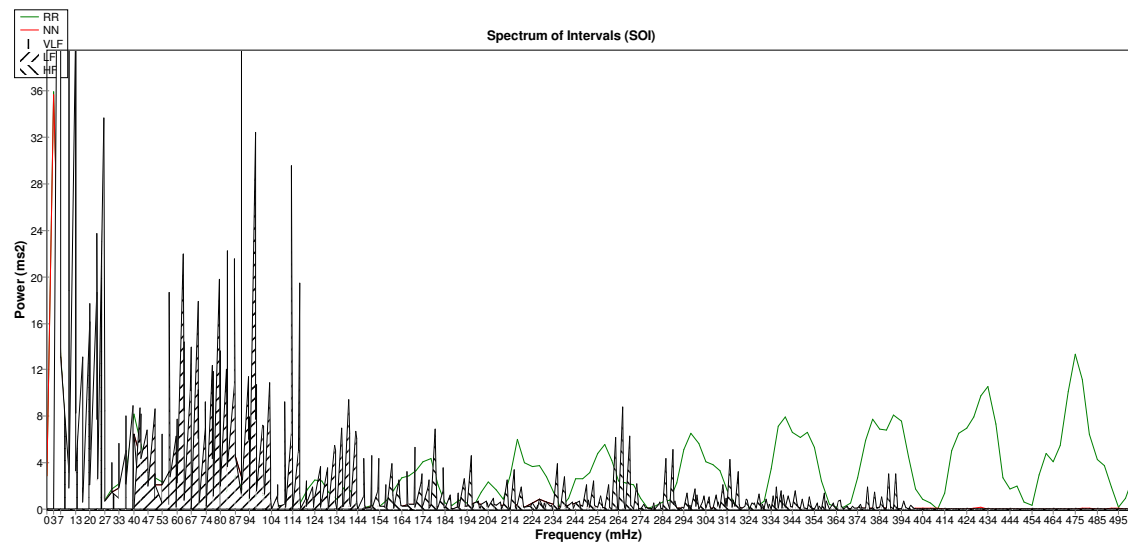

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	87	306	Spectrum of Intervals (SOI)	
VLF (ms2)	36	40	Frequency resolution (mHz)	3
LF (ms2)	39	45	VLF lower boundary (mHz)	3
HF (ms2)	12	221	VLF upper boundary (mHz)	40
LF/HF	3.22	0.20	LF upper boundary (mHz)	150
LF normalized	76.30	16.88	HF upper boundary (mHz)	400
HF normalized	23.70	83.12	Smoothing factor	1
VLF peak (mHz)	7	7	Tapering	Hann
LF peak (mHz)	87	43	Fourier transform	DFT
HF peak (mHz)	227	391	Sample frequency (Hz)	1.47
			Interval correction	Annotation
			Interval threshold (%)	10