


Anton Swart Biokinetic Rehabilitation Practice

Name: 016 016
Number: 016
Gender: Female
Birthdate: 26/11/1970 47 years

Recorded: 05/05/2018 13:14:35
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

P / PQ: 113 ms / 142 ms
QRS: 80 ms
QT / QTc / QTd: 391 ms / 424 ms / -
P/QRS/T axis: 74° / 91° / 76°
Heartrate: 79 bpm

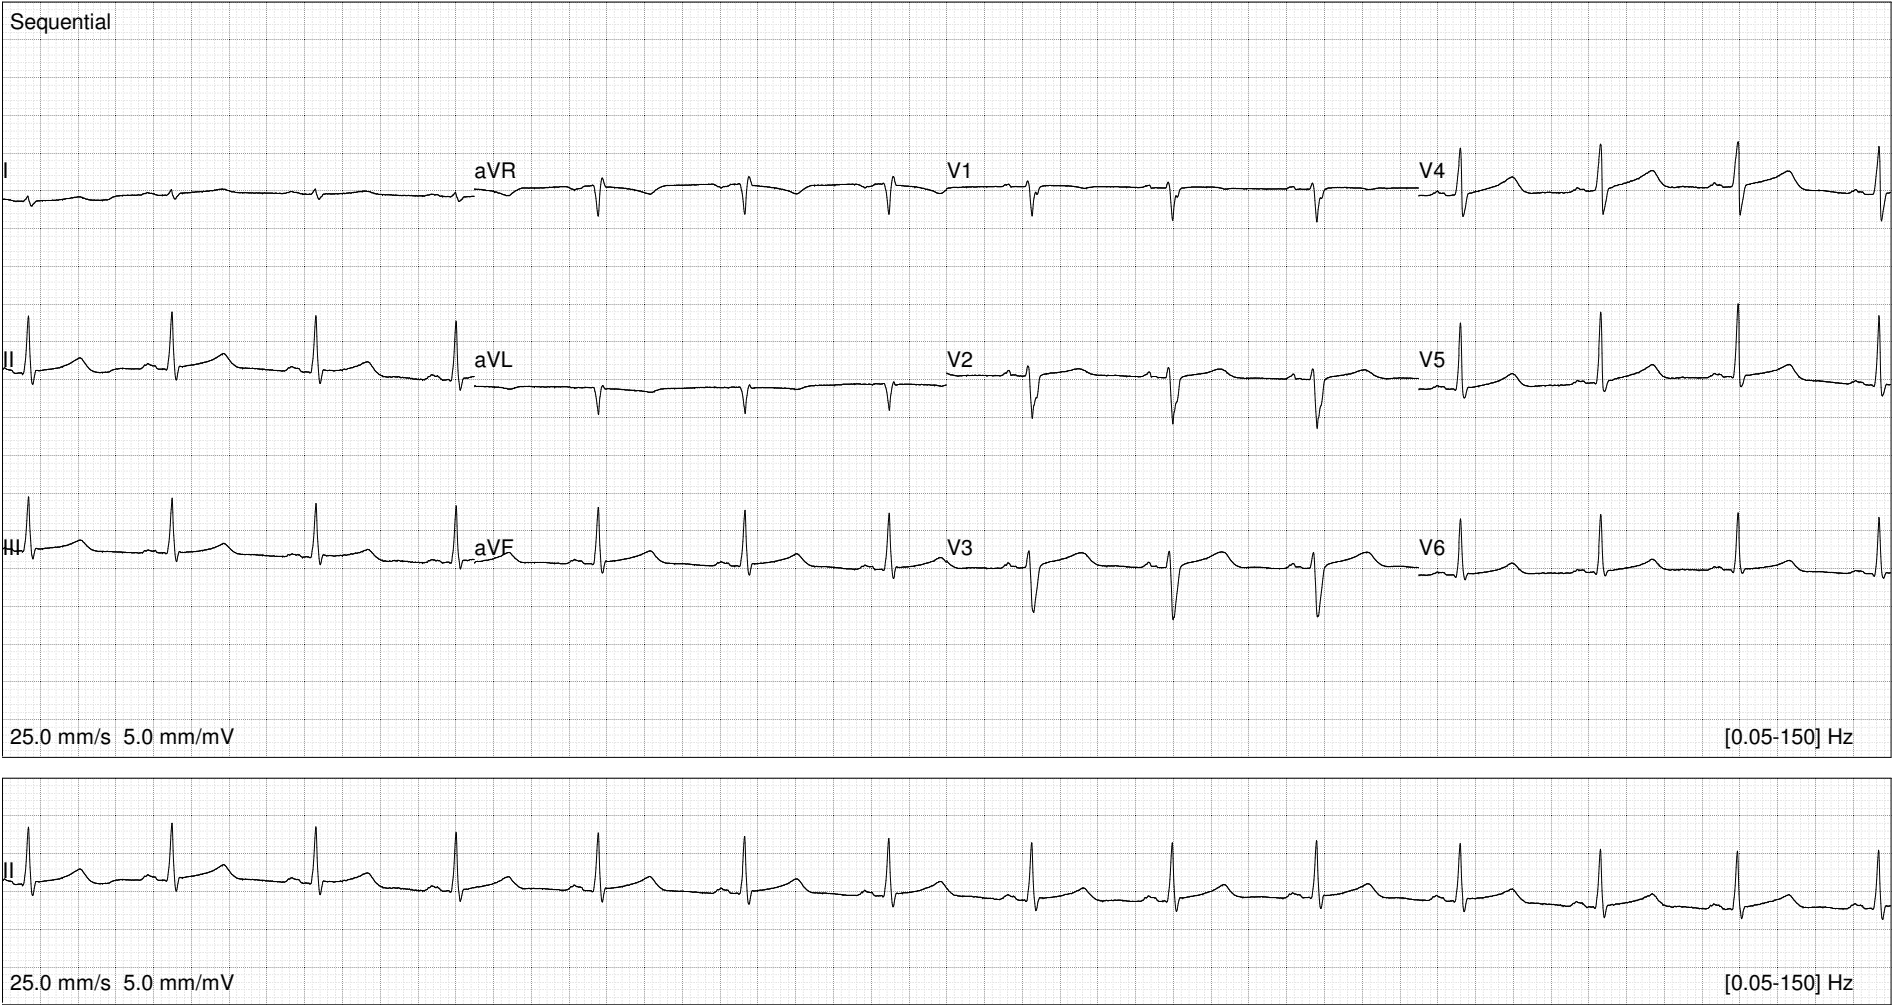

Anton Swart Biokinetic Rehabilitation Practice



Name: 016 016
Number: 016
Gender: Female
Birthdate: 26/11/1970 47 years

P / PQ: 113 ms / 142 ms
QRS: 80 ms
QT / QTc / QTd: 391 ms / 424 ms / -
P/QRS/T axis: 74° / 91° / 76°
Heartrate: 79 bpm

Recorded: 05/05/2018 13:14:35
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW



Beats		RR	
Total:	393	Minimum	700 ms
Normal:	393	Maximum	825 ms
Other:	0	Mean:	761 ms
		SD:	21 ms

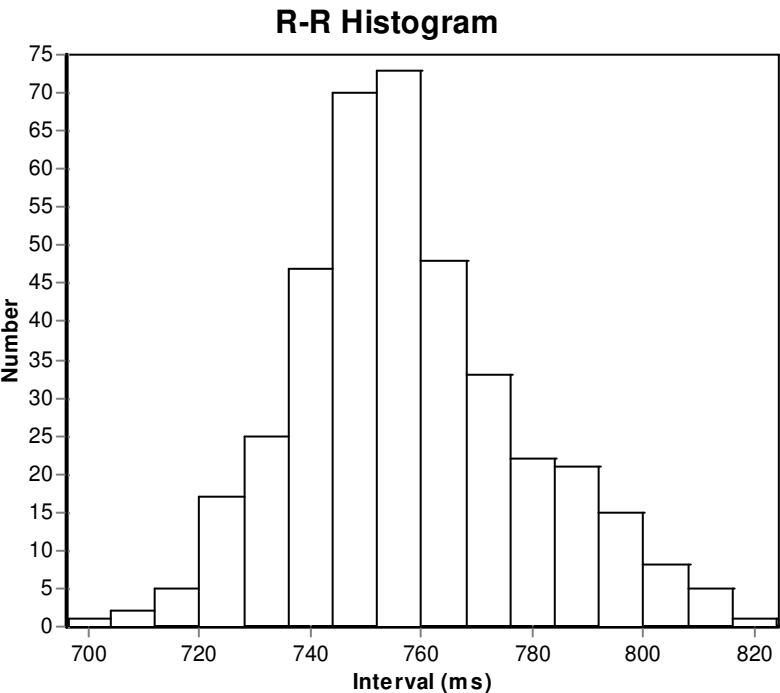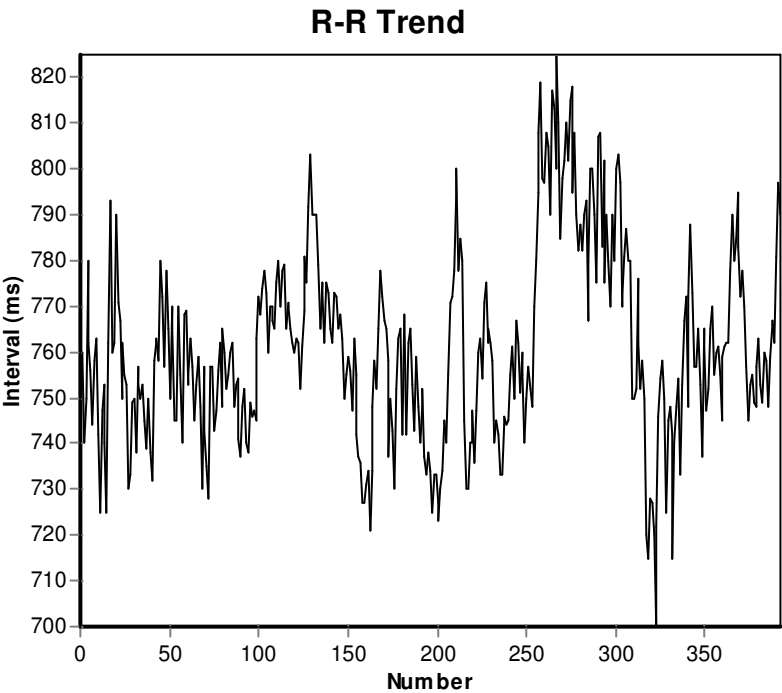

Heart Rate Variability: Time Domain Analysis

Name: 016, 016
Number: 016
Gender: Female


Birthdate: 26/11/1970
Recorded: 05/05/2018 13:14:35

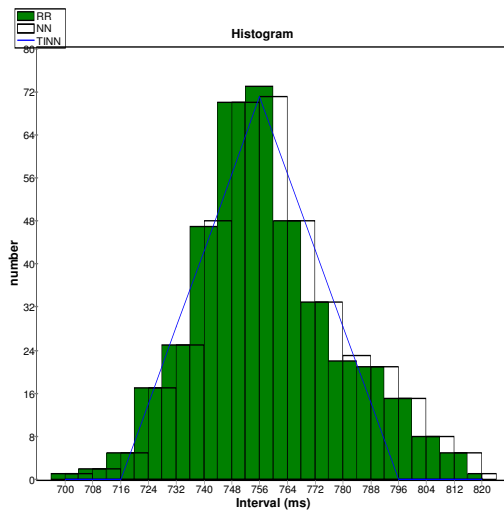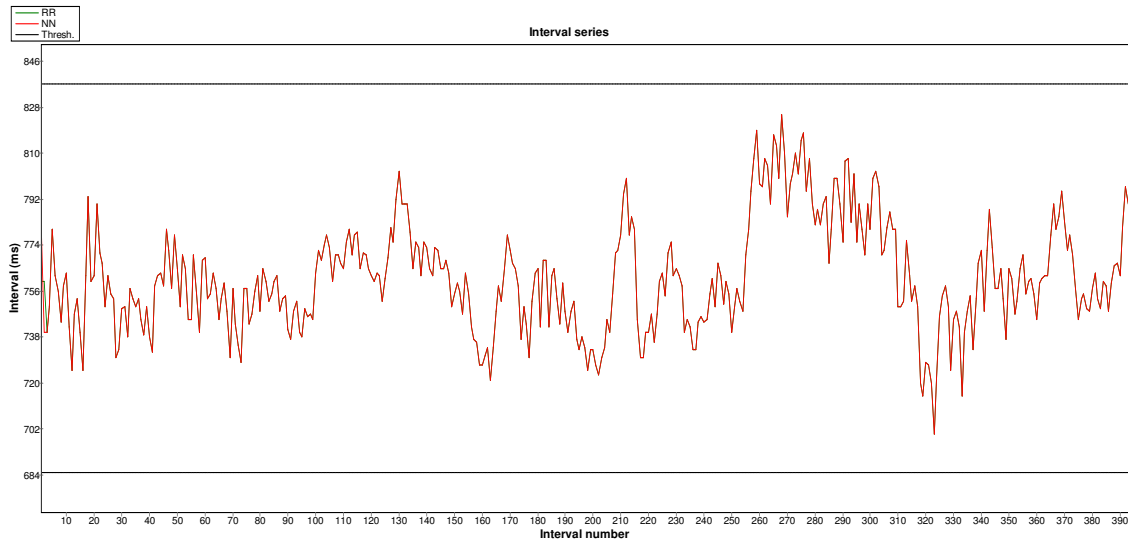

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	21	21
Triangular Interpolation (ms)	80	80
Triangular Index	5.54	5.38

Interval statistics	NN	RR
Number	393	393
Minimum (ms)	700	700
Maximum (ms)	825	825
Range (ms)	125	125
Avg (ms)	761	761
SD (ms)	21	21
AvgDev (ms)	16	16
p5 (ms)	730	730
p50 (ms)	760	760
p95 (ms)	802	802
Skewness	0.43	0.44
Kurtosis	3.16	3.18


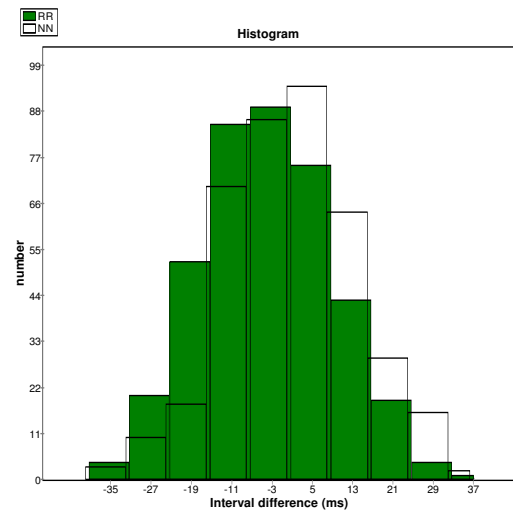


HRV parameters	NN	RR
SDSD (ms)	13	13
RMSSD (ms)	13	13
NN50	0	0
NN50(1)	0	0
NN50(2)	0	0
pNN50	0.00	0.00
pNN50(1)	0.00	0.00
pNN50(2)	0.00	0.00
Logarithmic Index	1.06	0.91
SD(Logarithmic Index)	0.14	0.17

Interval statistics	NN	RR
Number	392	392
Minimum (ms)	-40	-35
Maximum (ms)	37	37
Range (ms)	77	72
Avg (ms)	0	0
SD (ms)	13	13
AvgDev (ms)	10	10
p5 (ms)	-21	-21
p50 (ms)	0	0
p95 (ms)	22	22
Skewness	0.04	0.10
Kurtosis	2.94	2.82

Heart Rate Variability: Frequency Domain Analysis

Name: 016, 016 Birthdate: 26/11/1970
 Number: 016 Recorded: 05/05/2018 13:14:35
 Gender: Female

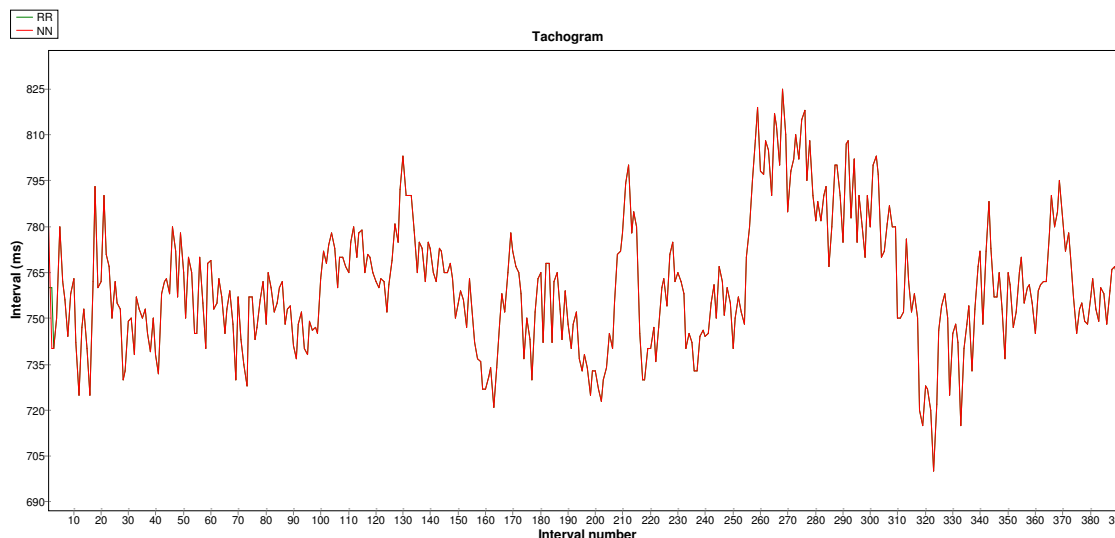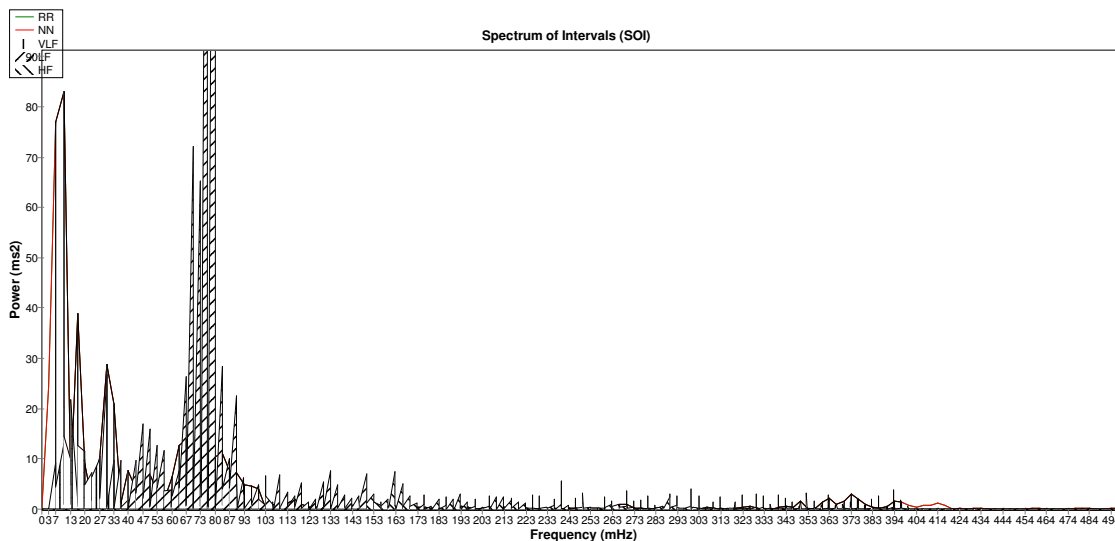

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	449	449	Spectrum of Intervals (SOI)	
VLF (ms2)	284	284	Frequency resolution (mHz)	3
LF (ms2)	130	130	VLF lower boundary (mHz)	3
HF (ms2)	35	35	VLF upper boundary (mHz)	40
LF/HF	3.77	3.77	LF upper boundary (mHz)	150
LF normalized	79.03	79.03	HF upper boundary (mHz)	400
HF normalized	20.97	20.97	Smoothing factor	1
VLF peak (mHz)	10	10	Tapering	Hann
LF peak (mHz)	67	67	Fourier transform	DFT
HF peak (mHz)	373	373	Sample frequency (Hz)	1.31
			Interval correction	Annotation
			Interval threshold (%)	10