


Anton Swart Biokinetic Rehabilitation Practice

Name: 017 017
Number: 017
Gender: Male
Birthdate: 17/11/1971 46 years

P / PQ: 112 ms / 185 ms
QRS: 112 ms
QT / QTc / QTd: 403 ms / 398 ms / -
P/QRS/T axis: 63° / 87° / 82°
Heartrate: 57 bpm

Recorded: 01/05/2018 10:50:52
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

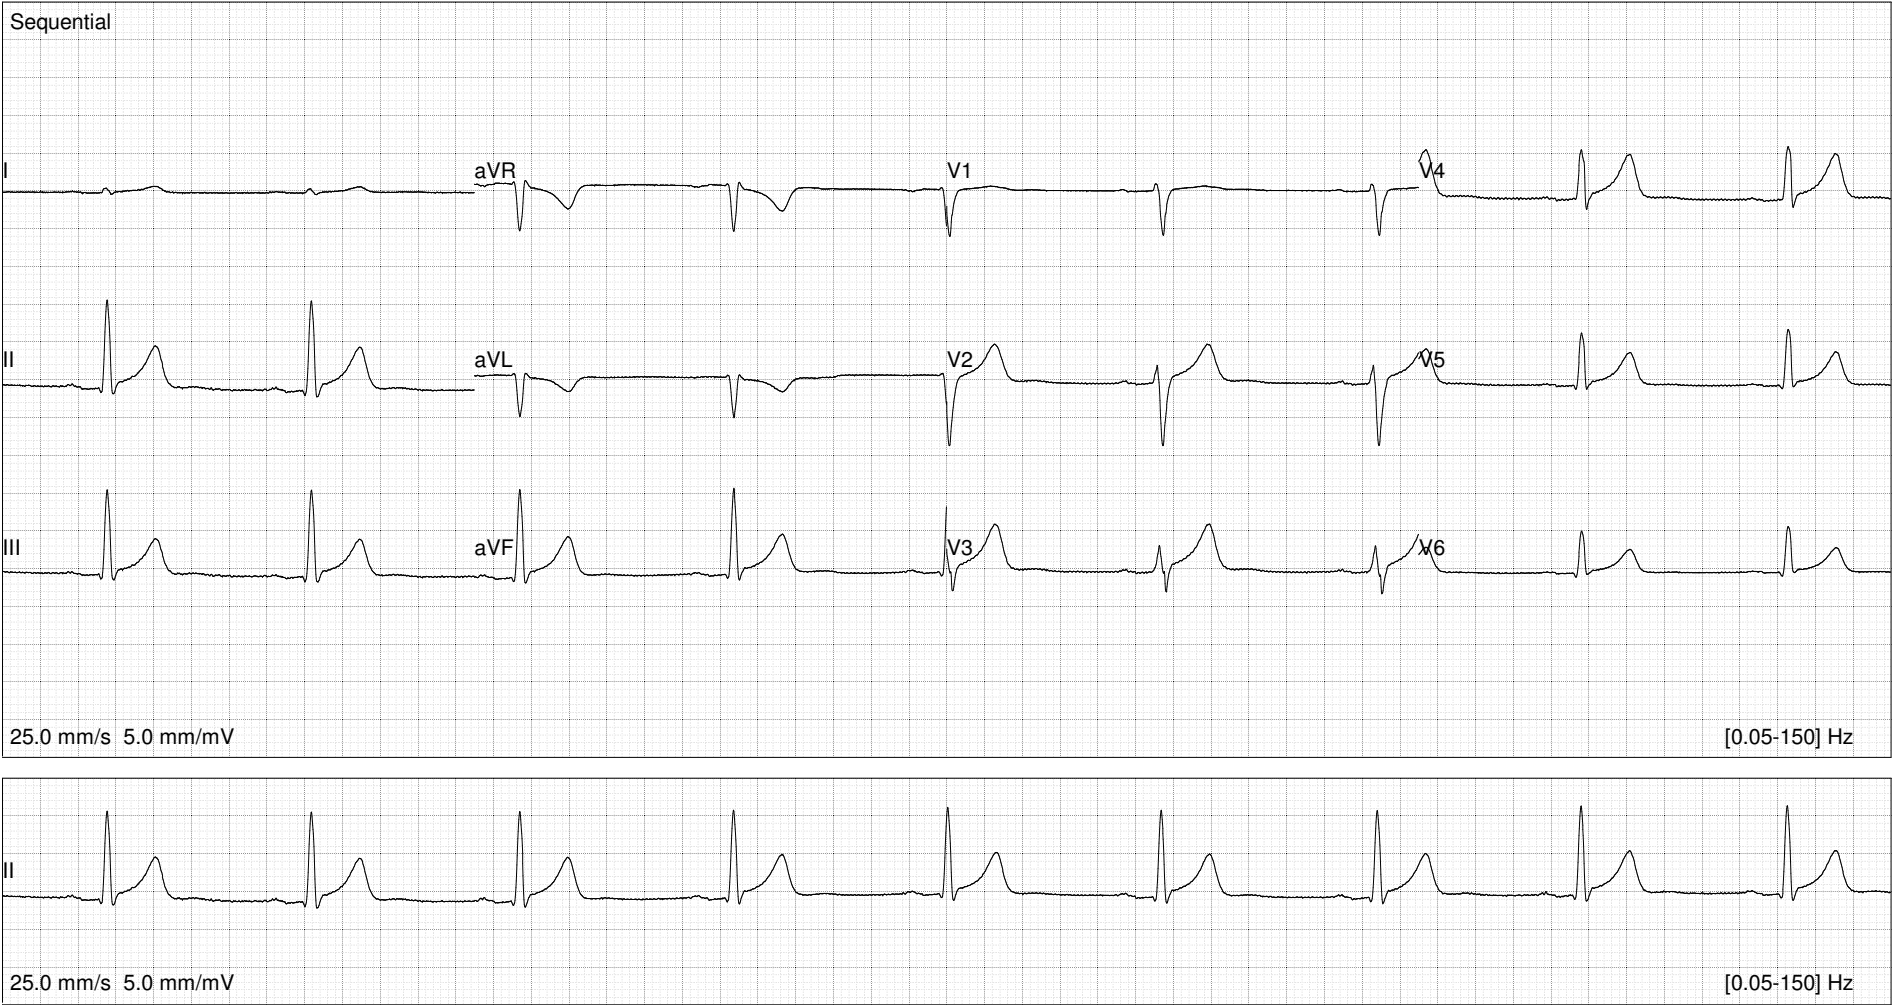

Anton Swart Biokinetic Rehabilitation Practice


Name: 017 017
Number: 017
Gender: Male
Birthdate: 17/11/1971 46 years
P / PQ: 112 ms / 185 ms
QRS: 112 ms
QT / QTc / QTd: 403 ms / 398 ms / -
P/QRS/T axis: 63° / 87° / 82°
Heartrate: 57 bpm

Recorded: 01/05/2018 10:50:52
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:


UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

Beats		RR	
Total:	285	Minimum	955 ms
Normal:	285	Maximum	1143 ms
Other:	0	Mean:	1047 ms
		SD:	39 ms

R-R Trend

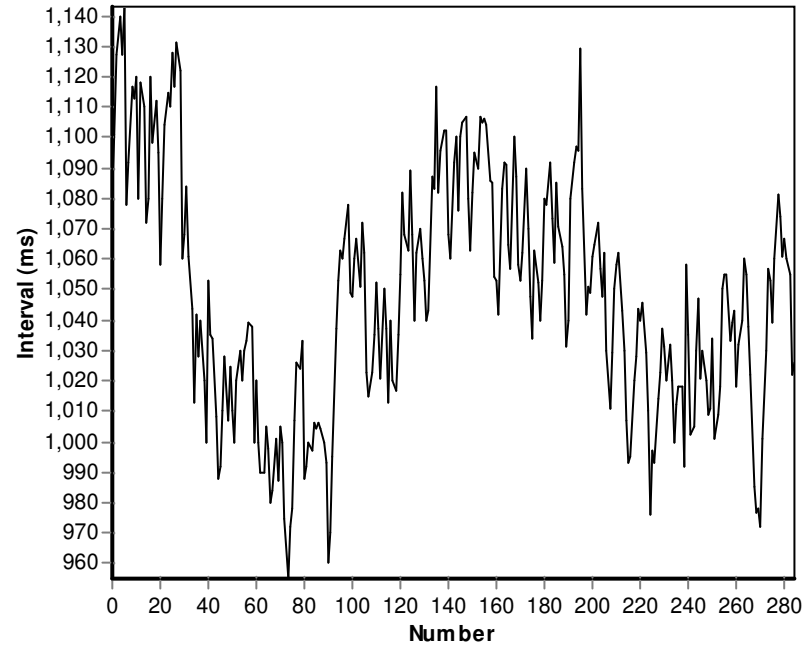



R-R Histogram

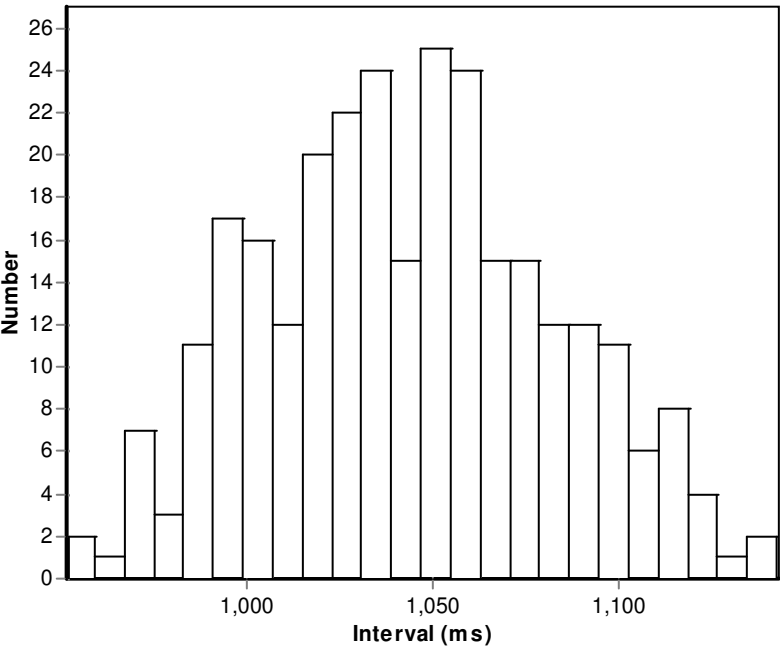

Heart Rate Variability: Time Domain Analysis

Name: 017, 017
Number: 017
Gender: Male


Birthdate: 17/11/1971
Recorded: 01/05/2018 10:50:52

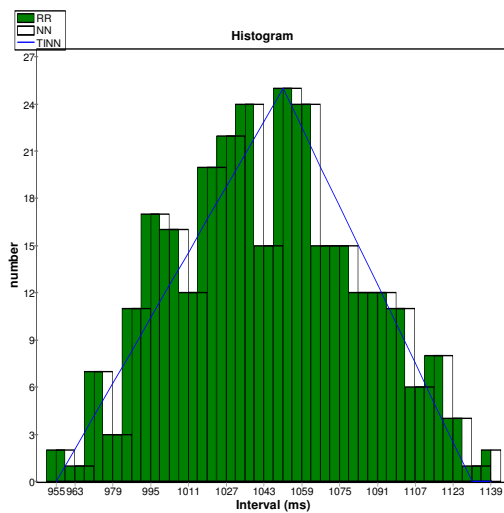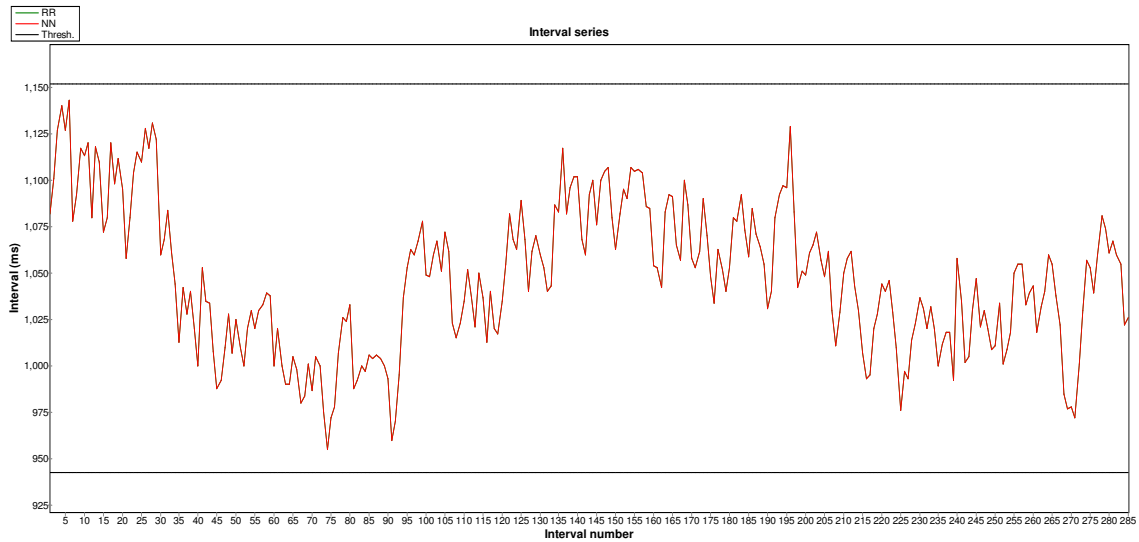

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	39	39
Triangular Interpolation (ms)	176	176
Triangular Index	11.40	11.40

Interval statistics	NN	RR
Number	285	285
Minimum (ms)	955	955
Maximum (ms)	1143	1143
Range (ms)	188	188
Avg (ms)	1047	1047
SD (ms)	39	39
AvgDev (ms)	32	32
p5 (ms)	988	988
p50 (ms)	1048	1048
p95 (ms)	1117	1117
Skewness	0.13	0.13
Kurtosis	2.43	2.43


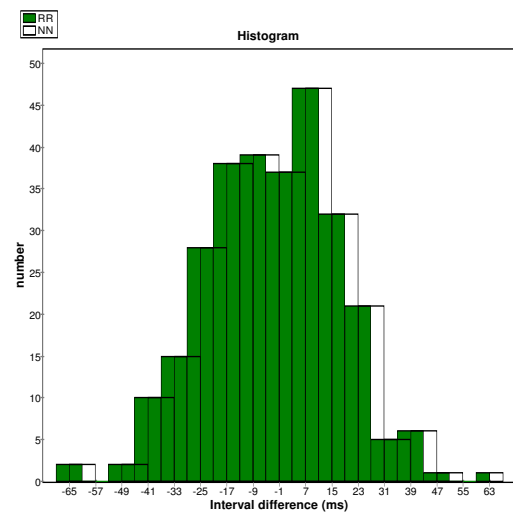


HRV parameters	NN	RR
SDSD (ms)	20	20
RMSSD (ms)	20	20
NN50	4	4
NN50(1)	2	2
NN50(2)	2	2
pNN50	0.01	0.01
pNN50(1)	0.01	0.01
pNN50(2)	0.01	0.01
Logarithmic Index	0.62	0.62
SD(Logarithmic Index)	0.09	0.09

Interval statistics	NN	RR
Number	284	284
Minimum (ms)	-65	-65
Maximum (ms)	66	66
Range (ms)	131	131
Avg (ms)	-0	-0
SD (ms)	20	20
AvgDev (ms)	16	16
p5 (ms)	-34	-34
p50 (ms)	0	0
p95 (ms)	29	29
Skewness	-0.08	-0.08
Kurtosis	3.15	3.15

Heart Rate Variability: Frequency Domain Analysis

Name: 017, 017 Birthdate: 17/11/1971
 Number: 017 Recorded: 01/05/2018 10:50:52
 Gender: Male

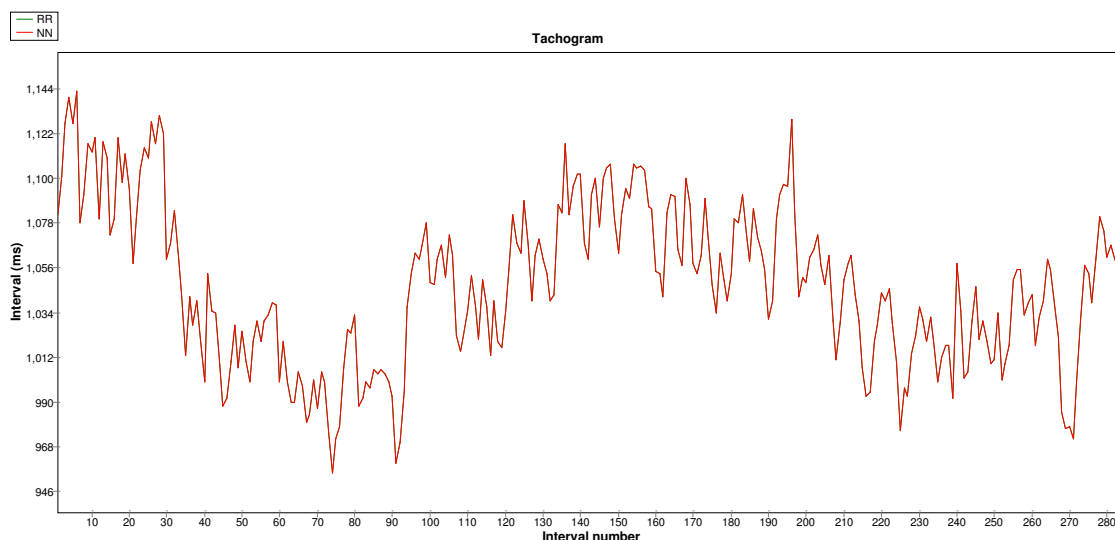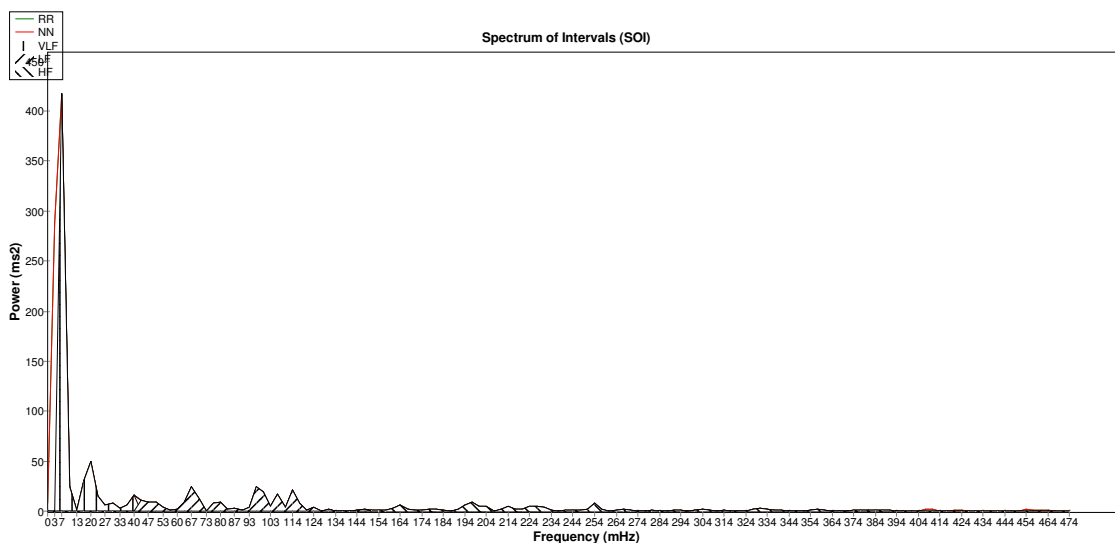

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	924	924	Spectrum of Intervals (SOI)	
VLF (ms2)	578	578	Frequency resolution (mHz)	3
LF (ms2)	223	223	VLF lower boundary (mHz)	3
HF (ms2)	123	123	VLF upper boundary (mHz)	40
LF/HF	1.82	1.82	LF upper boundary (mHz)	150
LF normalized	64.54	64.54	HF upper boundary (mHz)	400
HF normalized	35.46	35.46	Smoothing factor	1
VLF peak (mHz)	7	7	Tapering	Hann
LF peak (mHz)	67	67	Fourier transform	DFT
HF peak (mHz)	197	197	Sample frequency (Hz)	0.95
			Interval correction	Annotation
			Interval threshold (%)	10