


Anton Swart Biokinetic Rehabilitation Practice

Name: 017 017
Number: 017
Gender: Male
Birthdate: 17/11/1971 46 years

Recorded: 04/05/2018 13:05:12
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

P / PQ: 118 ms / 167 ms
QRS: 96 ms
QT / QTc / QTd: 378 ms / 408 ms / -
P/QRS/T axis: 80° / 86° / 80°
Heartrate: 77 bpm

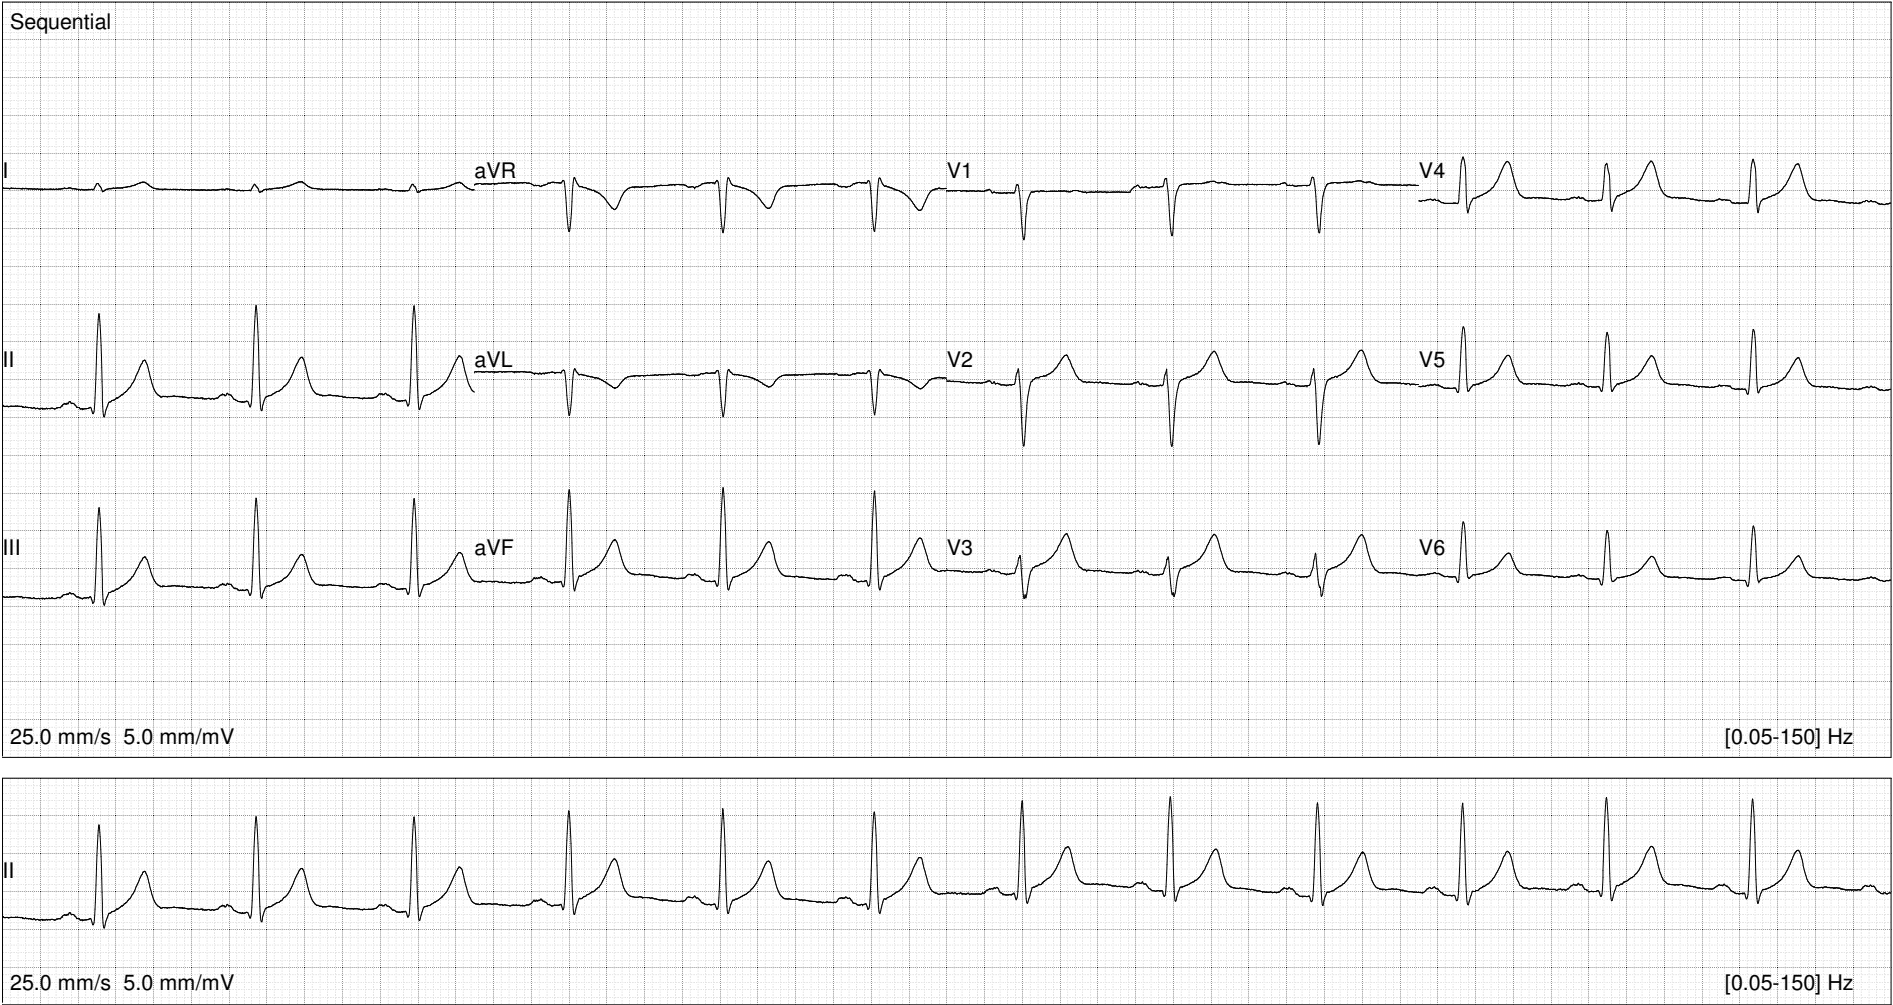

Anton Swart Biokinetic Rehabilitation Practice



Name: 017 017
Number: 017
Gender: Male
Birthdate: 17/11/1971 46 years

P / PQ: 118 ms / 167 ms
QRS: 96 ms
QT / QTc / QTd: 378 ms / 408 ms / -
P/QRS/T axis: 80° / 86° / 80°
Heartrate: 77 bpm

Recorded: 04/05/2018 13:05:12
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW



Beats		RR	
Total:	377	Minimum	693 ms
Normal:	377	Maximum	960 ms
Other:	0	Mean:	792 ms
		SD:	49 ms

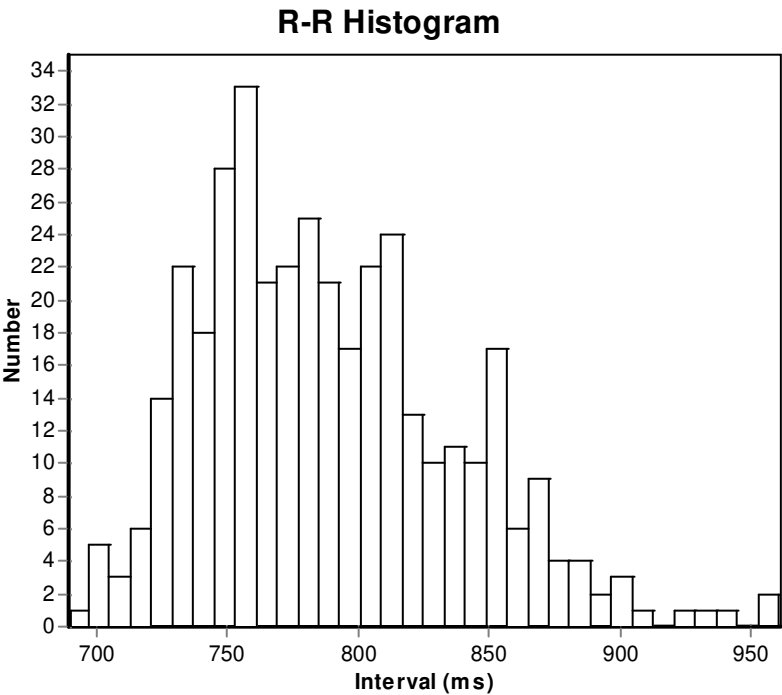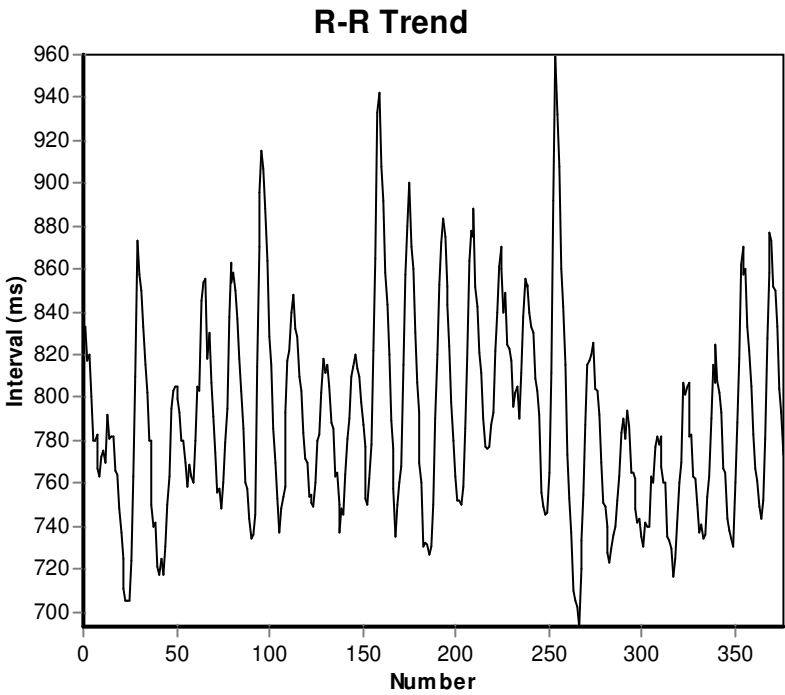

Heart Rate Variability: Time Domain Analysis

Name: 017, 017
Number: 017
Gender: Male


Birthdate: 17/11/1971
Recorded: 04/05/2018 13:05:12

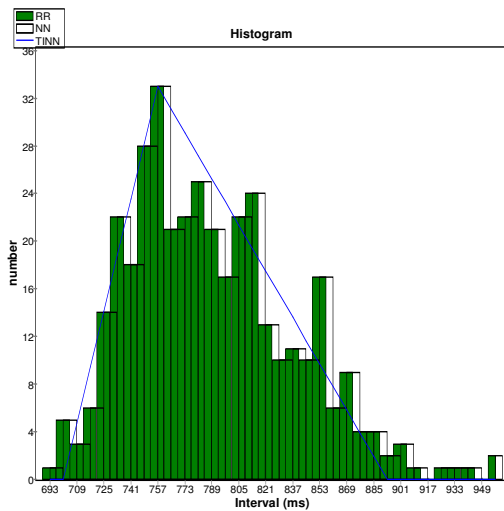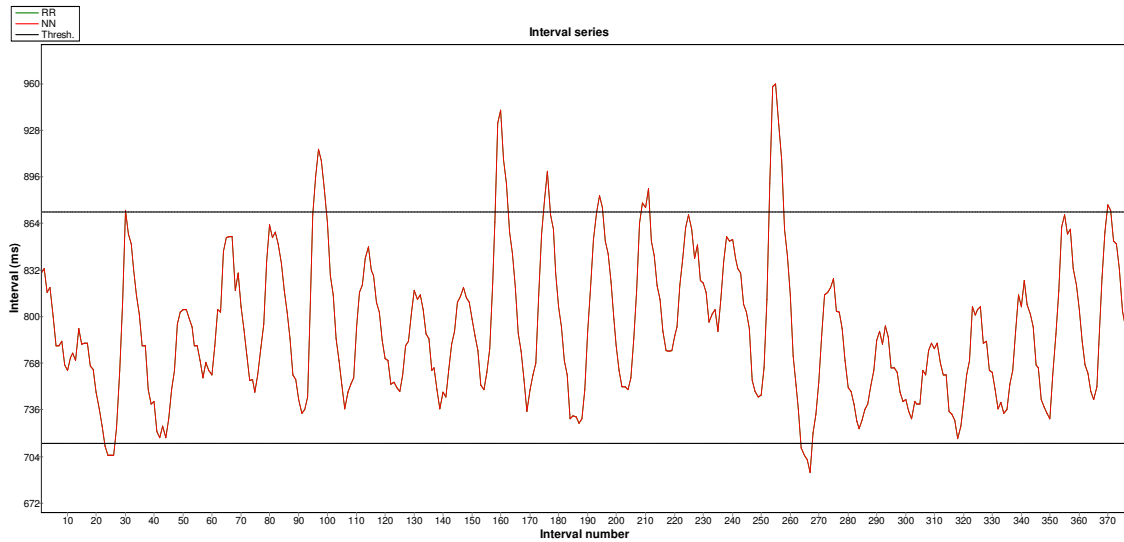

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	49	49
Triangular Interpolation (ms)	192	192
Triangular Index	11.42	11.42

Interval statistics	NN	RR
Number	377	377
Minimum (ms)	693	693
Maximum (ms)	960	960
Range (ms)	267	267
Avg (ms)	792	792
SD (ms)	49	49
AvgDev (ms)	39	39
p5 (ms)	727	727
p50 (ms)	785	785
p95 (ms)	878	878
Skewness	0.65	0.65
Kurtosis	3.20	3.20


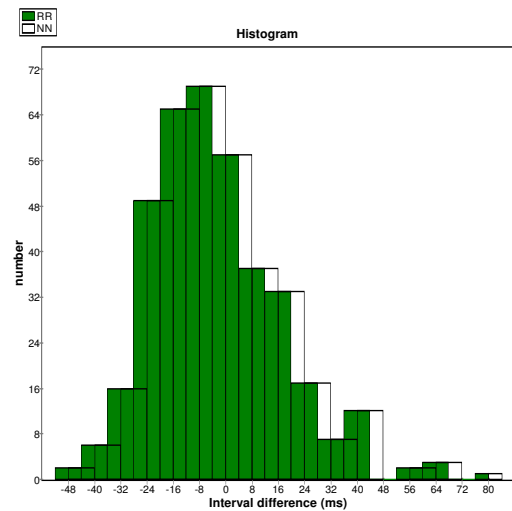


HRV parameters	NN	RR
SDSD (ms)	20	20
RMSSD (ms)	20	20
NN50	6	6
NN50(1)	0	0
NN50(2)	6	6
pNN50	0.02	0.02
pNN50(1)	0.00	0.00
pNN50(2)	0.02	0.02
Logarithmic Index	0.59	0.59
SD(Logarithmic Index)	0.08	0.08

Interval statistics	NN	RR
Number	376	376
Minimum (ms)	-48	-48
Maximum (ms)	80	80
Range (ms)	128	128
Avg (ms)	-0	-0
SD (ms)	20	20
AvgDev (ms)	15	15
p5 (ms)	-27	-27
p50 (ms)	-3	-3
p95 (ms)	40	40
Skewness	0.89	0.89
Kurtosis	4.28	4.28

Heart Rate Variability: Frequency Domain Analysis

Name: 017, 017 Birthdate: 17/11/1971
 Number: 017 Recorded: 04/05/2018 13:05:12
 Gender: Male

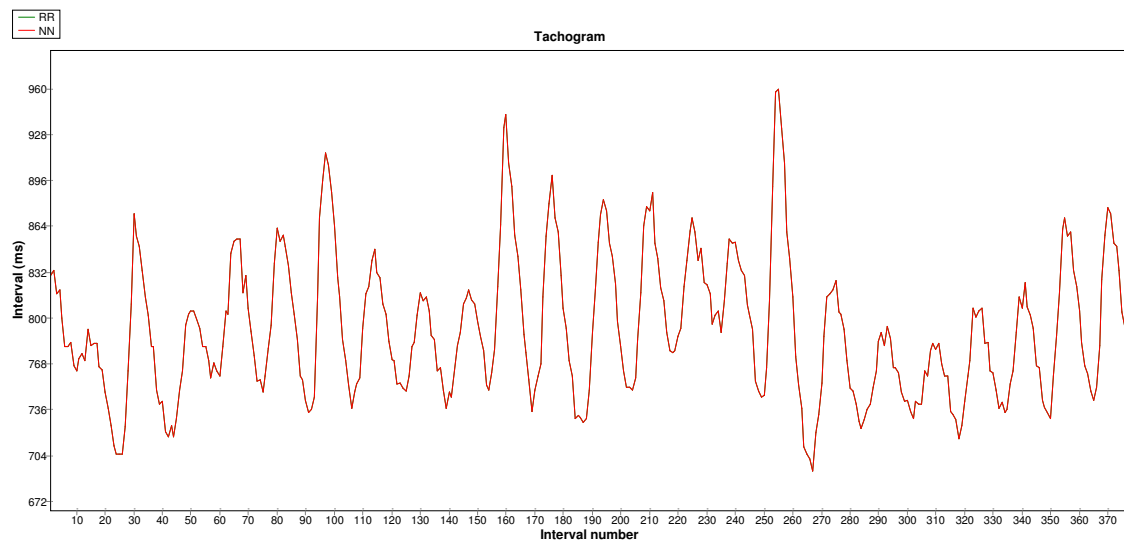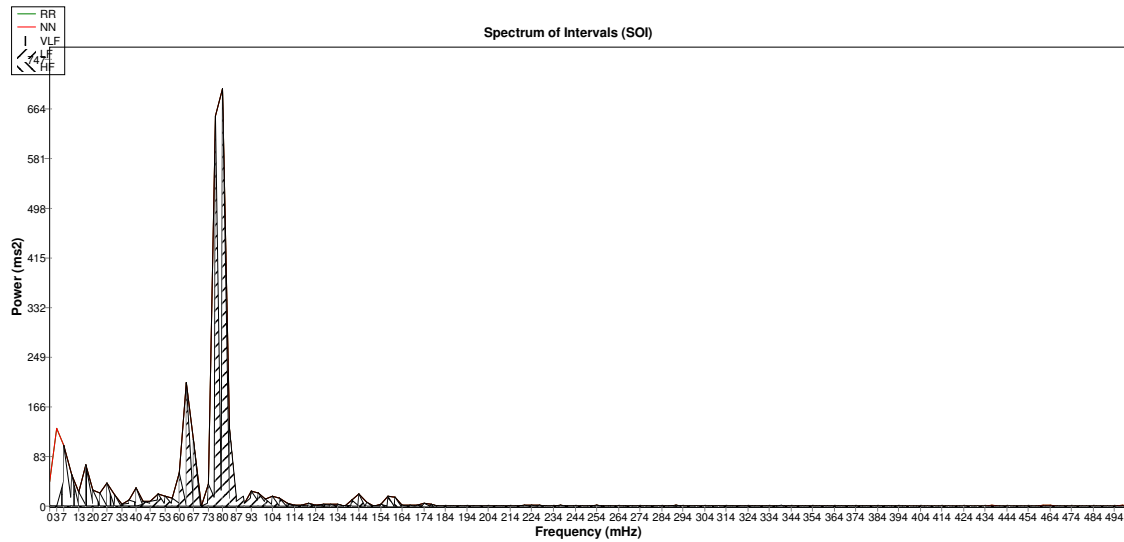

HRV parameters		NN	RR	HRV spectral settings	
TP (ms2)		2597	2597	Spectrum of Intervals (SOI)	
VLF (ms2)		398	398	Frequency resolution (mHz)	3
LF (ms2)		2127	2127	VLF lower boundary (mHz)	3
HF (ms2)		73	73	VLF upper boundary (mHz)	40
LF/HF		29.19	29.19	LF upper boundary (mHz)	150
LF normalized		96.69	96.69	HF upper boundary (mHz)	400
HF normalized		3.31	3.31	Smoothing factor	1
VLF peak (mHz)		7	7	Tapering	Hann
LF peak (mHz)		80	80	Fourier transform	DFT
HF peak (mHz)		157	157	Sample frequency (Hz)	1.26
				Interval correction	Annotation
				Interval threshold (%)	10