


Anton Swart Biokinetic Rehabilitation Practice

Name: 017 017
Number: 017
Gender: Male
Birthdate: 17/11/1971 46 years

Recorded: 06/05/2018 09:07:31
Recorded by: Mr. Anton Swart
Referring physician:
Ordering physician:
Attending physician:
Location: Anton Swart Biokinetic Rehabilitation Practi
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW

P / PQ: 102 ms / 162 ms
QRS: 100 ms
QT / QTc / QTd: 410 ms / 431 ms / -
P/QRS/T axis: 55° / 88° / 82°
Heartrate: 72 bpm

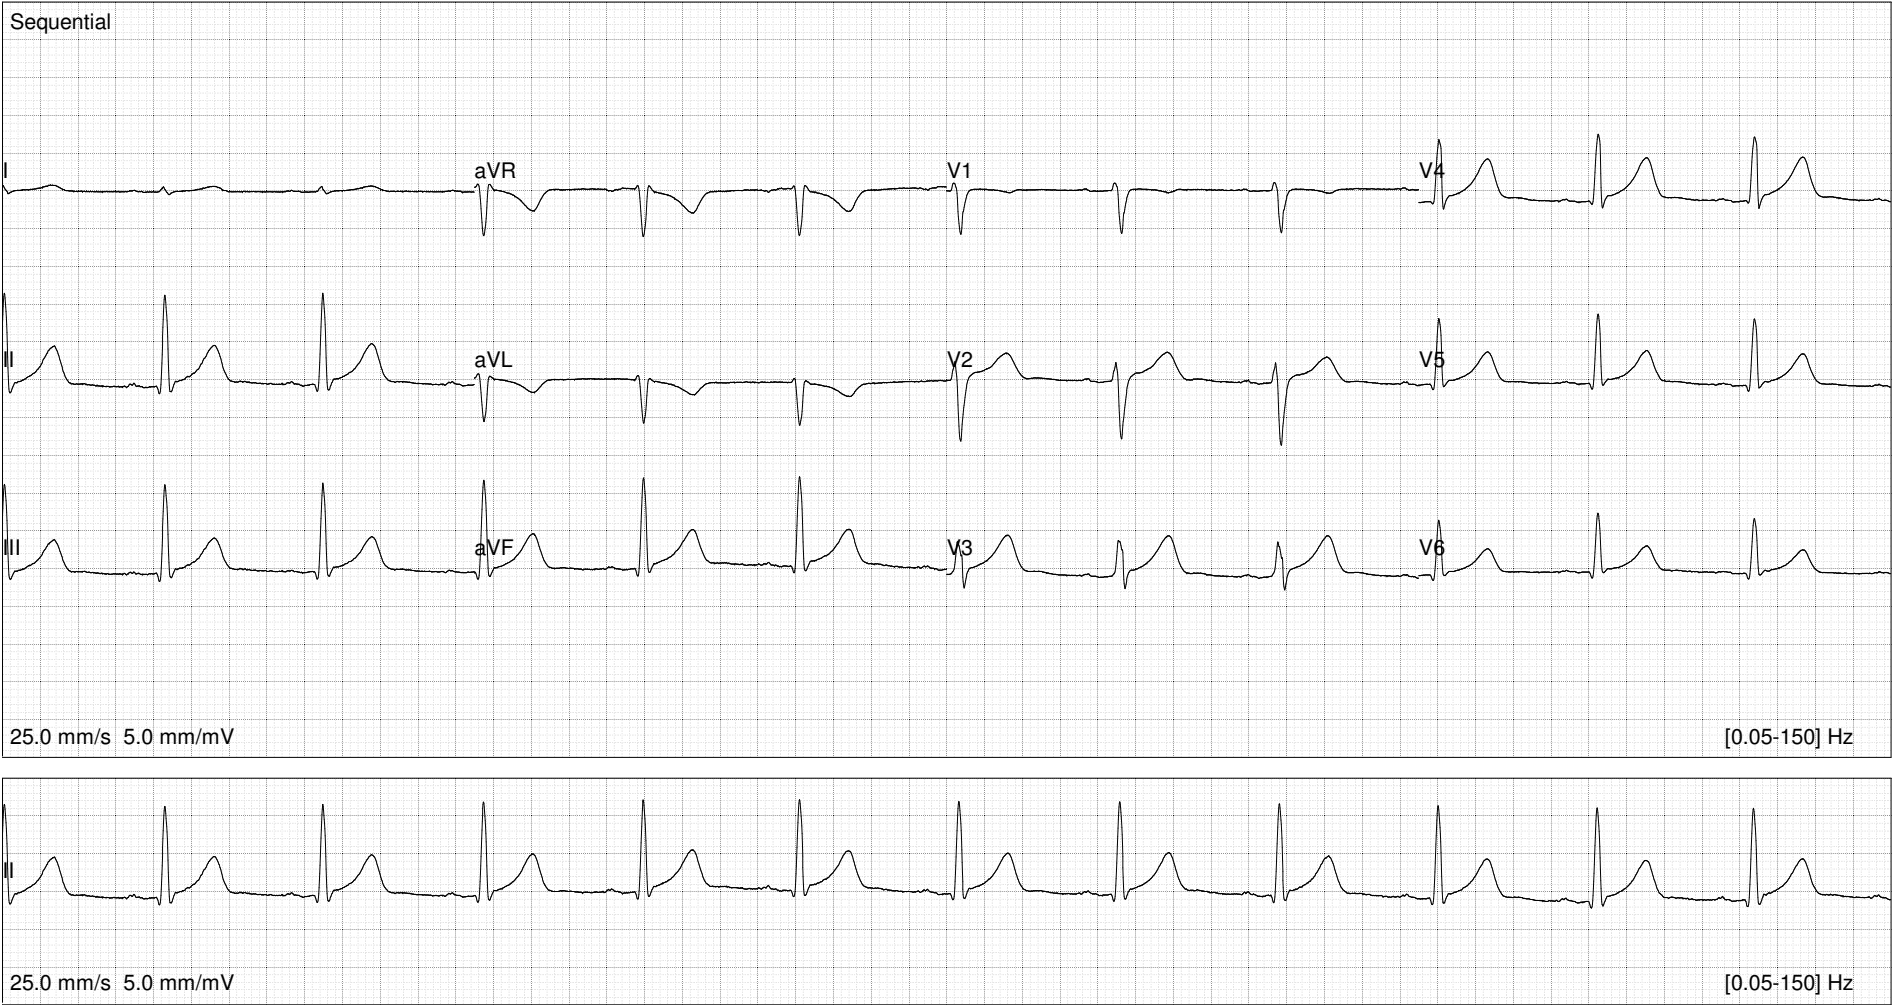

Anton Swart Biokinetic Rehabilitation Practice



Name: 017 017
Number: 017
Gender: Male
Birthdate: 17/11/1971 46 years

P / PQ: 102 ms / 162 ms
QRS: 100 ms
QT / QTc / QTd: 410 ms / 431 ms / -
P/QRS/T axis: 55° / 88° / 82°
Heartrate: 72 bpm

Recorded: 06/05/2018 09:07:31
Recorded by: Mr. Anton Swart
Referring physician:
Location: Anton Swart Biokinetic Rehabilitation Practice
Ordering physician:
Attending physician:
Comment:

UNCONFIRMED INTERPRETATION - MD SHOULD REVIEW




Beats		RR	
Total:	357	Minimum	803 ms
Normal:	357	Maximum	877 ms
Other:	0	Mean:	836 ms
		SD:	15 ms

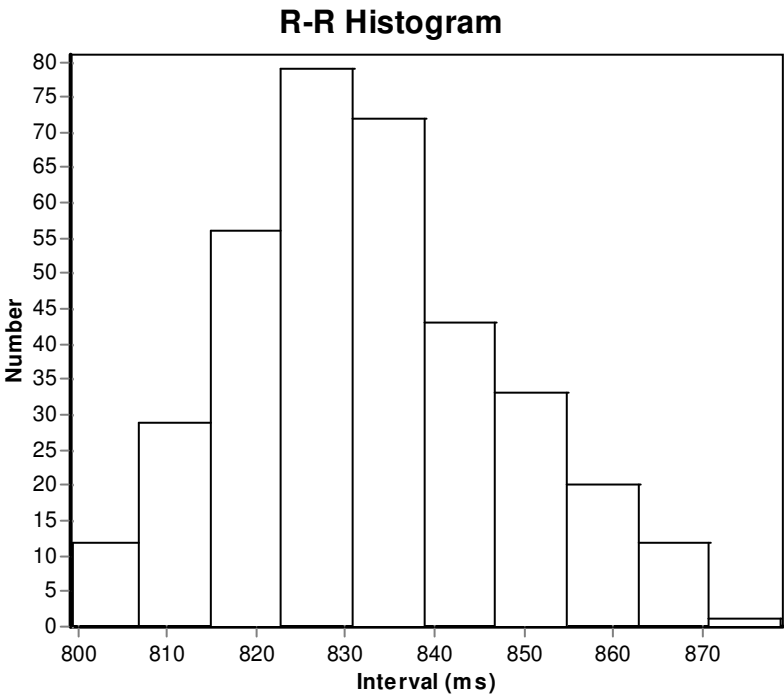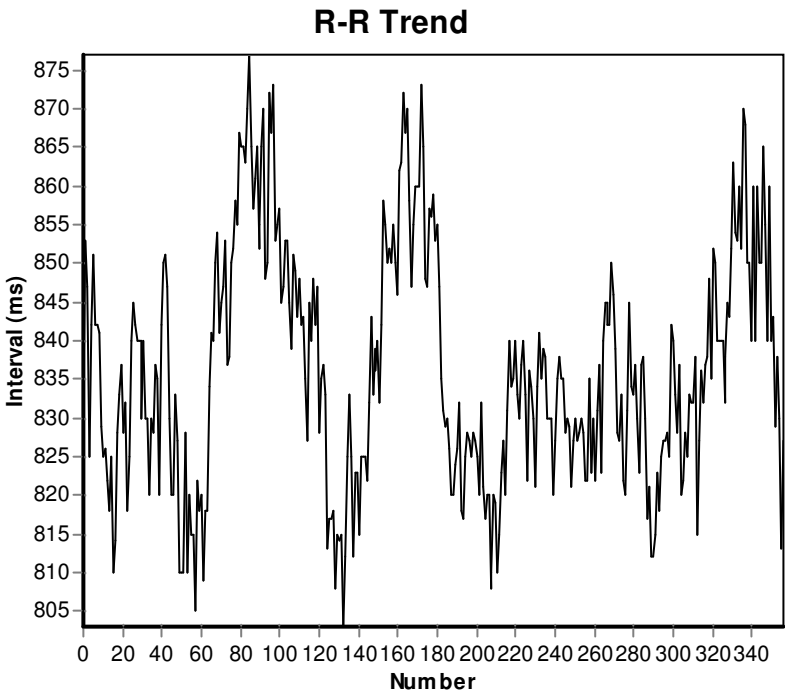

Heart Rate Variability: Time Domain Analysis

Name: 017, 017
Number: 017
Gender: Male

Birthdate: 17/11/1971
Recorded: 06/05/2018 09:07:31

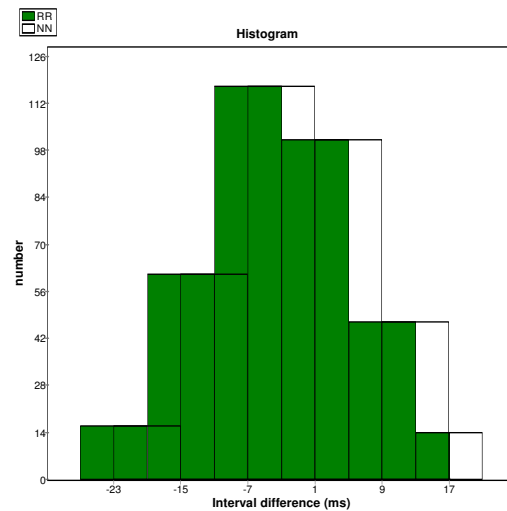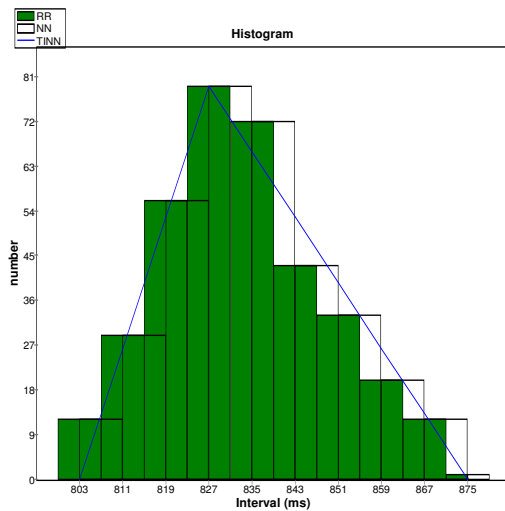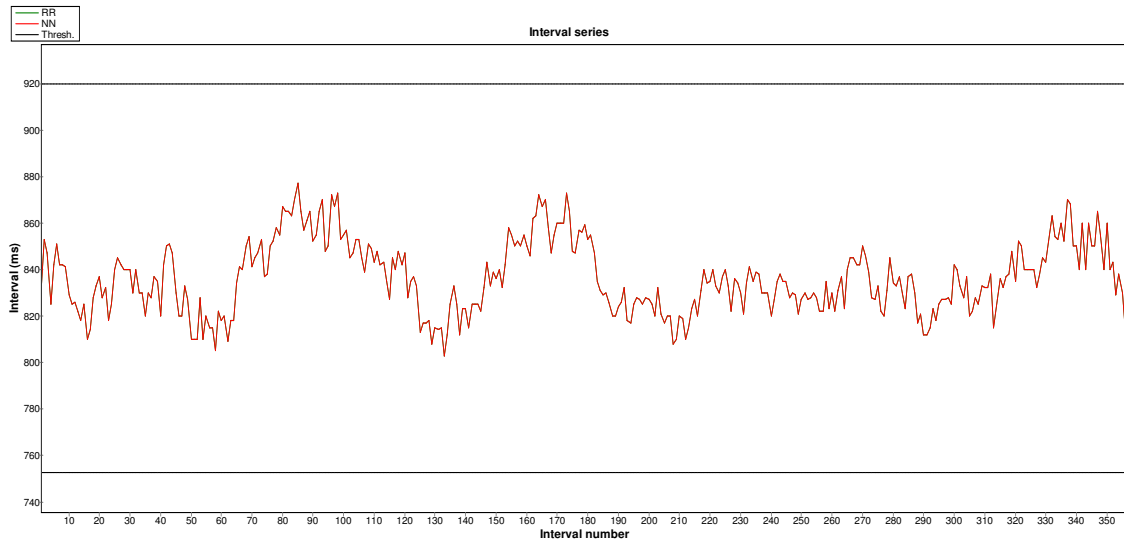

Binsize (ms) = 8

HRV parameters	NN	RR
SDNN (ms)	15	15
Triangular Interpolation (ms)	72	72
Triangular Index	4.52	4.52



HRV parameters	NN	RR
SDSD (ms)	9	9
RMSSD (ms)	9	9
NN50	0	0
NN50(1)	0	0
NN50(2)	0	0
pNN50	0.00	0.00
pNN50(1)	0.00	0.00
pNN50(2)	0.00	0.00
Logarithmic Index	0.92	0.92
SD(Logarithmic Index)	0.19	0.19

Interval statistics	NN	RR
Number	357	357
Minimum (ms)	803	803
Maximum (ms)	877	877
Range (ms)	74	74
Avg (ms)	836	836
SD (ms)	15	15
AvgDev (ms)	12	12
p5 (ms)	813	813
p50 (ms)	835	835
p95 (ms)	865	865
Skewness	0.36	0.36
Kurtosis	2.56	2.56

Interval statistics	NN	RR
Number	356	356
Minimum (ms)	-23	-23
Maximum (ms)	22	22
Range (ms)	45	45
Avg (ms)	-0	-0
SD (ms)	9	9
AvgDev (ms)	7	7
p5 (ms)	-15	-15
p50 (ms)	0	0
p95 (ms)	16	16
Skewness	-0.04	-0.04
Kurtosis	2.79	2.79

Heart Rate Variability: Frequency Domain Analysis

Name: 017, 017 Birthdate: 17/11/1971
 Number: 017 Recorded: 06/05/2018 09:07:31
 Gender: Male

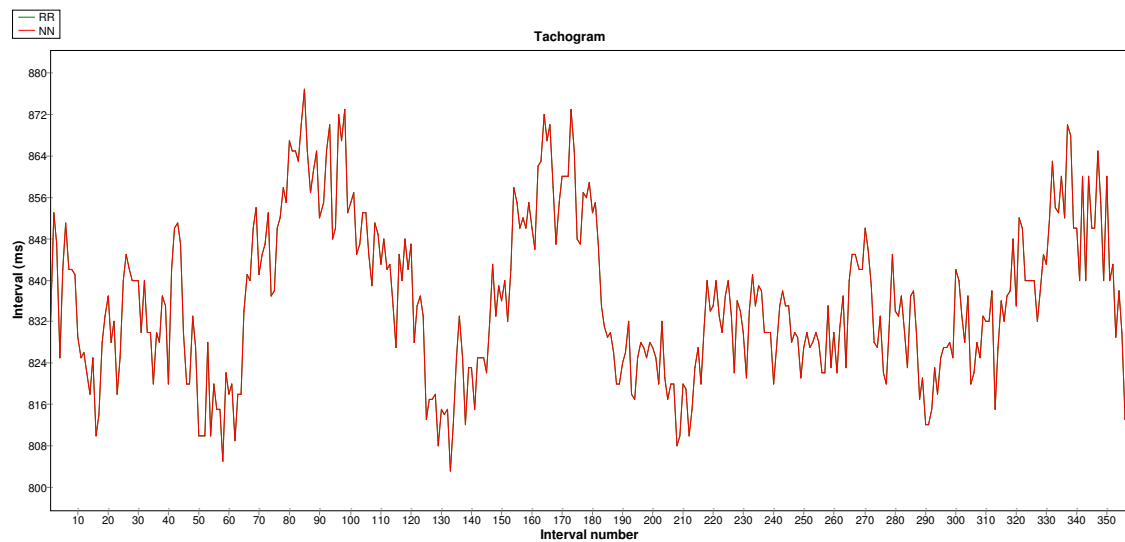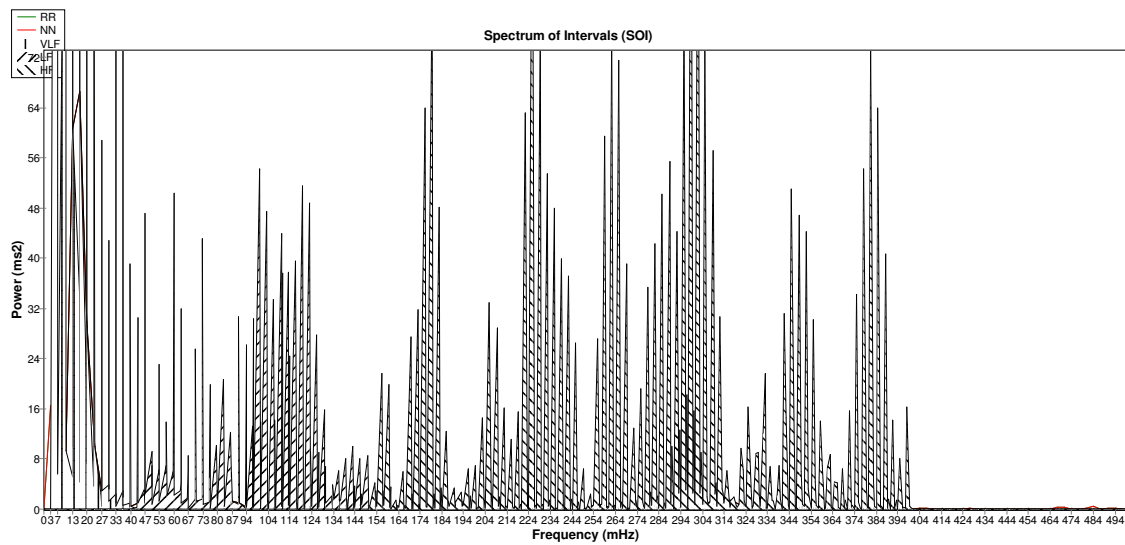

HRV parameters	NN	RR	HRV spectral settings	
TP (ms2)	232	232	Spectrum of Intervals (SOI)	
VLF (ms2)	188	188	Frequency resolution (mHz)	3
LF (ms2)	24	24	VLF lower boundary (mHz)	3
HF (ms2)	20	20	VLF upper boundary (mHz)	40
LF/HF	1.21	1.21	LF upper boundary (mHz)	150
LF normalized	54.77	54.77	HF upper boundary (mHz)	400
HF normalized	45.23	45.23	Smoothing factor	1
VLF peak (mHz)	17	17	Tapering	Hann
LF peak (mHz)	47	47	Fourier transform	DFT
HF peak (mHz)	317	317	Sample frequency (Hz)	1.20
			Interval correction	Annotation
			Interval threshold (%)	10