

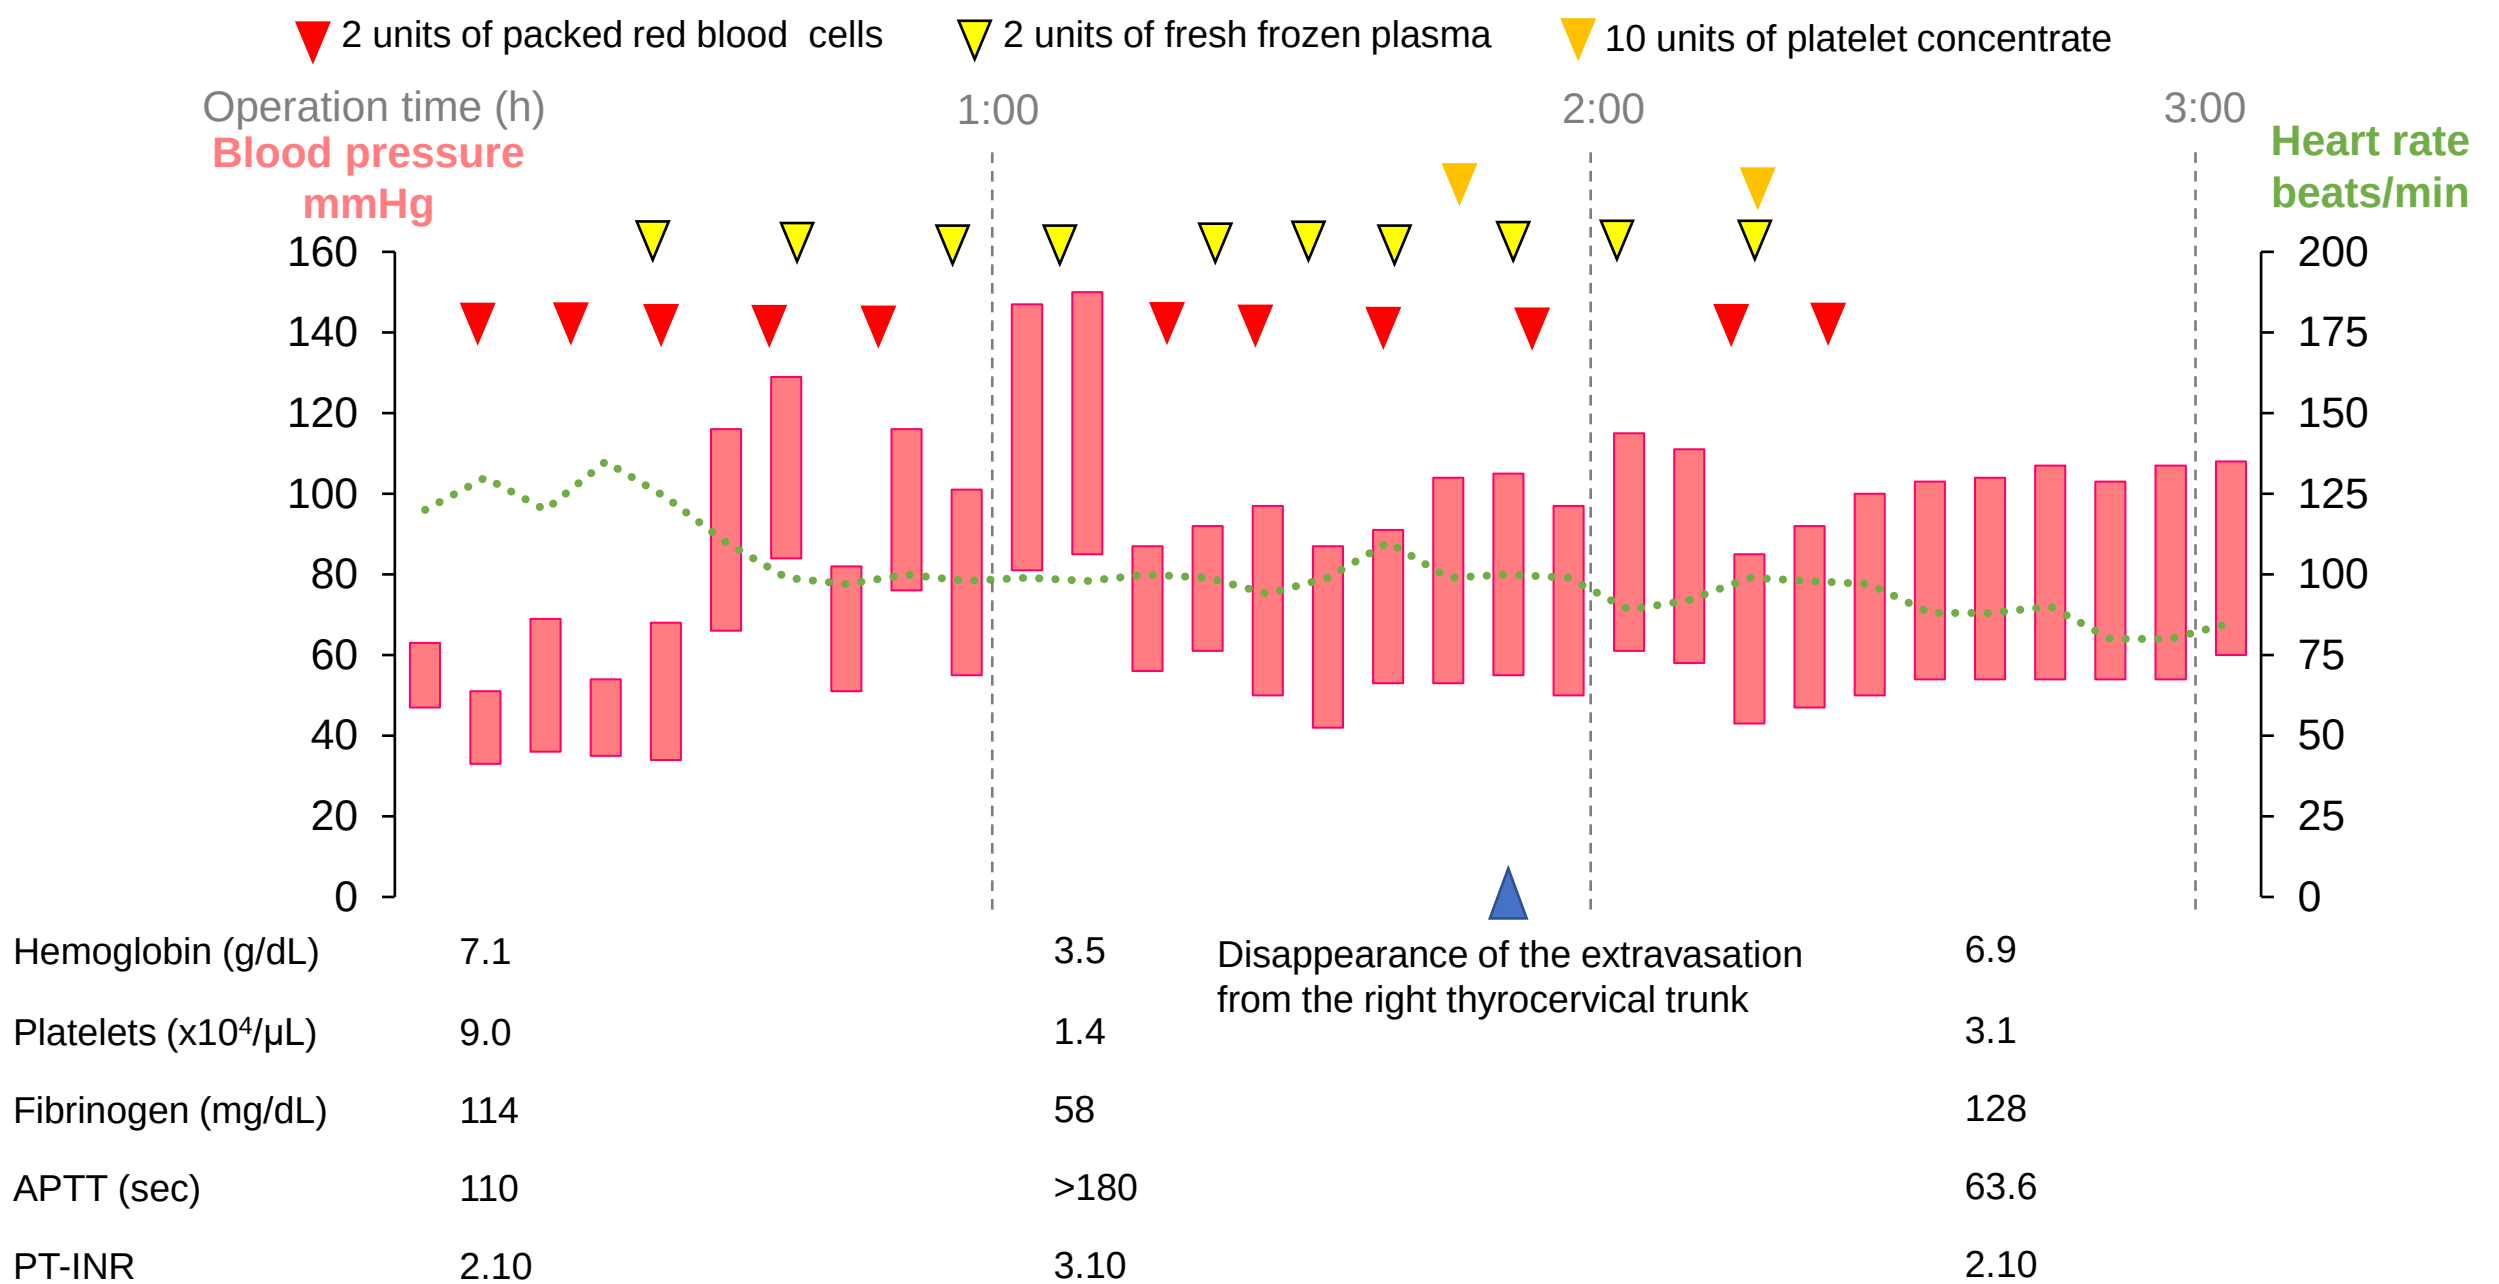


Figure S1. Schema of the operative course at the catheterization laboratory.

PT-INR: international normalized ratio of the prothrombin time; APTT: activated partial thromboplastin time.